VISION OF ENVIRONMENTAL HEALTH:
-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

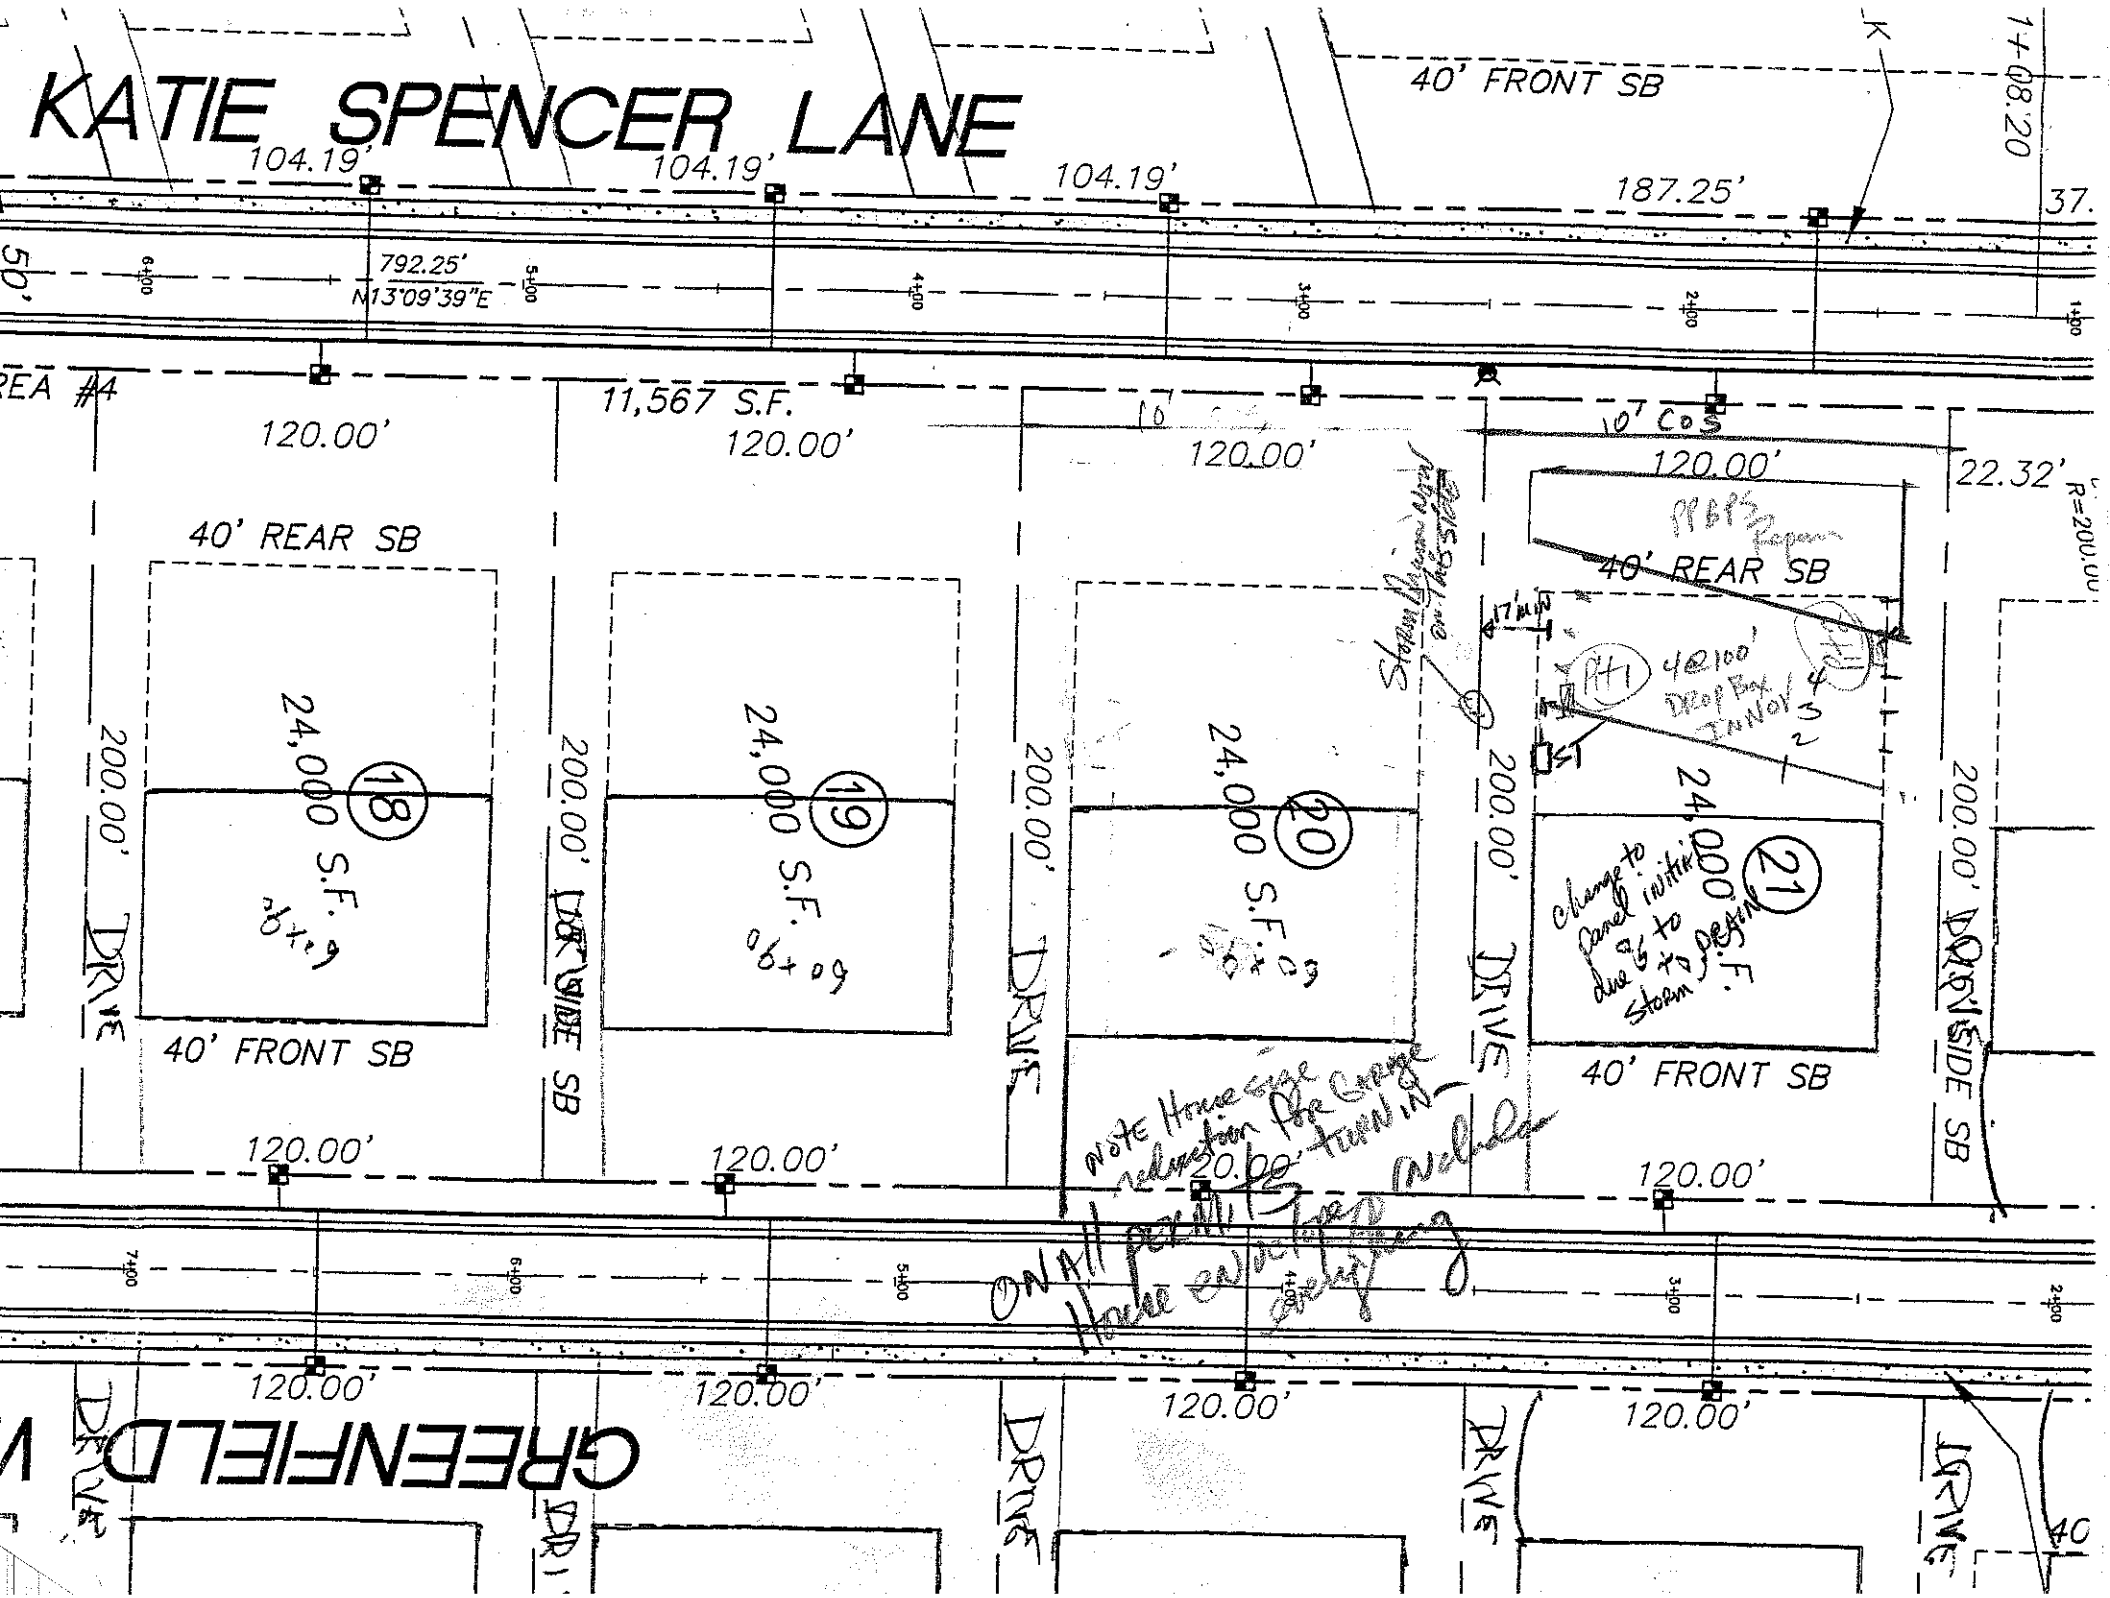
WNER: _____ APPLICANT: _____
DDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 7-30-01
OPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
CATION OF SITE: lot 21 Templeton Farms PROPERTY RECORDED: _____
ATER SUPPLY: ☐ Private ☐ Public ☑ Well ☐ Spring ☐ Other _____
ALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
PE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
①	0-27	gr-vksl sbk/sol	fr ss sp					≈ 3
	27-50	ms sl	vfr ss sp					
			few ind sp					
			few ind rock ~ 30"					
②	0-5	sl sbk/vgrnd	fr ss sp					.25-.3
	5-21	ms sl sbk/gr	fi-fr ss sp					
	21-48	sl sbk	vfr ss sp common manganese coatings					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
uilable Space (.1945)		
tem Type(s)		
LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____
OTHER(S) PRESENT: _____


KATIE SPENCER LANE
104.19'
104.19'
104.19'
187.25'
40' FRONT SB
792.25'
N13°09'39"E
11,567 S.F.
120.00'
120.00'
120.00'
120.00'
10' Cos
22.32'
40' REAR SB
40' REAR SB
24,000 S.F.
18
24,000 S.F.
19
24,000 S.F.
20
24,000 S.F.
21
200.00'
200.00'
200.00'
200.00'
200.00'
DRIVE
DRIVE
DRIVE
DRIVE
DRIVE
40' FRONT SB
40' FRONT SB
120.00'
120.00'
120.00'
120.00'
120.00'
120.00'
120.00'
GREENFIELD
DRIVE
DRIVE
DRIVE
DRIVE
DRIVE
change to panel within due to storm pipe
ON all perimeter Home owner landscaping