4646-06-9049

IREDELL COUNTY HEALTH DEPARTMENT

112.00

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Norman Beckham DATE 12/6/91 PERMIT NO. 2K-2-B-2

PHONE: Business _____ Home 664-2787

LOCATION Woodduck Loop, Brawley School TL Canvasback TL on Woodduck Lp. ~.3 mile on (R) S. R. No. _____

SUBDIVISION NAME Lakeshore Estates LOT NO. ~~15~~ 2 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2.5

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil P - c - (ss) (sbk)
Percolation Rate 4
Topography 2-5%
Depth to Water Table > 48"
Rock or other impervious formations None observed

Lot Area 20,000 FT²

_____ Basement with Plumbing ✓ Basement without Plumbing _____ No Basement

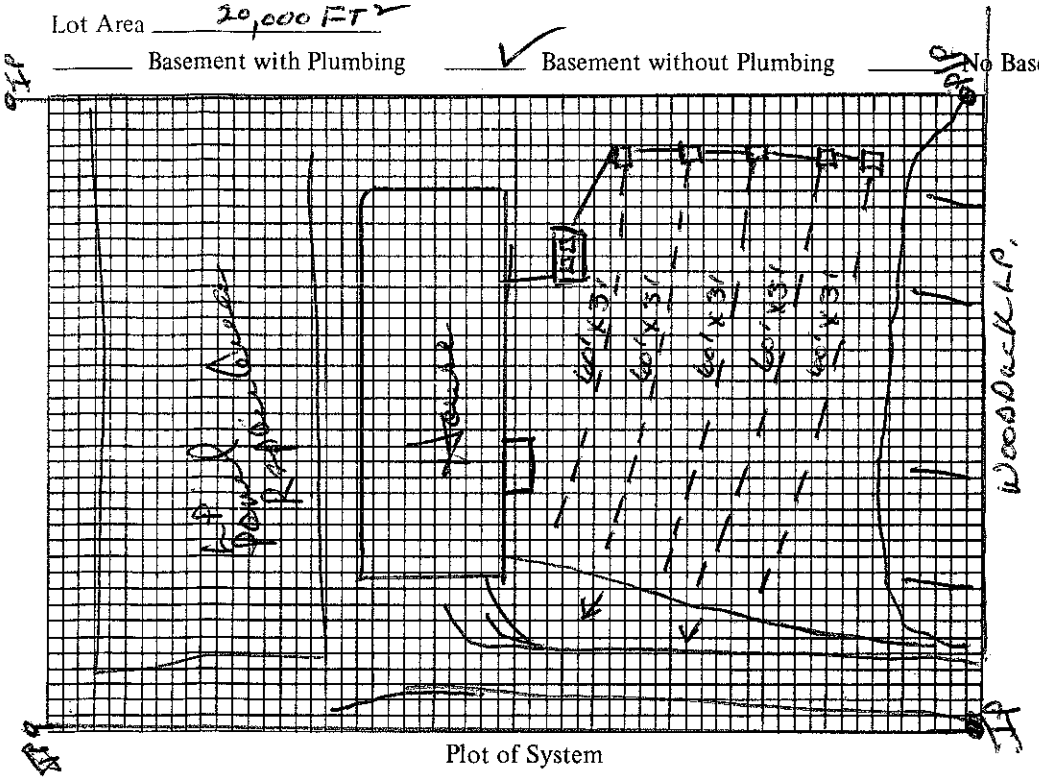

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 5 @ 60' x 3'
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"

Water Supply: Individual ( ) Public ✓ comm system
No well in at this time.

Installed by FJ Erwin

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Wesley Sparks RS. DATE 12/6/91

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold