9/8/92 – Drainfield Balanced and approved – AOS – Need Maint. Agreement.

IREDELL COUNTY HEALTH DEPARTMENT

13890

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Kerry Miller DATE 1/8/92 PERMIT NO. 2K-11-A-13

PHONE: Business ______ Home 568-8099

LOCATION Woodduck Lp; Canvasback (L) off Brawley School, (L) first Woodduck Lp, ~1/4 mile on (L) S. R. No. ______

SUBDIVISION NAME Lakeside Farms LOT NO. 13 SECTION OR BLOCK NO. ______

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 4 No. Bathrooms 2.5

	Yes	No
Garbage Disposal Unit	( )	(✓)
Auto. Dishwasher	(✓)	( )
Auto. Wash. Machine	(✓)	( )
Site Suitable	(✓)	( )

Character & Porosity of Soil P – c (sa – sp)

Percolation Rate .4


Topography P 5-8%

Depth to Water Table S >48"

Rock or other impervious formations S – None observed

Lot Area 20,000 FT²

✓ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

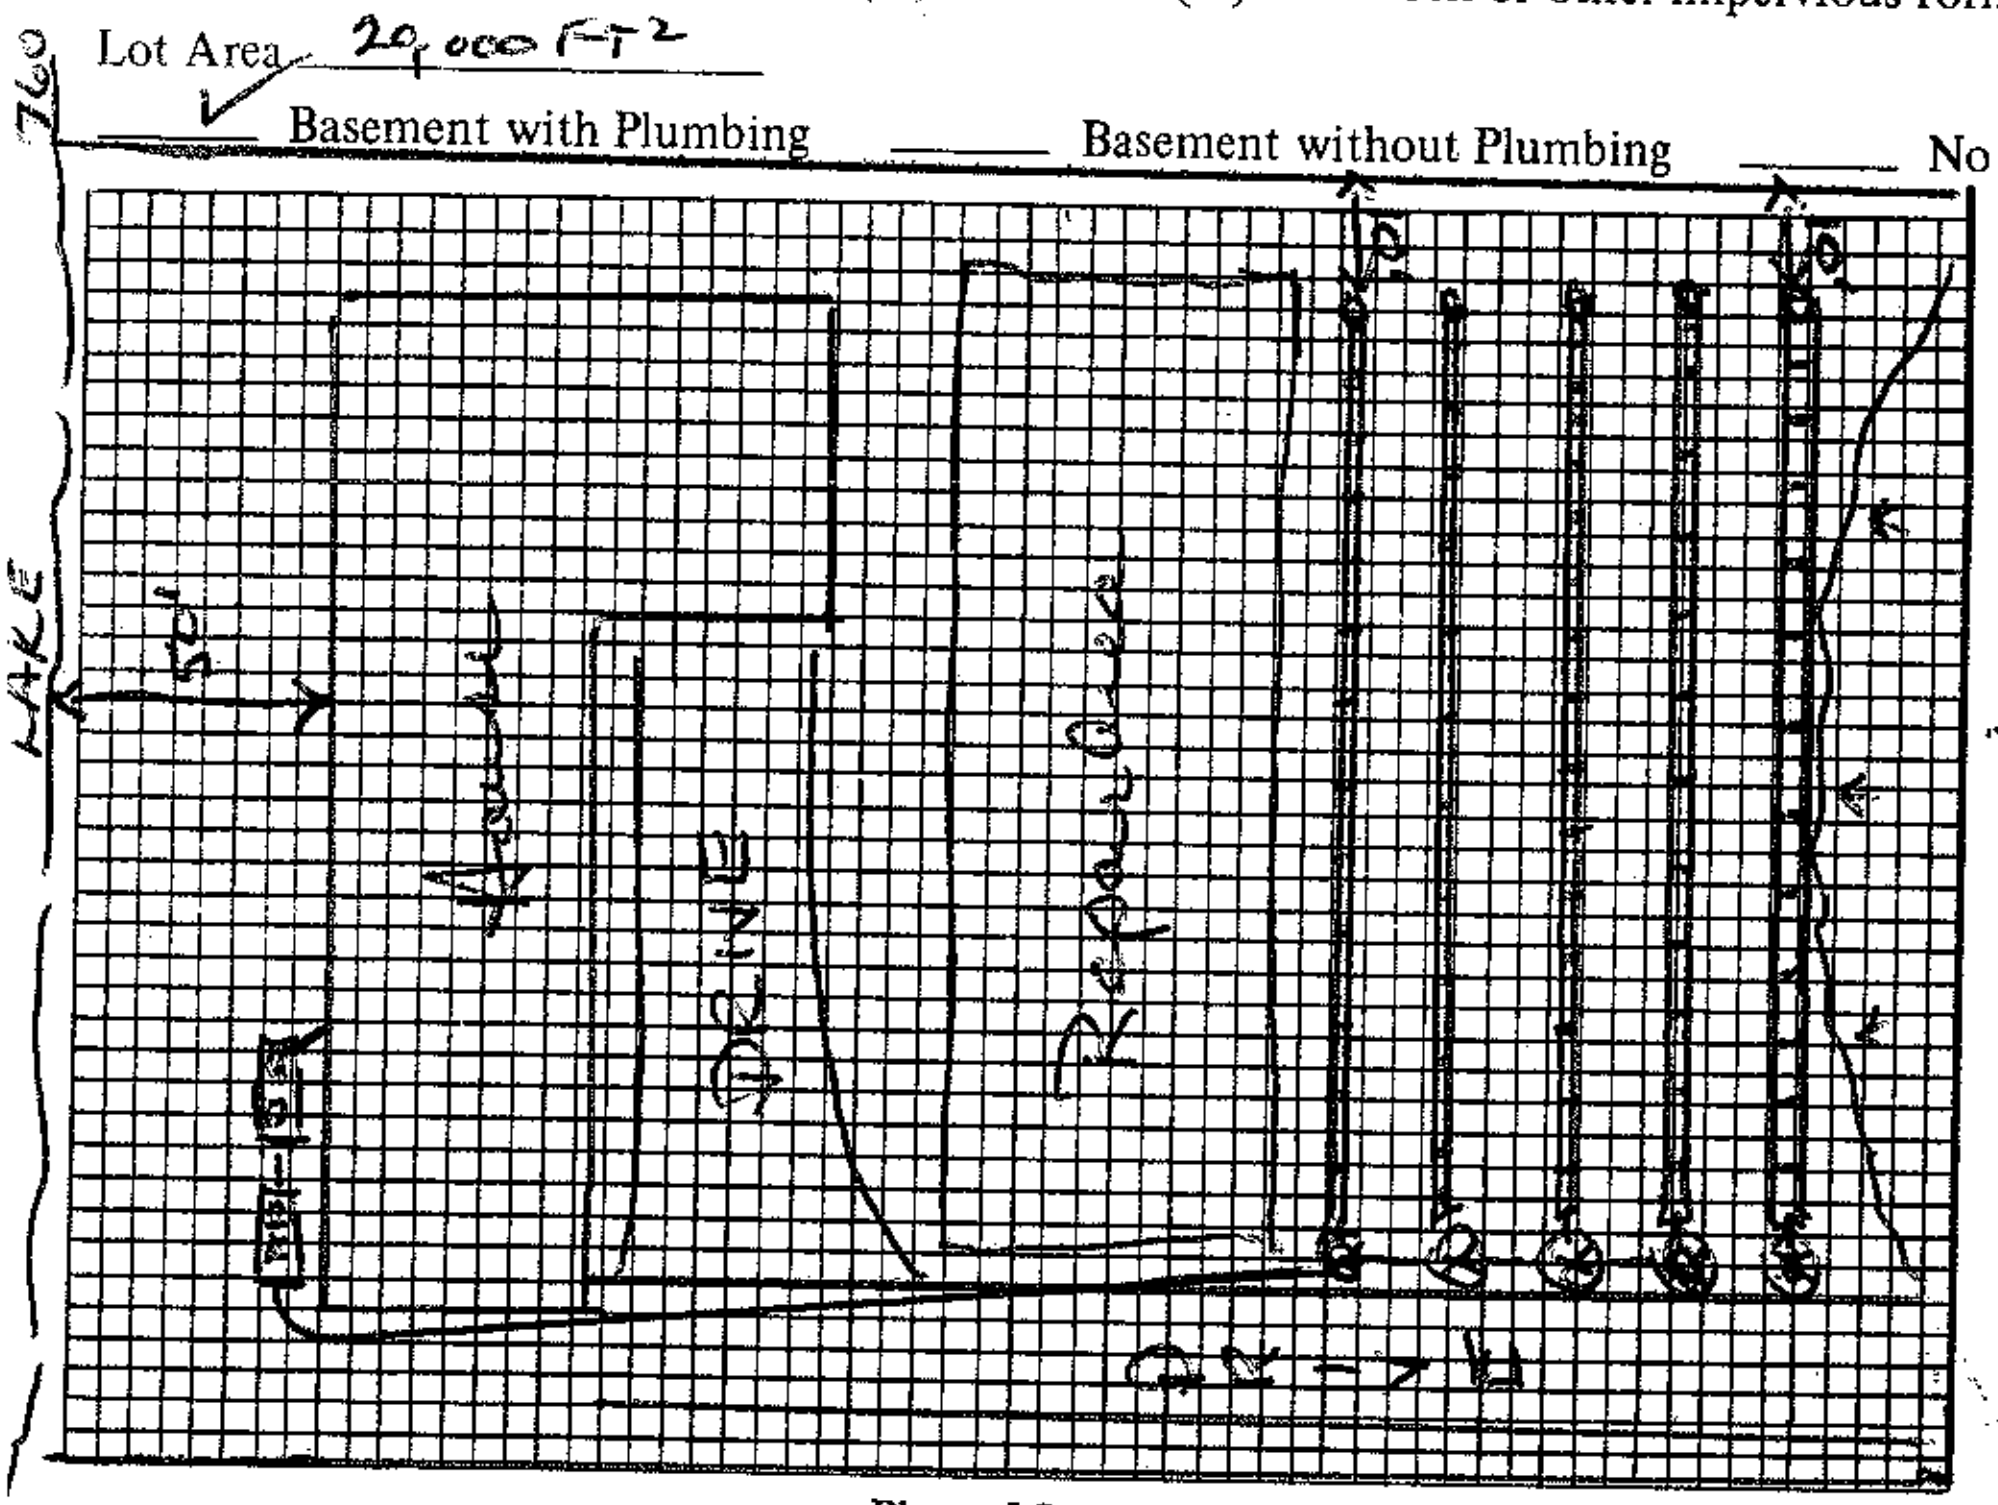

1000 – Pump Tank

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 5 @ 60' x 3'

Sq. Ft. ______ Linear Ft. 300 *(1)

Depth of Stone in Lines ______

Water Supply: Individual ( )

Public ( )

*(1) 16" Prefabricated Permeable Panel Block – Pressure dosed

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

Plot of System

IMPROVEMENTS PERMIT BY Wesley Sparks RS.

COMMENTS: 1 1/4 PVC SCH 40 pipe with one 3/16" hole drilled per panel. 2' stand pipe at the end of each drain line. Trenches to be no deeper than 24" to trench bottom. Lines to be on slope contour as shown in this drawing.

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold