4646308155

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Phillip Simmons DATE 11-15-84 PERMIT NO. 421

PHONE: Business _____ Home _____

LOCATION Hwy 21 S TL 1207 TR 1310 Go to end of pavement on R S. R. No. _____

SUBDIVISION NAME Catalina Cove LOT NO. 33 SECTION OR BLOCK NO. B

Site Address: 388 Catalina Drive - Mooresville 32


House (X) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (X)	Character & Porosity of Soil	Clay loam
Auto. Dishwasher	Yes (X)	No ( )	Percolation Rate	0.5 gpl. 10 [illegible]
Auto. Wash. Machine	Yes (X)	No ( )	Topography	[illegible]
Site Suitable	Yes (X)	No ( )	Depth to Water Table	4
			Rock or other impervious formations	None

Lot Area 20,000 Ft²

_____ Basement with Plumbing _____ Basement without Plumbing X No Basement

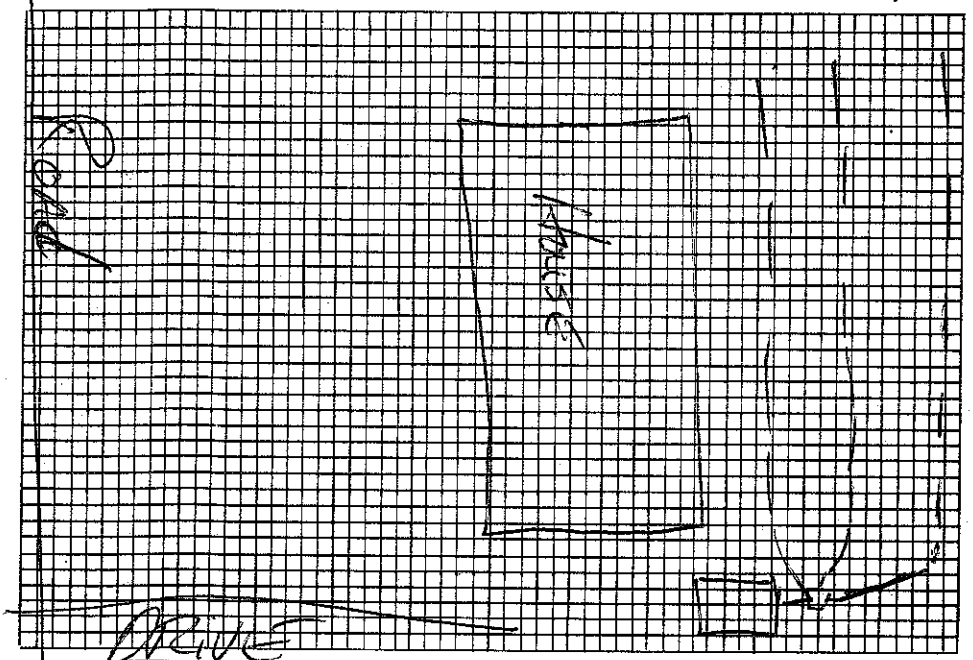

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3
Sq. Ft. 720 Linear Ft. 240
Depth of Stone in Lines 24

Water Supply: Individual (X) Public ( )

Installed by J. Ervin

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY C.K. Bennett

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Fred Clemmer DATE 11-15-84

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

2.00

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Philip Simmons DATE 11-9-84 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 21S TL 1206 TR Catina Rd go to the end

S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (X) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (X)

Auto. Dishwasher Yes (X) No ( )

Auto. Wash. Machine Yes (X) No ( )

Site Suitable Yes (X) No ( )

Lot Area 20,000 ft2

Character & Porosity of Soil Clay loam


Percolation Rate 0.5 gal/ft2/day

Topography 2-8%

Depth to Water Table 4'

Rock or other impervious formations None observed

_____ Basement with Plumbing _____ Basement without Plumbing 1 No Basement

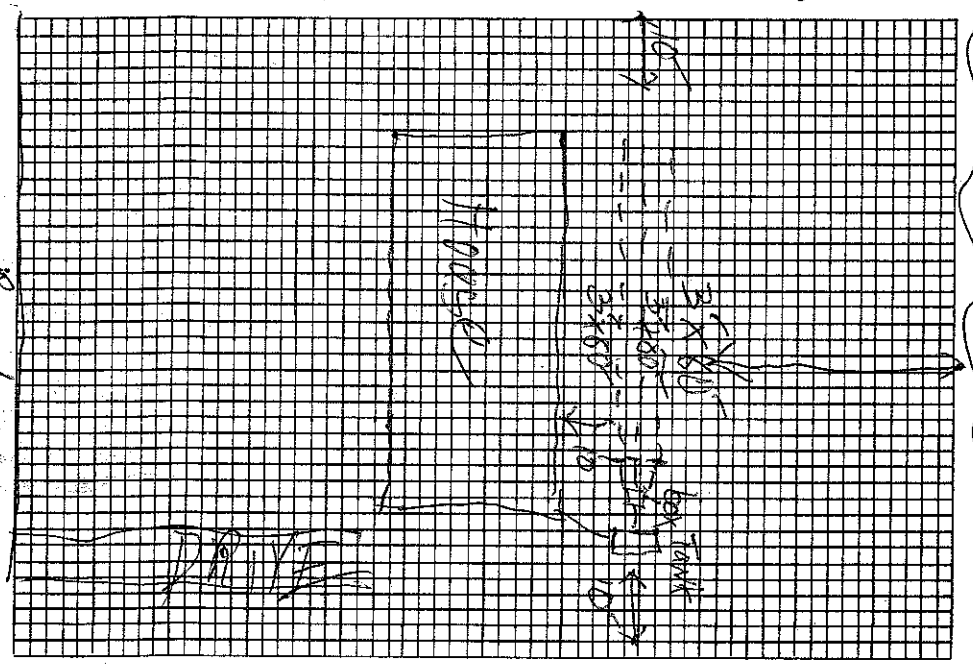

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 720 Linear Ft. 240

Depth of Stone in Lines 12"

Water Supply: Individual (X)

Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Calvin Kenley Jr

IMPROVEMENTS PERMIT BY Charles K. Barnett

COMMENTS: _____

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold