DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

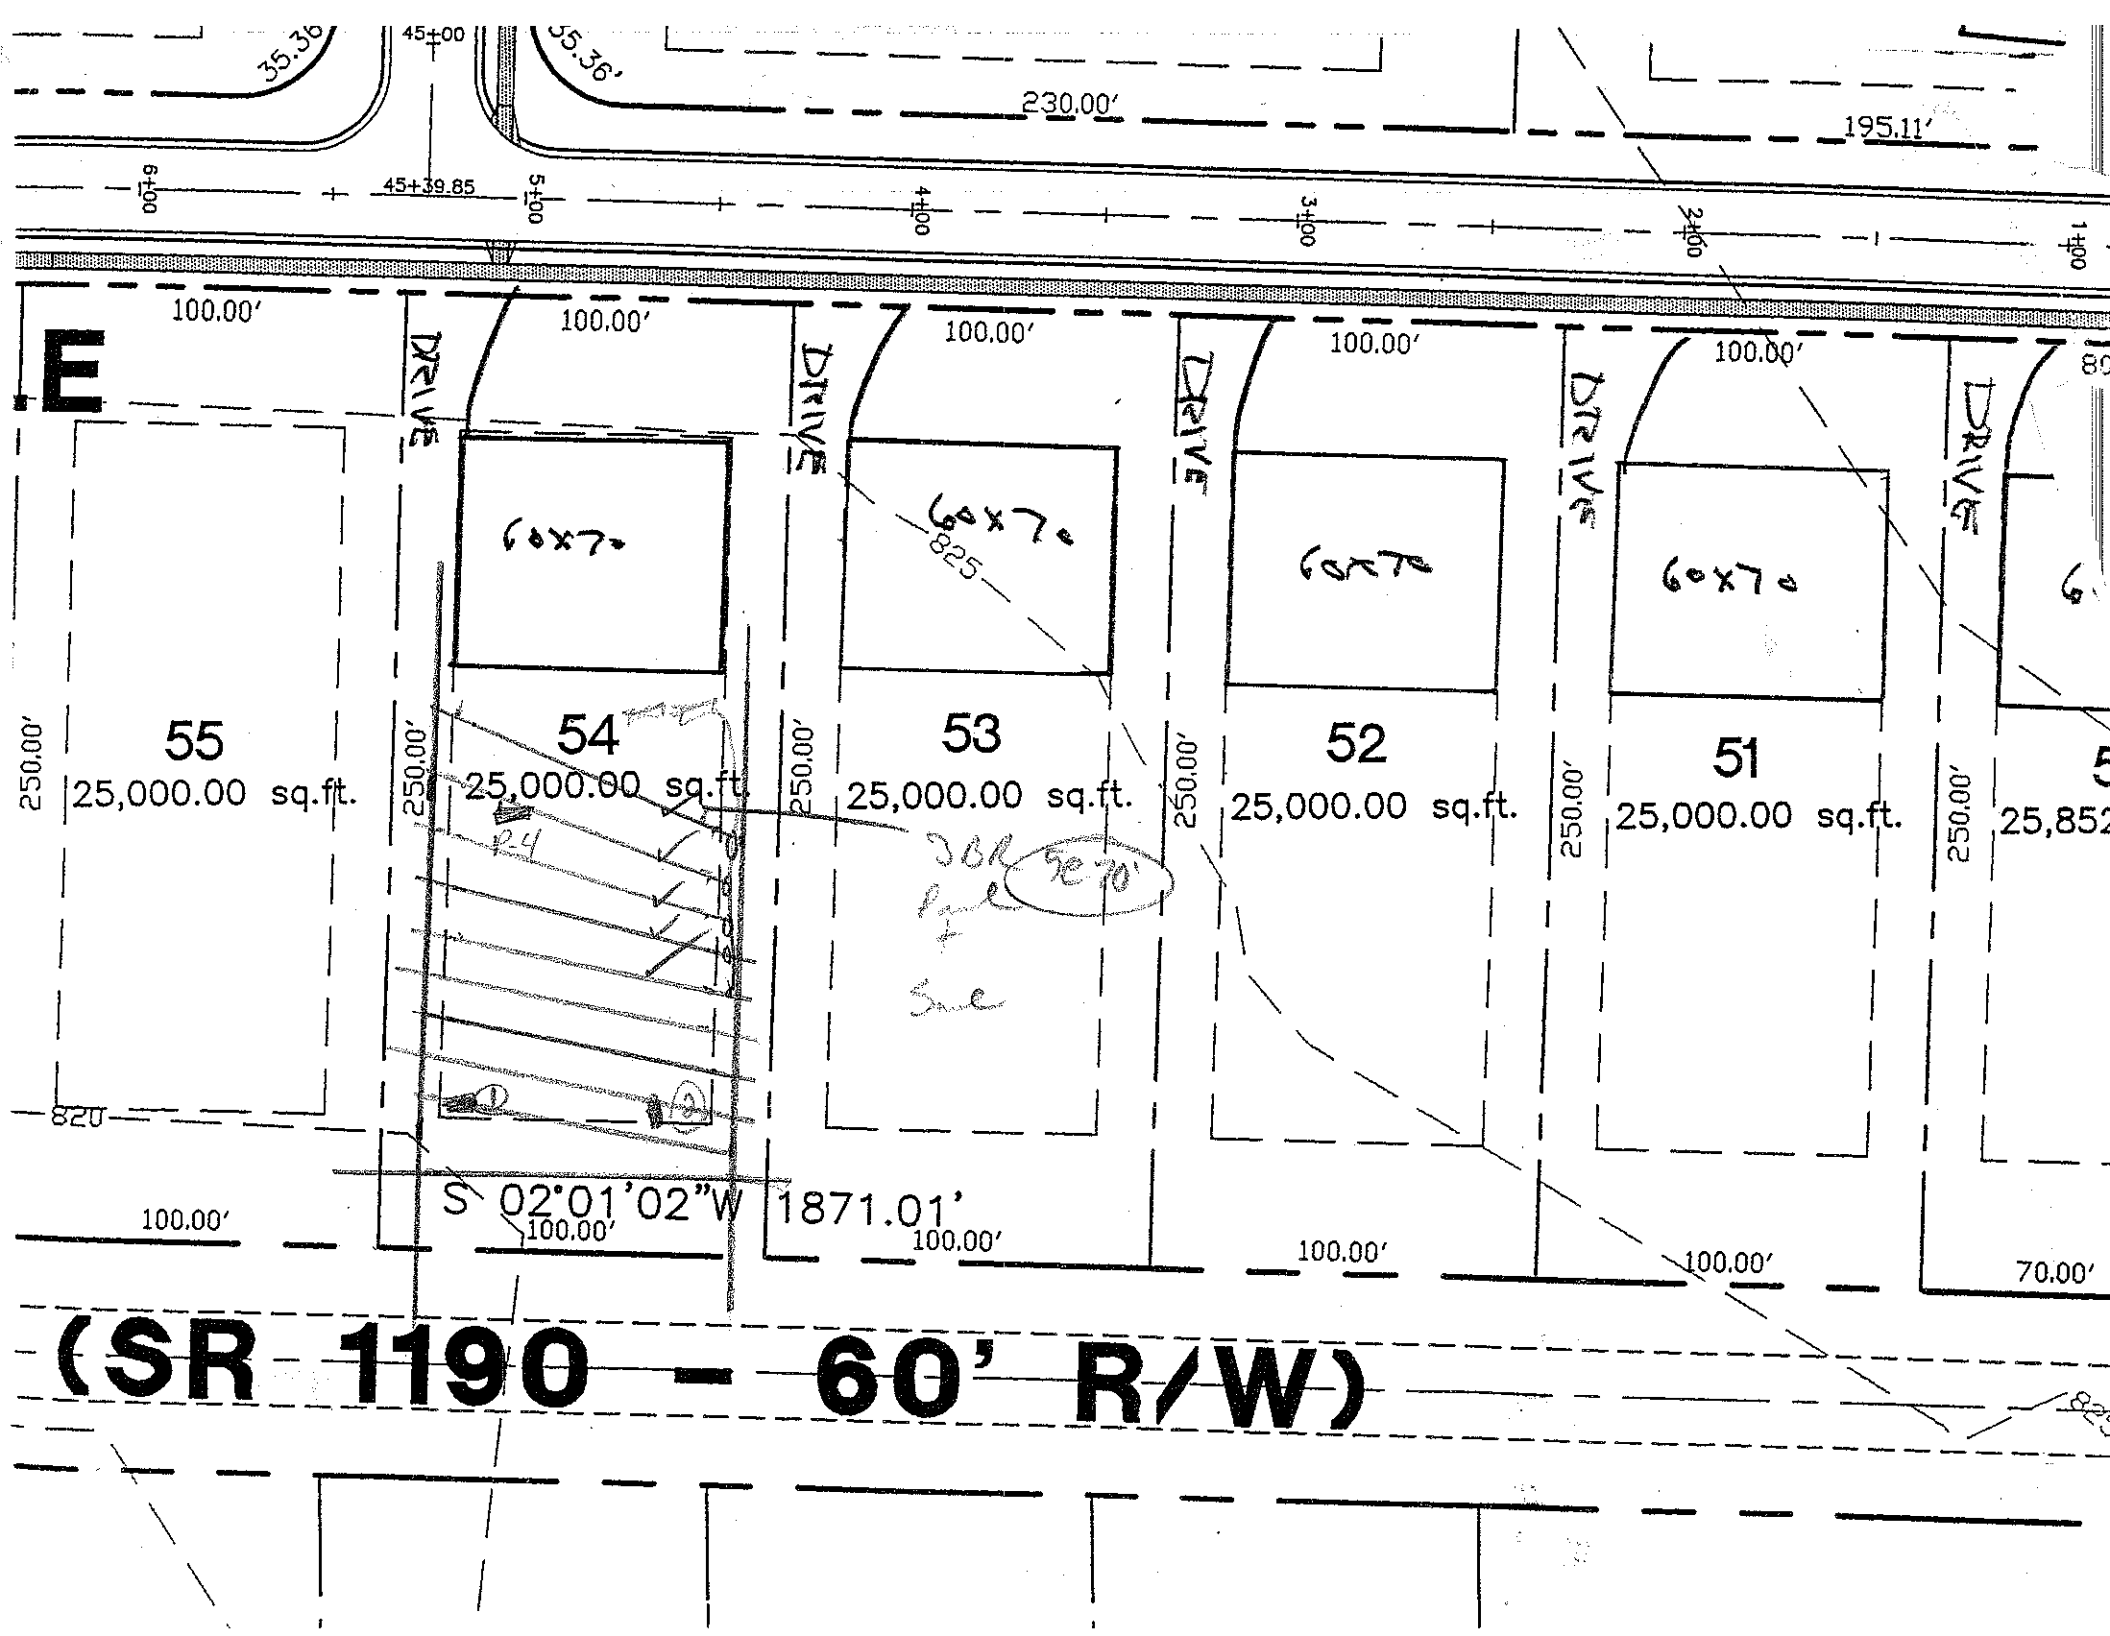
OWNER: _____ APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 5-16-02
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 59 Sundown Cove PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-22	wk sbk lm sl	fr ss sp	few many coarse prom Brown Mott				.25
		22-51	AB/SBK RC	fr ss sp					
2		0-9	wk sbk lm sl	fr ss sp	common many coarse few common prom Brown Mott				.2
		9-52	sbk/ma rc	fi-fr st sp					
3	f-4 fcs	0-8	massive wk sbk lm sl	fr ss sp	common few many coarse prom				.25 max
		8-45	MMA rc	fi sp					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____

COMMENTS: _____


35.36'
45+00
35.36'
230.00'
195.11'
6+00
45+39.85
5+00
4+00
3+00
2+00
1+00
E
100.00'
DRIVE
60x70
825
55
25,000.00 sq.ft.
54
25,000.00 sq.ft.
53
25,000.00 sq.ft.
52
25,000.00 sq.ft.
51
25,000.00 sq.ft.
250.00'
820
S 02°01'02"W 1871.01'
70.00'
(SR 1190 - 60' R/W)