4646471177

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Roger Edwards DATE 9-28-84 PERMIT NO. 353

PHONE: Business ______ Home ______

LOCATION 150W on TR 1109, TR 1190, TR 1290 TR Elysean Drive, ¼ mile on left S. R. No. ______

SUBDIVISION NAME ~~Woodland Hills~~ Mooreland Est. LOT NO. 33 SECTION OR BLOCK NO. ______

House (X) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (X)

Auto. Dishwasher Yes (X) No ( )

Auto. Wash. Machine Yes (X) No ( )

Site Suitable Yes (X) No ( )

Lot Area 20,000 Ft²

Character & Porosity of Soil Clay


Percolation Rate 0.5 gal/ft²/day

Topography 2-10%

Depth to Water Table ______

Rock or other impervious formations None obs

____ Basement with Plumbing ____ Basement without Plumbing ____ No Basement

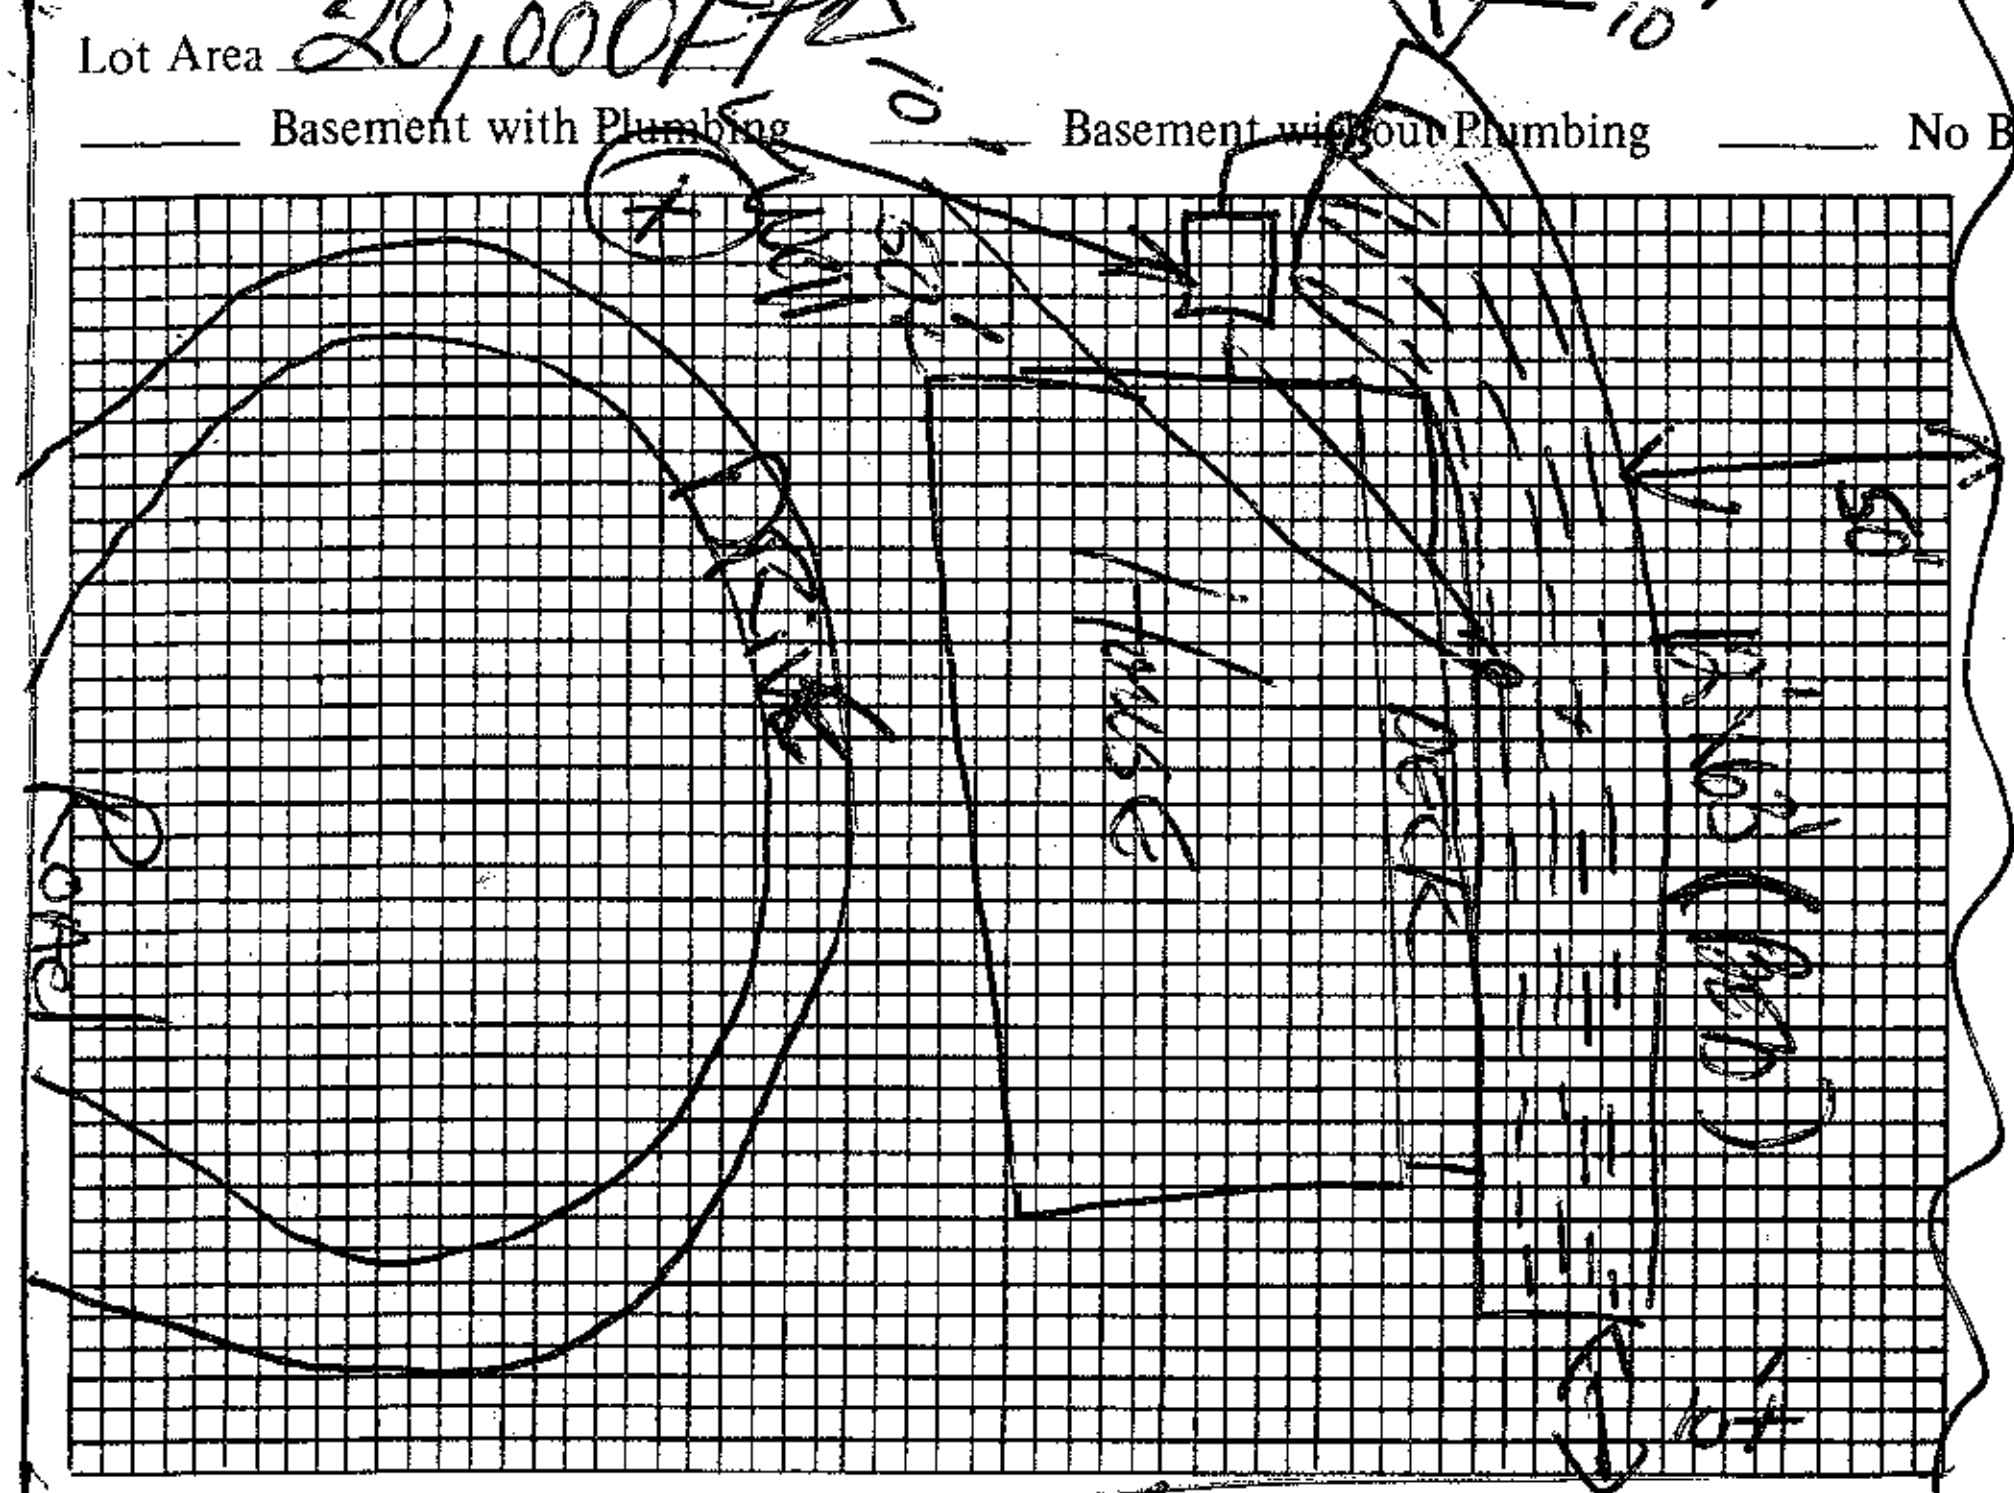

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 4

Sq. Ft. 750 Linear Ft. 250

Depth of Stone in Lines 18"

Water Supply: Individual (X) Public ( )

Installed by J. R. Bowles

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY Fred Clemmer

COMMENTS: Relayout by FHC used 18" stone for extra length compensation

CERTIFICATE OF COMPLETION BY Fred Clemmer DATE 9-28-84

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

Final 2:00

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Roger Edwards DATE 6-13-84 PERMIT NO. 155

PHONE: Business _____ Home _____

LOCATION 150W TL 1109 TR 1190 TL 1290 R Clipper Drive ¼ mile on left

SUBDIVISION NAME Moreland Estates LOT NO. 33 SECTION OR BLOCK NO. _____ S. R. No. _____

House (X) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (X)

Auto. Dishwasher Yes (X) No ( )

Auto. Wash. Machine Yes (X) No ( )

Site Suitable Yes (X) No ( )

Lot Area 20,000+/-


Character & Porosity of Soil Clay

Percolation Rate 2 5 10 60 24 Hr/day

Topography

Depth to Water Table

Rock or other impervious formations None obs.

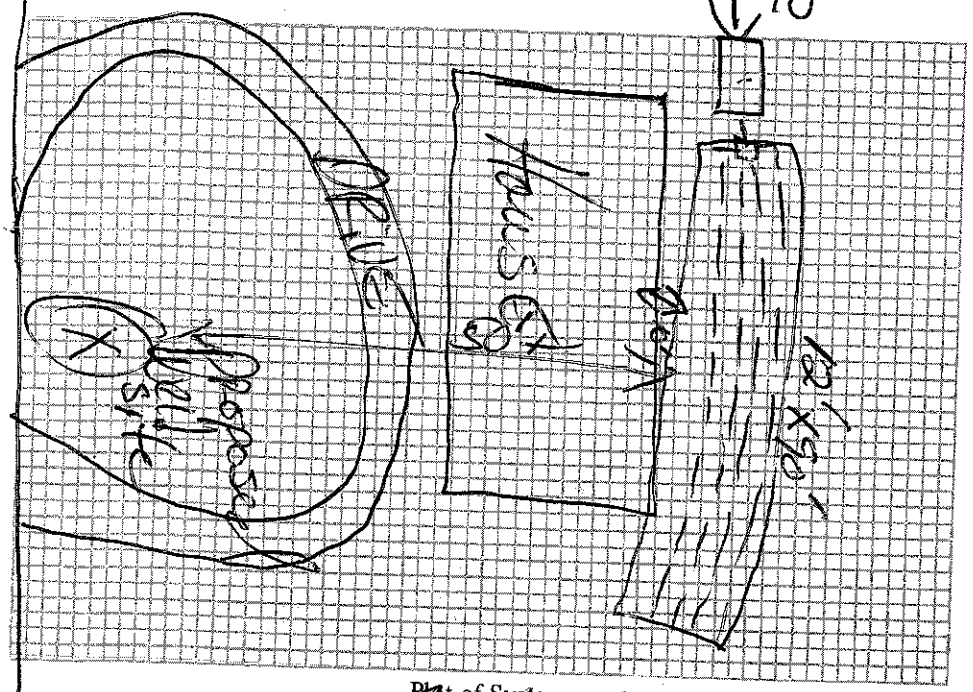

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 4

Sq. Ft. 1080 Linear Ft. ~~360~~

Depth of Stone in Lines 12

Water Supply: Individual (X)

Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: X Jerry McNinch

IMPROVEMENTS PERMIT BY Fred Clemmons

COMMENTS: Keep system shallow follow contours

CERTIFICATE OF COMPLETION BY _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold