for ON-SITE WASTEWATER SYSTEM

WNER: _____ APPLICANT: _____

DDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 8-22-01

OPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____

CATION OF SITE: Lot 45 Templeton Farms PROPERTY RECORDED: _____

ATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____

ALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut

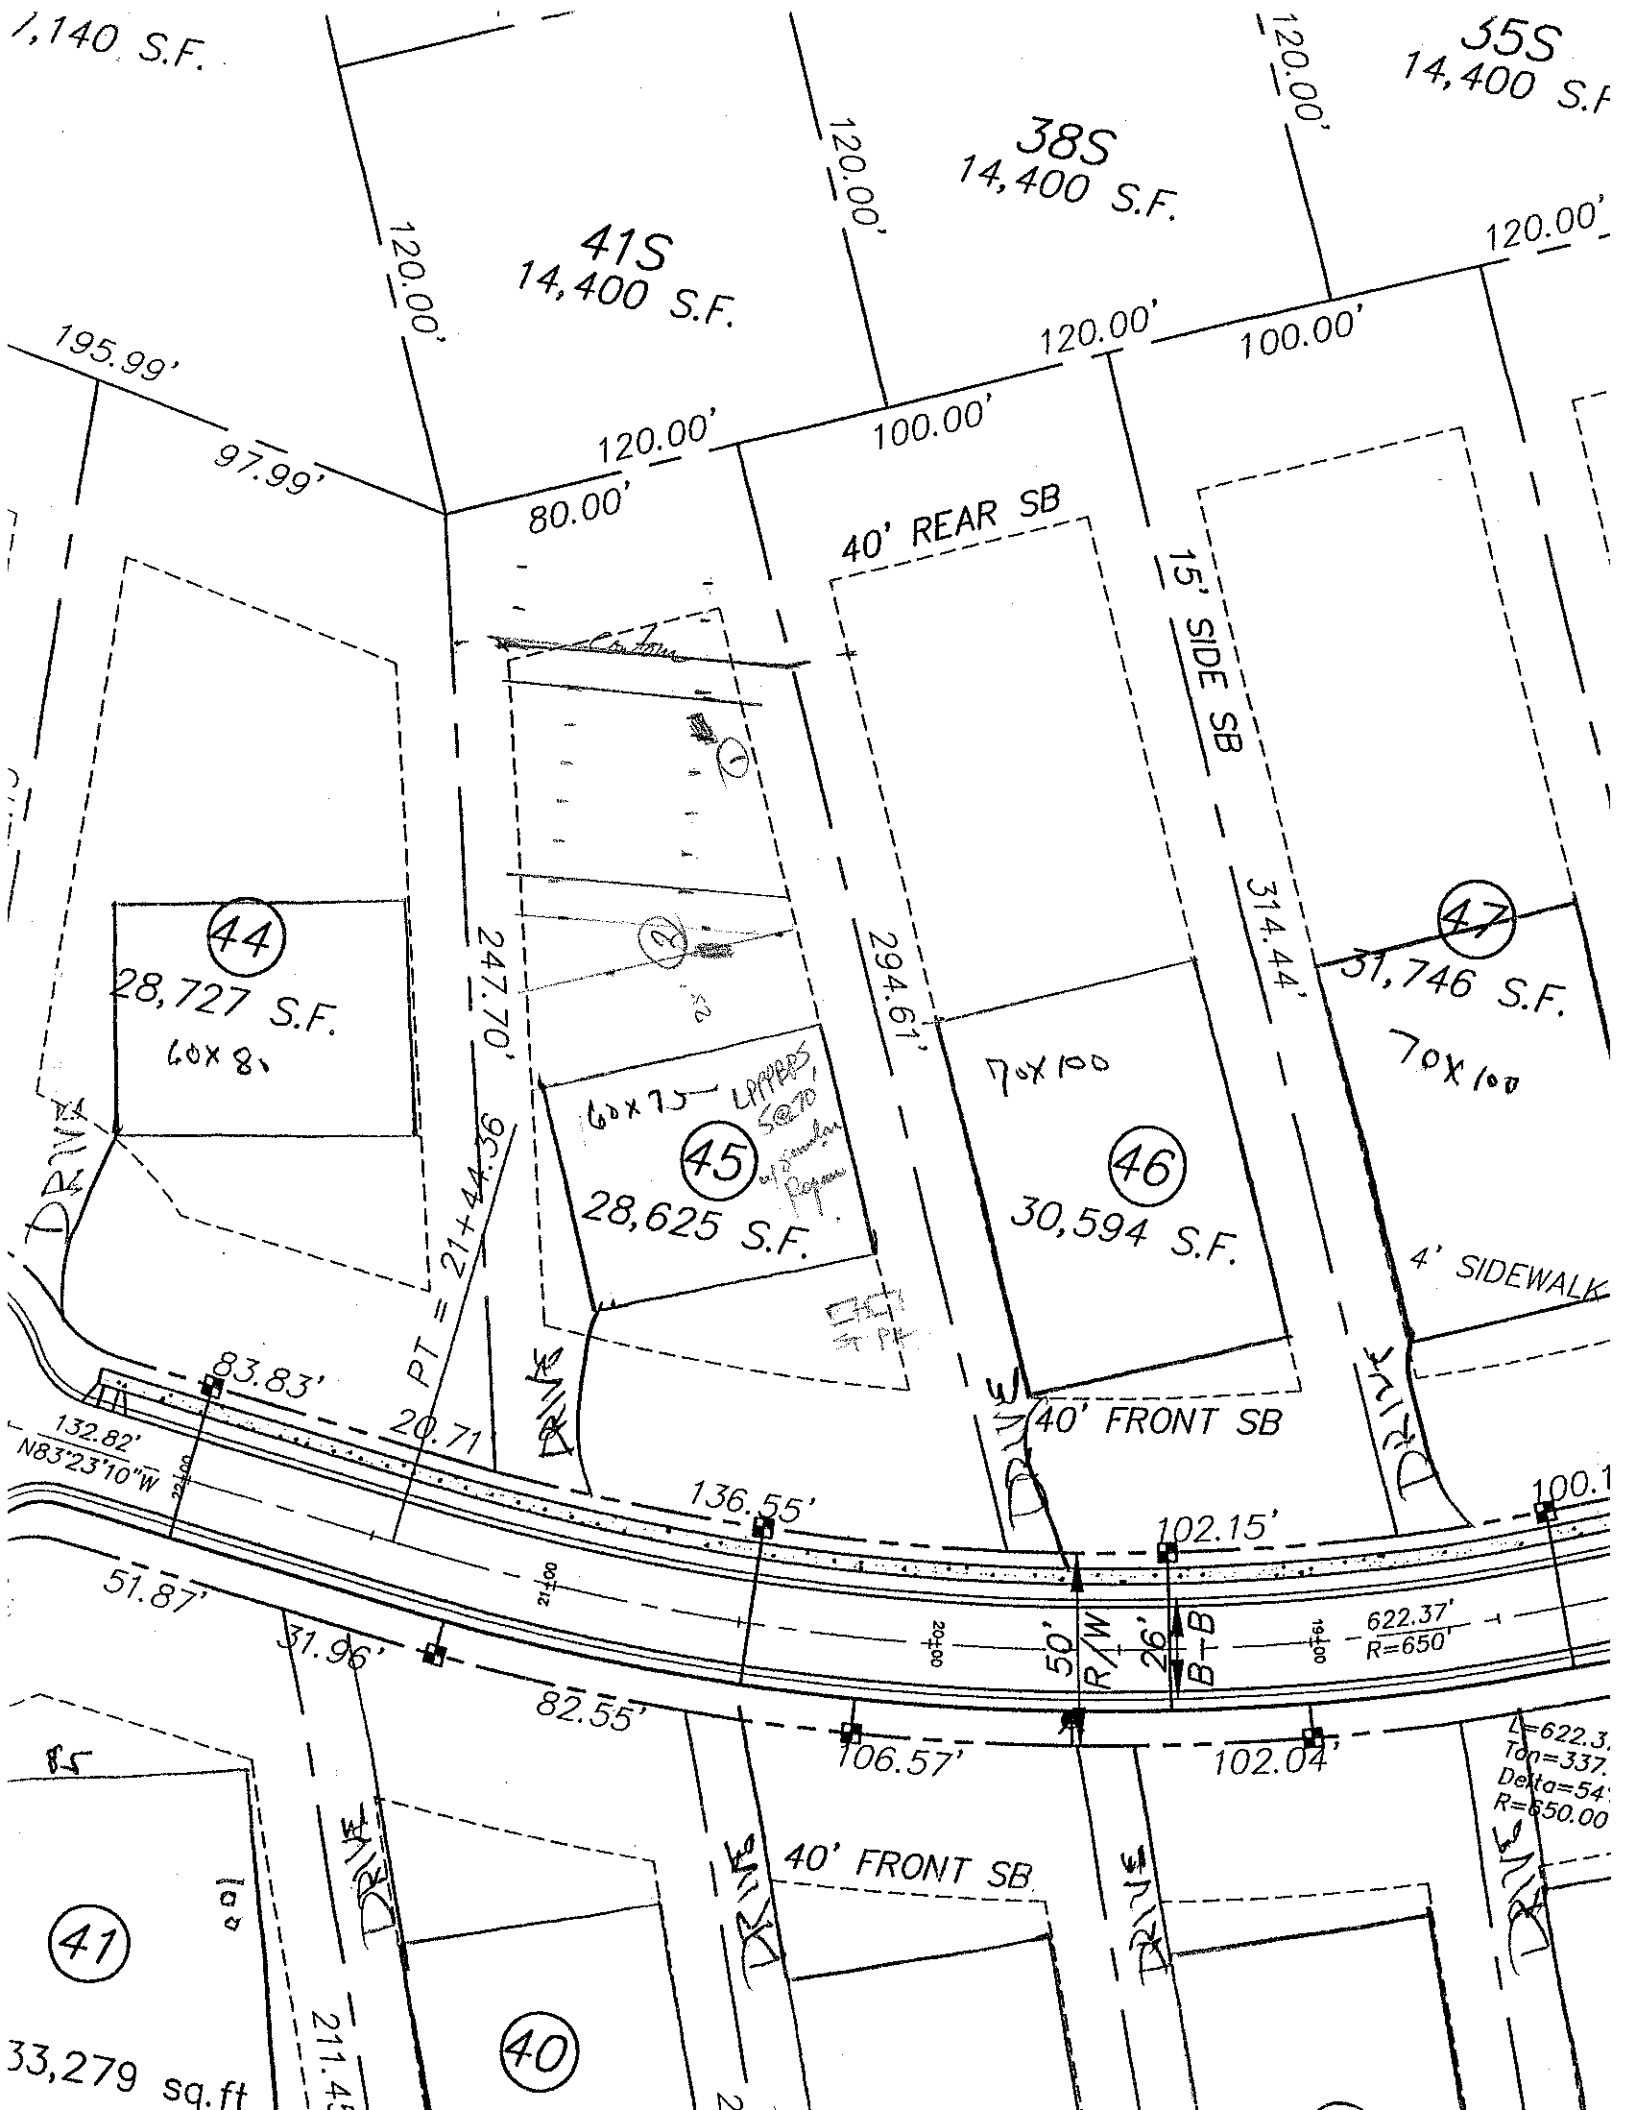
PE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
(1)	0-9	wk sgb brn sl/l fsa						
	9-43	WMB R-ebrd c fisp fsa		comm y brd mottles & manganiferous fsa ind stp				.25 and
(2)	0-16	sgb RC	fsg-fi snso					
	16-42	wk-sgb yel-brn	frssb comm-mi stp					.25-.3

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM

OTHER FACTORS (.1946): _____

SITE CLASSIFICATION (.1948): _____


1,140 S.F.
41S
14,400 S.F.
38S
14,400 S.F.
35S
14,400 S.F
120.00'
120.00'
120.00'
120.00'
120.00'
195.99'
97.99'
80.00'
100.00'
100.00'
40' REAR SB
15' SIDE SB
314.44'
294.61'
247.70'
44
28,727 S.F.
60x8
45
28,625 S.F.
60x7
46
30,594 S.F.
70x100
47
31,746 S.F.
70x100
4' SIDEWALK
PT = 21+44.36
83.83'
20.71
132.82'
N83°23'10"W
136.55'
102.15'
40' FRONT SB
51.87'
31.96'
82.55'
106.57'
102.04'
50' R/W
26' B-B
622.37'
R=650'
L=622.3
Tan=337.
Delta=54
R=650.00
40' FRONT SB
41
40
33,279 sq.ft
211.43'