for ON-SITE WASTEWATER SYSTEM

ER: _____ APPLICANT: _____

DRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 8-22-01

OPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____

CATION OF SITE: lot 43 Templeton Farms PROPERTY RECORDED: _____

TER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____

ALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut

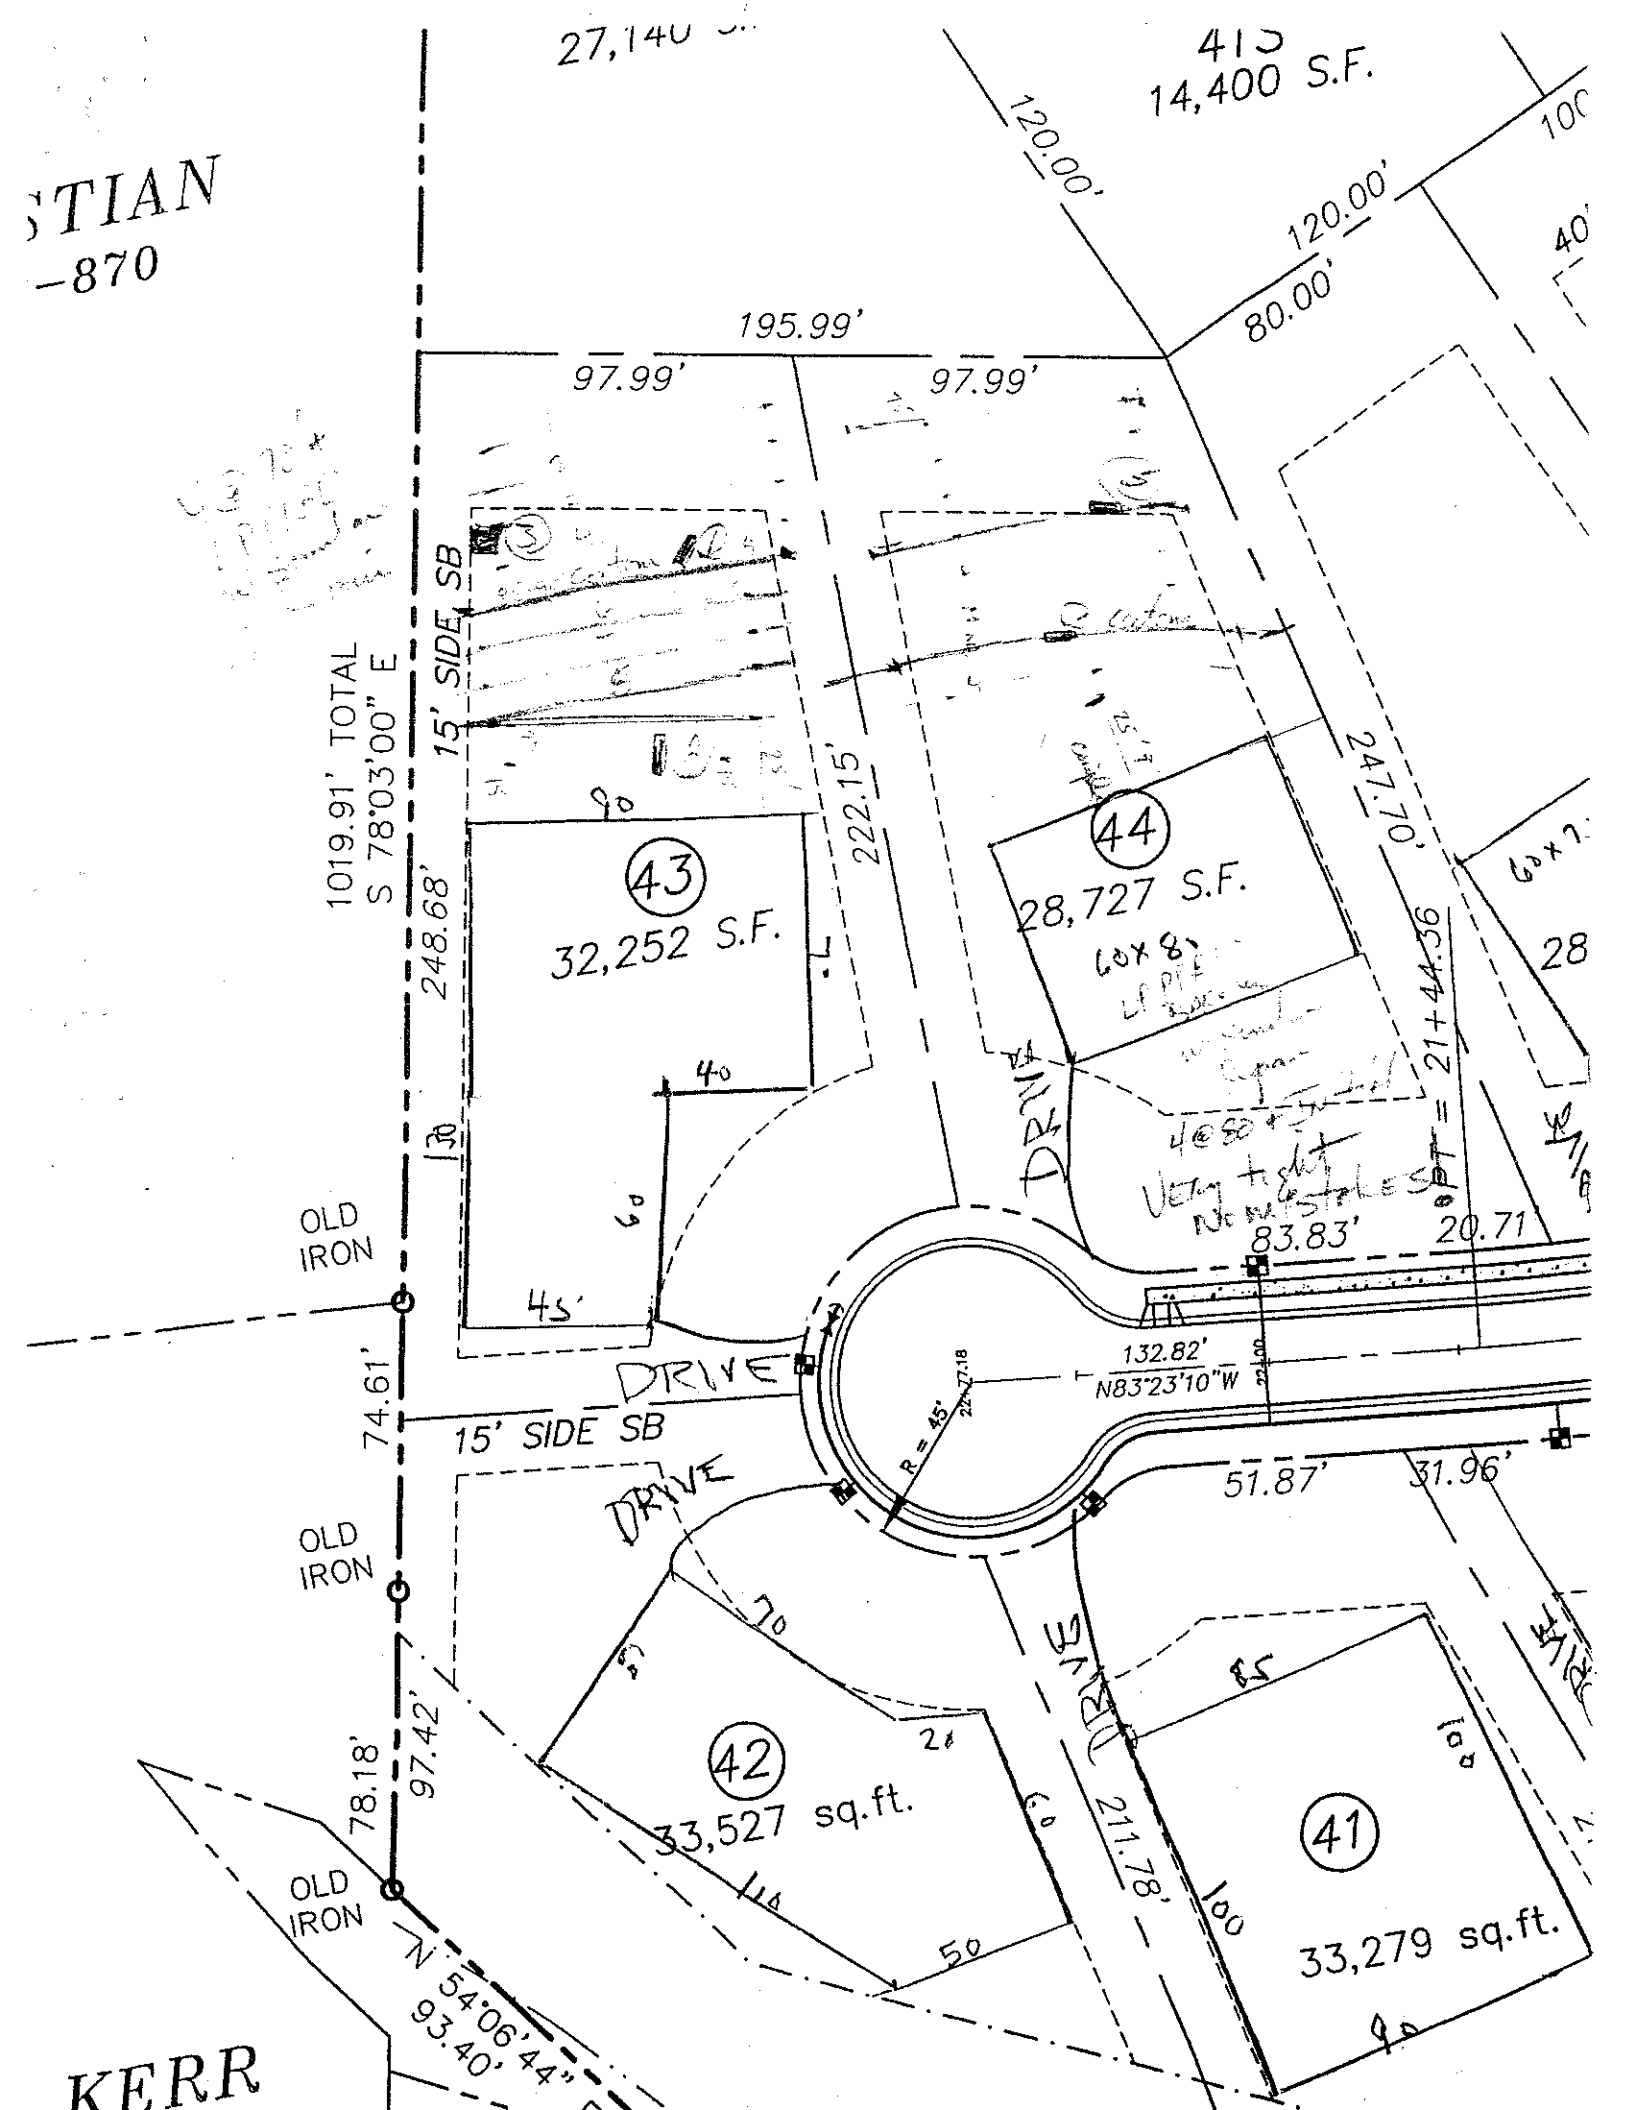
PE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
(1)	0-12	wk sbk fbrn cl	fr ss sp					.3
	12-38	mfmas RC	fr sp					
	38-51	wk sbk yp cl	fr ss sp few ind sap					
(2)	0-21	sbk RCL	fr sp ss sp sap					.3
	21-40	wk sbk yp cl/l	fr ss sp few ind sap					
(3)	0-10	wk sbk fbrn cl	fr ss sp					.3
	10-38	sbk RC	fr sp					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM

OTHER FACTORS (.1946): _____

SITE CLASSIFICATION (.1948): _____


27,140
415
14,400 S.F.
120.00'
120.00'
80.00'
195.99'
97.99'
97.99'
15' SIDE SB
1019.91' TOTAL
S 78°03'00" E
248.68'
222.15'
247.70'
43
32,252 S.F.
44
28,727 S.F.
60x8
40
130
60
45'
DRIVE
83.83'
20.71'
21+44.36
OLD IRON
74.61'
15' SIDE SB
DRIVE
132.82'
N83°23'10"W
R = 45'
51.87'
31.96'
OLD IRON
70
85
26
60
42
33,527 sq.ft.
110
50
211.78'
85
100
41
33,279 sq.ft.
90
78.18'
97.42'
OLD IRON
N 54°06'44"
93.40'
KERR