12660

4647315338

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Fellowship First Presbyterian Church Reform DATE 8/29/91 PERMIT NO. 2J-A-5-C

PHONE: Business _____ Home _____

LOCATION Williamson Rd, 150 W, Jct Williamson, thru light, on (L) just after intersection S. R. No. _____

SUBDIVISION NAME N/A LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home ( ) Business ( ) Other Church Fellowship Hall 100 members @ 3gal/member

No. Bedrooms — No. Bathrooms 3


Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil	clay-(sp-lg)	
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	.63	
Auto. Wash. Machine	Yes ( )	No (✓)	Topography	1-2%	
Site Suitable	Yes (✓)	No ( )	Depth to Water Table	40"	
			Rock or other impervious formations	None found	

Lot Area 29,000 Ft²

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 3 @ 100'
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12-14"
Water Supply: Individual (✓)
Public ( )

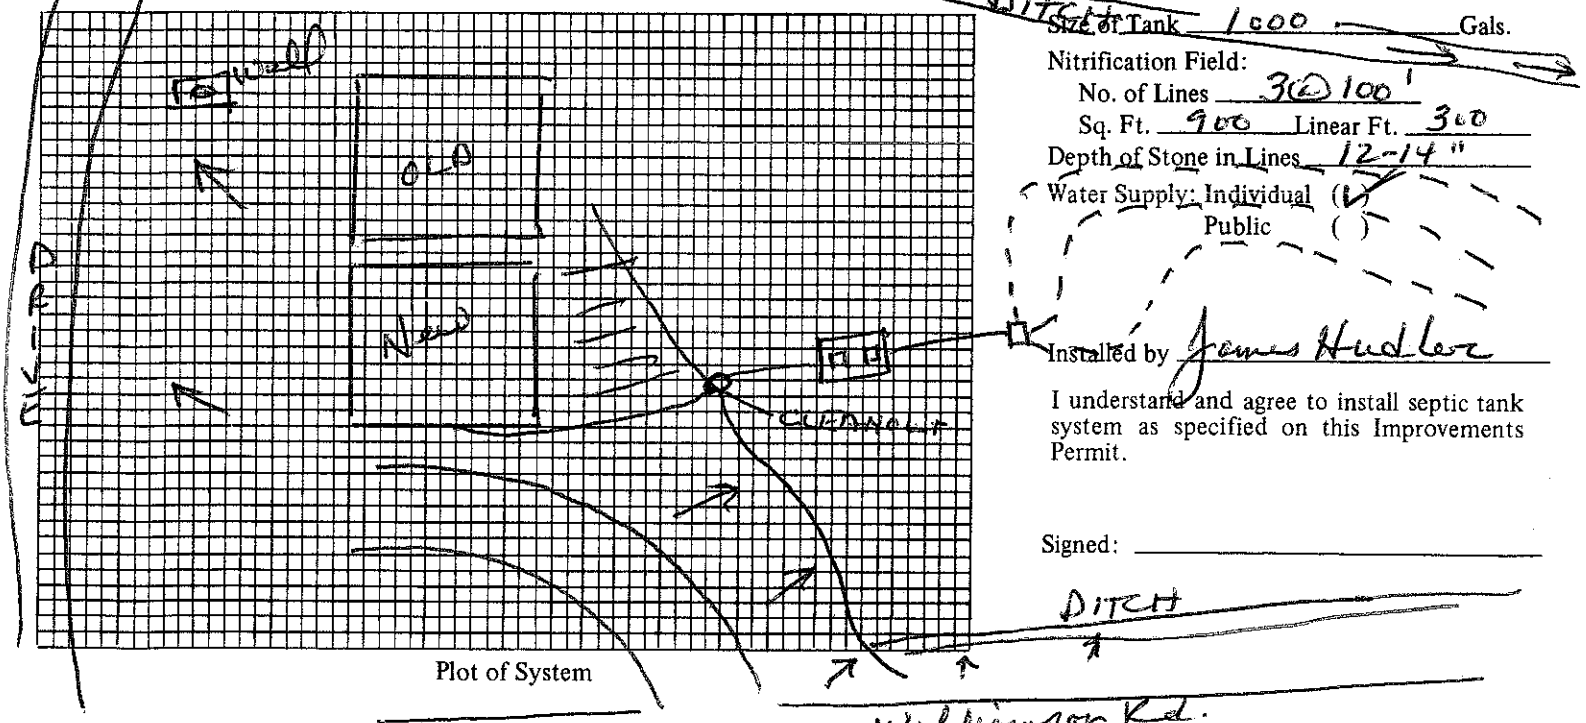

Plot of System

Installed by James Hudler

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: Shallow - no deeper than 30". Drainlines at top of relic mottling and more plastic soils

CERTIFICATE OF COMPLETION BY Wesley Sparks R.S. DATE 8/29/91

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold