DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: ___
COUNTY: ___

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

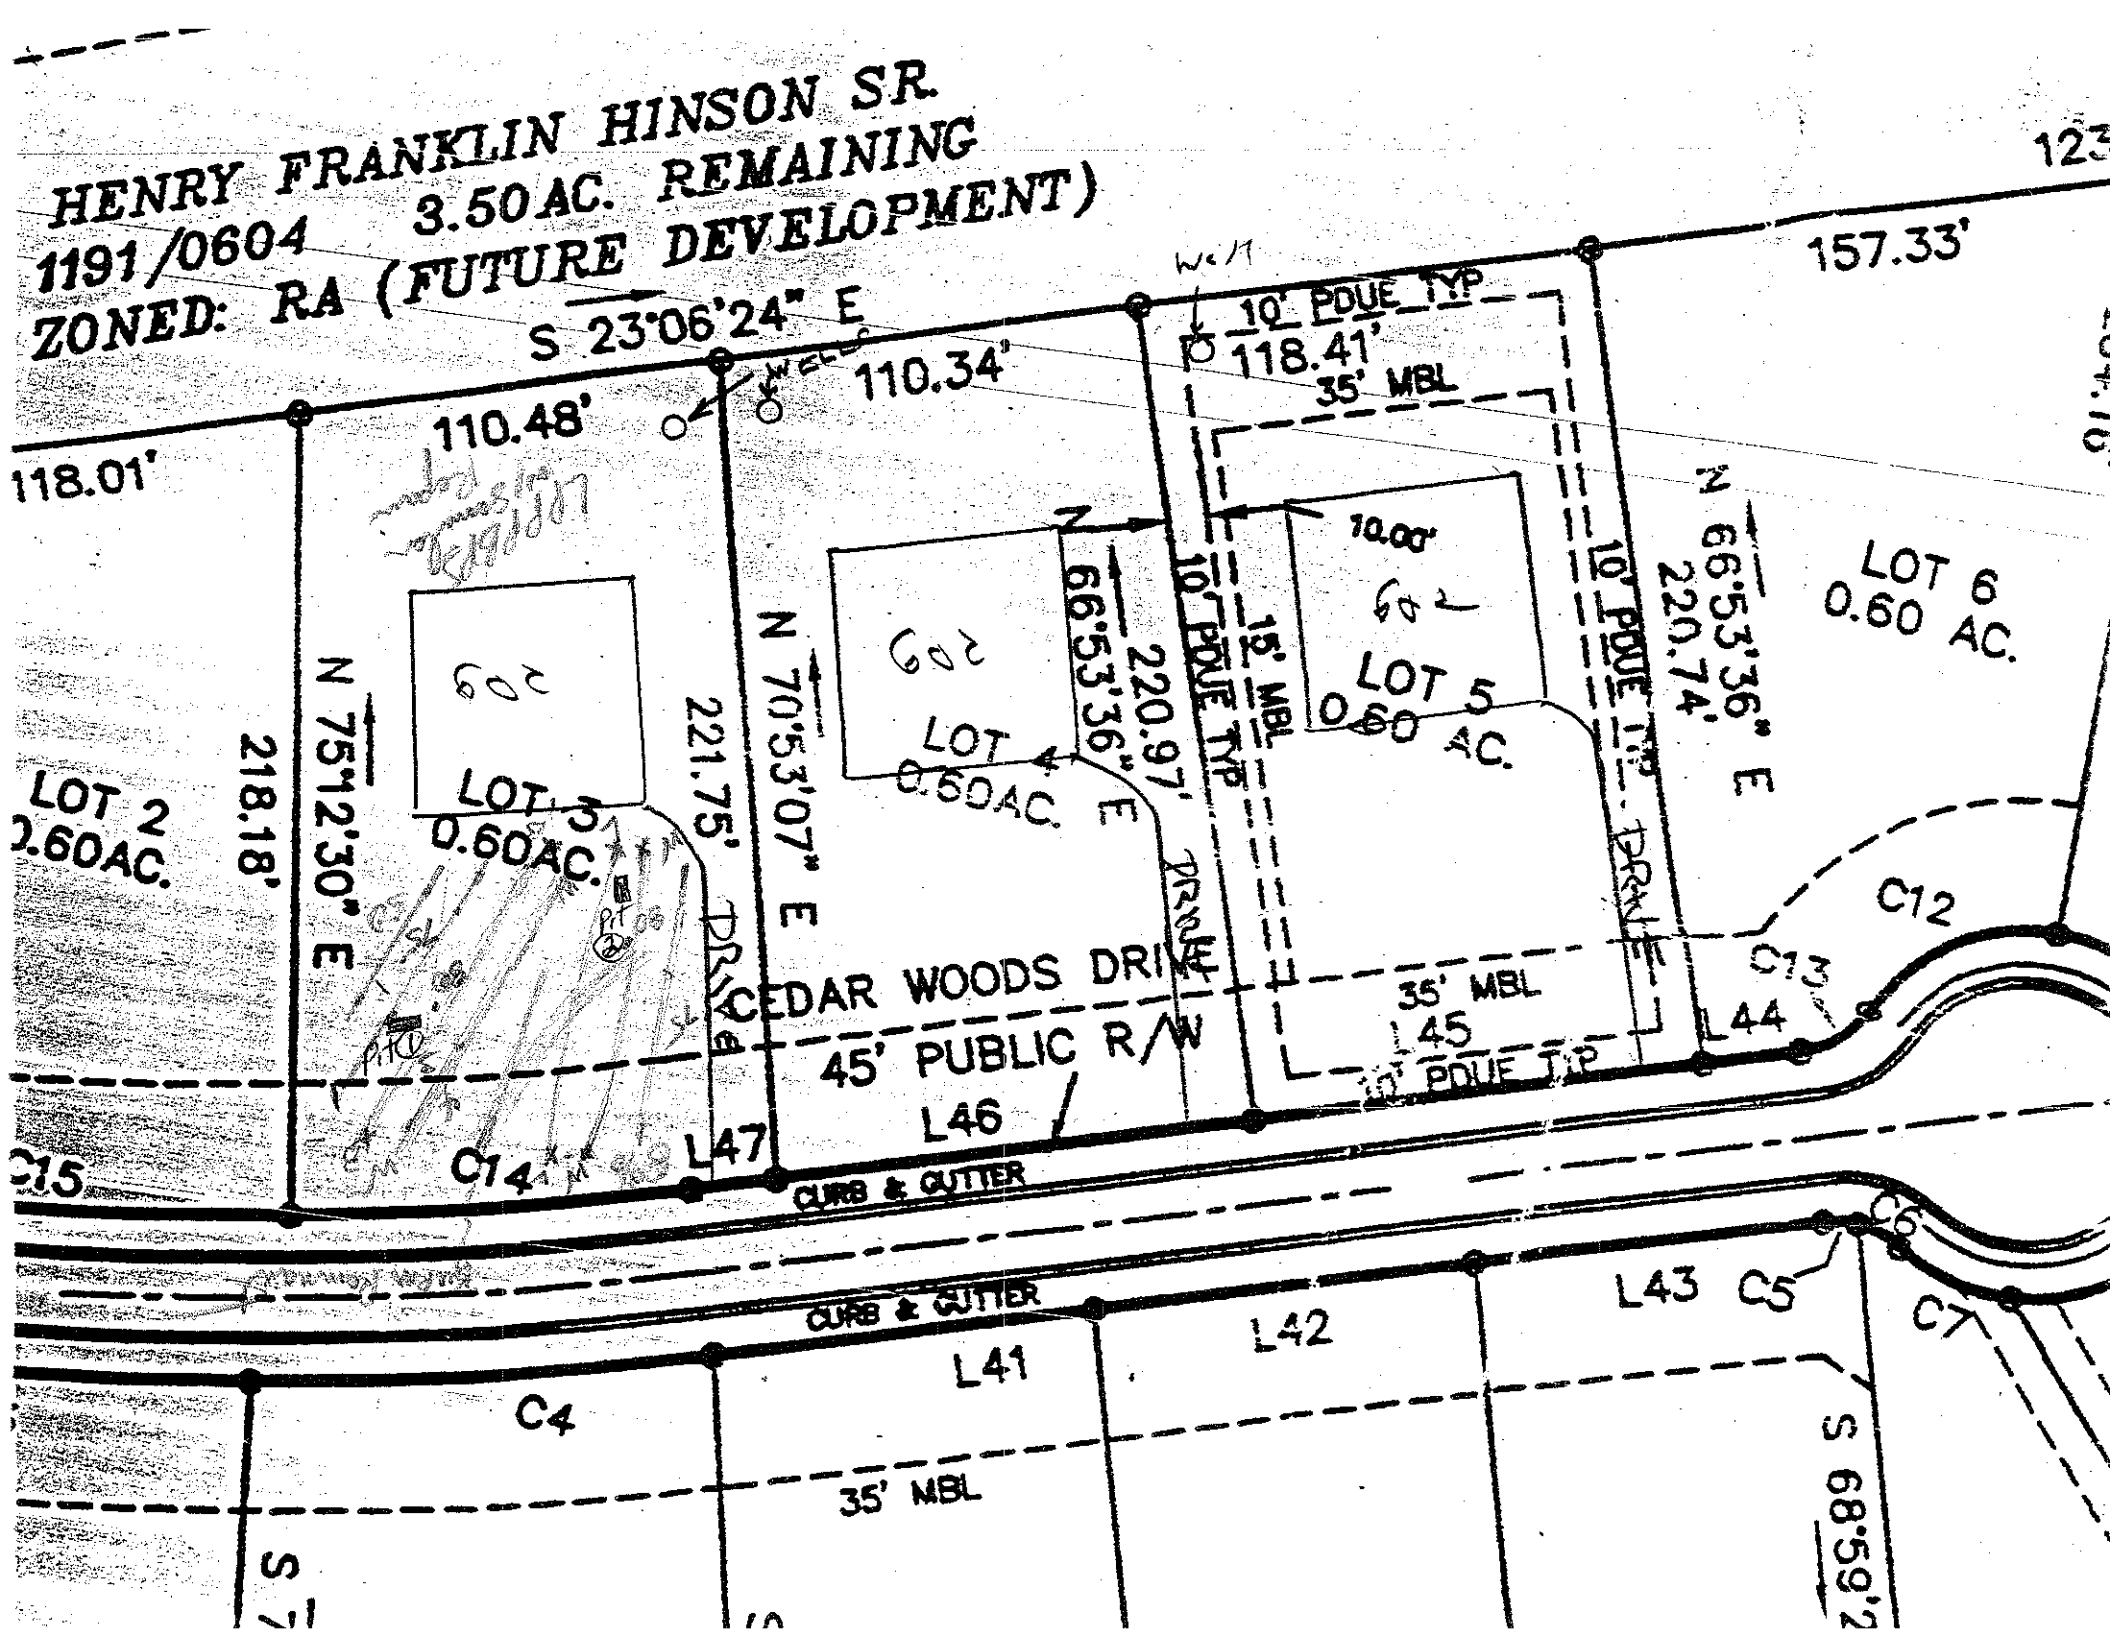
OWNER: Redd Tree LLC APPLICATION DATE ___
ADDRESS: ___ DATE EVALUATED: 1-22-04
PROPOSED FACILITY: ___ PROPOSED DESIGN FLOW (.1949): 4Bdrm PROPERTY SIZE: ___
LOCATION OF SITE: lot 3 Cedarwood PROPERTY RECORDED: ___
WATER SUPPLY: ☒ Private ☐ Public ☒ Well ☐ Spring ☐ Other ___
EVALUATION METHOD: ☐ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	6% S	0-5	gr wksbk brn scl	fr sspl					.3
		5-22	mfsbk RBrwc	fr sp sspl					
		22-30	wkfsbk ygrcl	fi fr sssp	pa wi spl				
2		0-8	gr brn scl	fr sssp					~3
		8-33	mfsbk/mdRC	fr sssp spl					
		33-55	wkfsbk ygrcl	fr sssp	few common mi spl				
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	0S
System Type(s)	LPPPBPS	LPPPBPS
Site LTAR	.3	.3

OTHER FACTORS (.1946): ___
SITE CLASSIFICATION (.1948): B
EVALUATED BY: DRThomas
OTHER(S) PRESENT: Ken Kennerly

COMMENTS: ___


HENRY FRANKLIN HINSON SR.
1191/0604 3.50AC. REMAINING
ZONED: RA (FUTURE DEVELOPMENT)
S 23°06'24" E
110.34'
110.48'
118.01'
157.33'
10' PDUE TYP
118.41'
35' MBL
10.00'
15' MBL
10' PDUE TYP
N 66°53'36" E
220.74'
LOT 6
0.60 AC.
LOT 5
0.60 AC.
LOT 4
0.60AC.
LOT 3
0.60AC.
LOT 2
0.60AC.
N 70°53'07" E
220.97'
N 75°12'30" E
218.18'
221.75'
PRIVATE
CEDAR WOODS DRIVE
45' PUBLIC R/W
L46
L47
L45
L44
L43
L42
L41
C4
C5
C6
C7
C12
C13
C14
C15
CURB & GUTTER
S 68°59'2