Permit Reissue

~~3-3-90~~ 10:00 – 10:15

10965

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Larry Hildreth DATE May 1, 1990 PERMIT NO. EP-6-A-6C

PHONE: Business _____ Home _____

LOCATION 150 W TR 1467 TL 1395 Bearsfoot TR Big Indian Loop ~1mi. on right after crossing creek S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) House Other Permit now for garage 1 Bdr.

No. Bedrooms 3 → Future House 2½ No. Bathrooms _____

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site ~~Suitable~~ FS Yes ( ) No ( )

Lot Area 1.78ac

Character & Porosity of Soil clayey

Percolation Rate ~ 3 gpd/ft²


Topography 1-5%

Depth to Water Table + 3½'

Rock or other impervious formations none obs.

✓ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

1250 AT

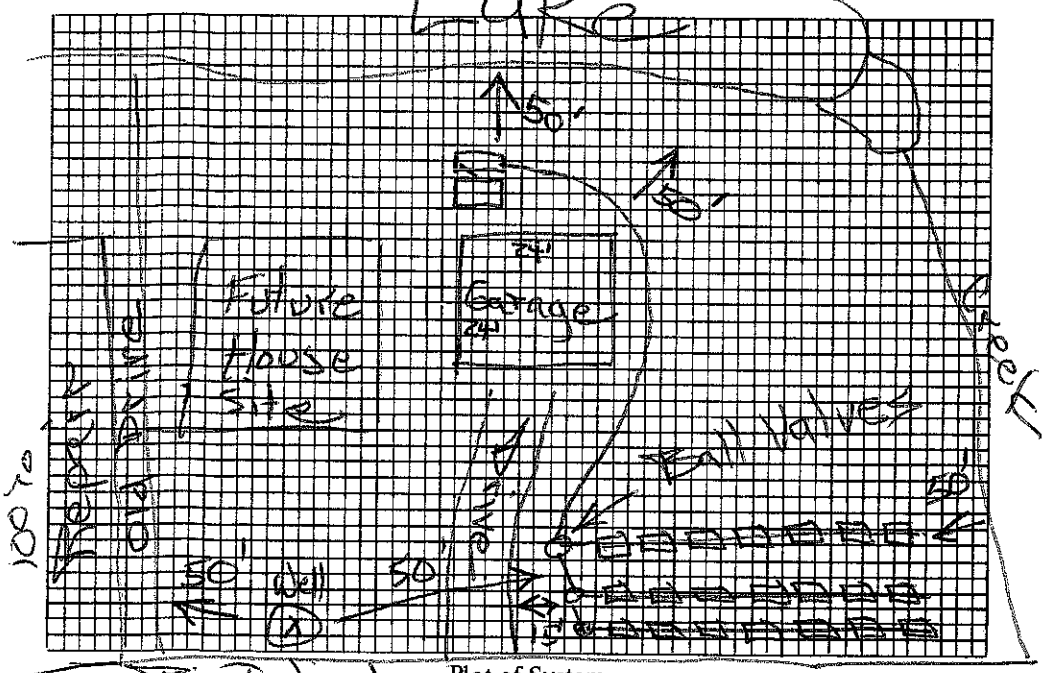

Plot of System

Size of Tank 1250 Gals.

Nitrification Field:

No. of Lines 3@67'

Sq. Ft. _____ Linear Ft. 200

Depth of Stone in Lines ~~12"~~ 24"

Water Supply: Individual (✓)

Public ( ) 16" Panel

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Larry D. Hildreth

IMPROVEMENTS PERMIT BY Sam Ingram EHS

COMMENTS: Approx. 100' Sch 40 2" Supply line 1½" lateral 5/32" Hole Panel 18 gpm Pump 20' TDH Front of garage 85' from road.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold