DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: 1-22-0
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 5 Cedarwoods PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

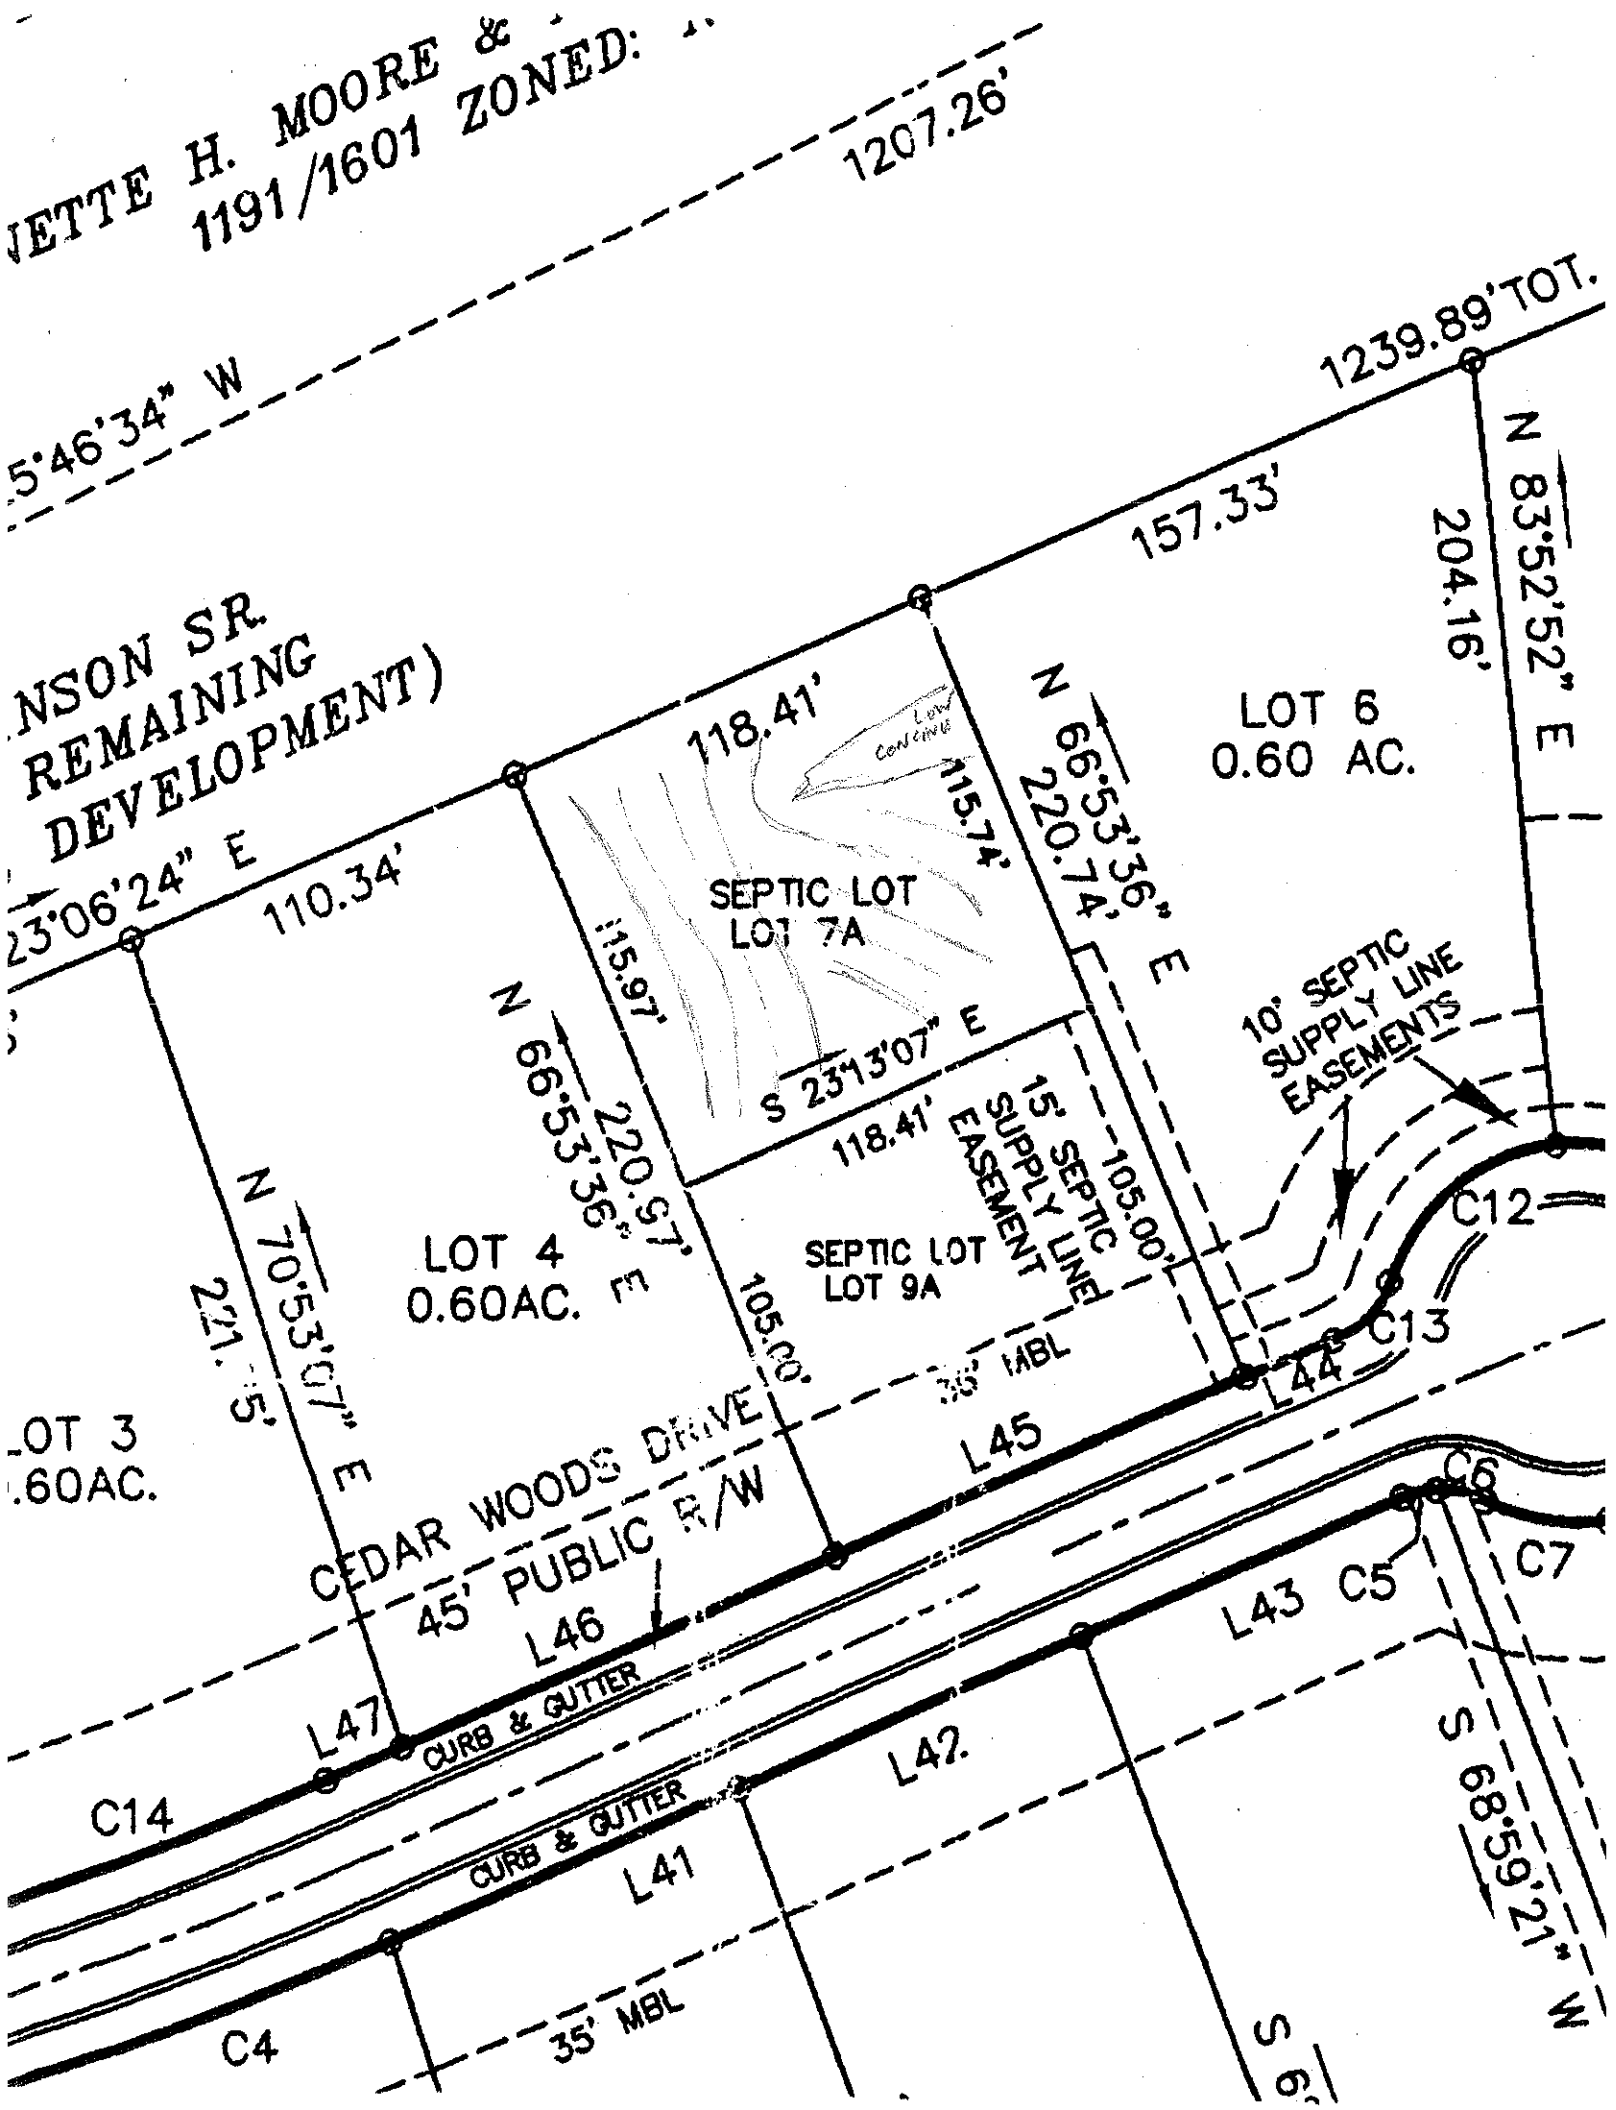
#5 0-10 gr brn sl fr sss p
10-19 wk fsbk brn scl fr sss p sap .3
19-30 mfsbk RC fr sss p sap
30-50 wk m mskpk cl fr sss p .225=.3

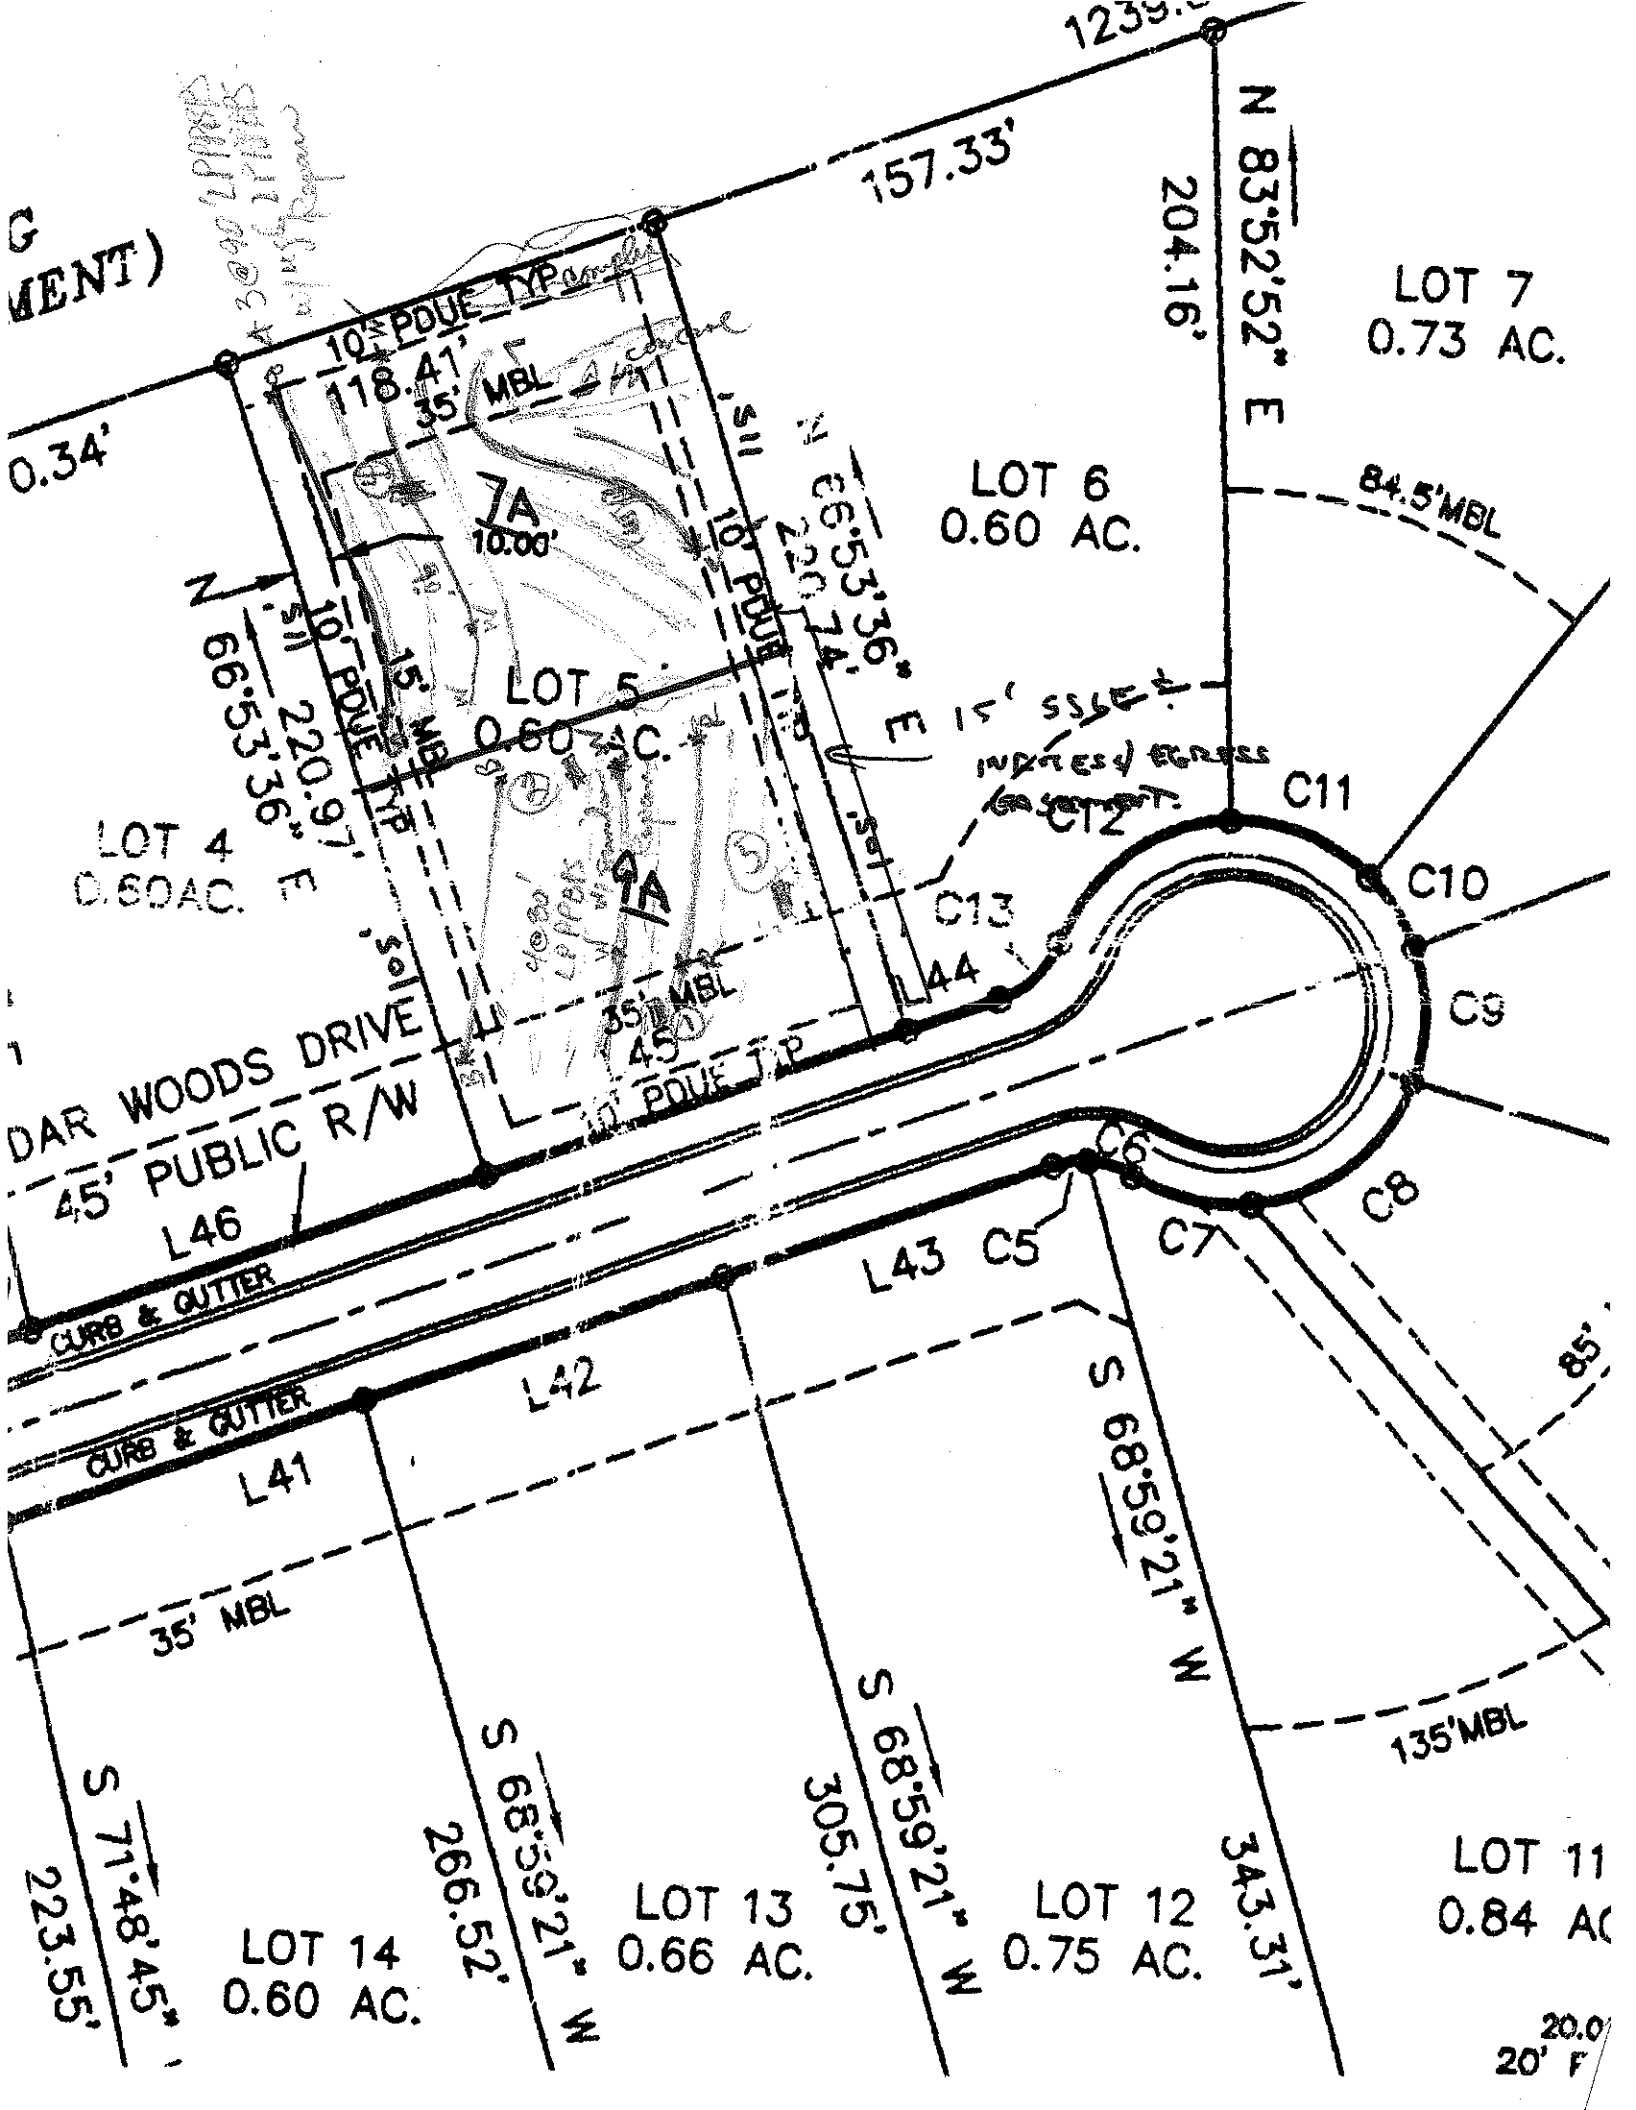
PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	9A	0-5	gr brn sl	fr sss p					
		5-27	mfsbk RC	fr ss sl sap	fair wet sap				.3
		27-54	wk sbk mottled ry l sap	fr sss p	fair mottled				
2	L 5-16% 9A	0-5	wk sbk brn scl	fr sss p					
		5-25	wk fsbk RCh	fr sss p sap	wet sap 20"+				.3+
		25-55	Marine l/sl sap	fr sss p					
3	7A	0-9/12	m fsbk RC	fr ss p sap					
		9/12-46	9R fsbk yr cl	fr sss p	common mot sap				.3
4	7A	0-16	m fsbk RSCl cl	fr sss p					
		16-53	m fsbk RSCl	fr sss p	few fine mot sap few quartz vein				.3

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: DH Hanson
OTHER(S) PRESENT: Paul Pennington

This site split into two septic field easements


NETTE H. MOORE &
1191/1601 ZONED:
1207.26'
5°46'34" W
1239.89'TOT.
N 83°52'52" E
204.16'
157.33'
NSON SR.
REMAINING
DEVELOPMENT)
23°06'24" E
110.34'
118.41'
115.74'
N 66°53'36" E
220.74'
LOT 6
0.60 AC.
SEPTIC LOT
LOT 7A
115.97'
S 23°13'07" E
118.41'
15' SEPTIC SUPPLY LINE EASEMENT
105.00'
10' SEPTIC SUPPLY LINE EASEMENTS
N 66°53'36" E
220.97'
N 70°53'07" E
221.35'
LOT 4
0.60AC.
105.00'
SEPTIC LOT
LOT 9A
C12
C13
L44
35' MBL
L45
LOT 3
.60AC.
CEDAR WOODS DRIVE
45' PUBLIC R/W
C6
C7
L46
L43
C5
L47
CURB & GUTTER
L42.
C14
CURB & GUTTER
L41
S 68°59'21" W
C4
35' MBL
S 6


157.33'
N 83°52'52" E
204.16'
LOT 7
0.73 AC.
LOT 6
0.60 AC.
84.5'MBL
10' PDUE TYP
118.41'
35' MBL
7A
10.00'
N 66°53'36" E
220.74'
LOT 5
0.60 AC.
15' SSLE &
INGRESS/EGRESS
EASEMENT
C11
C12
C10
C13
L44
C9
9A
35' MBL
45'
10' PDUE TYP
DAR WOODS DRIVE
45' PUBLIC R/W
L46
C6
C8
C7
L43 C5
CURB & GUTTER
L42
CURB & GUTTER
L41
35' MBL
S 68°59'21" W
305.75'
135'MBL
S 71°48'45" W
223.55'
S 68°59'21" W
266.52'
LOT 14
0.60 AC.
LOT 13
0.66 AC.
LOT 12
0.75 AC.
343.31'
LOT 11
0.84 AC
0.34'