13794

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Joel W Cook DATE 1/10/92 PERMIT NO. 25-A-65

PHONE: Business _____ Home 528-6300

LOCATION Judas Rd; 2 IN TL on Cornelius Rd, TR on Judas Rd, ~1/2 mile on (L) in woods S. R. No. _____

SUBDIVISION NAME N/A LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes (✓)	No ( )	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable	Yes (✓)	No ( )	

Character & Porosity of Soil P e (SBk - SS)
Percolation Rate 4
Topography 2-3%
Depth to Water Table >48"
Rock or other impervious formations None Encountered

Lot Area 20,000 FT²

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

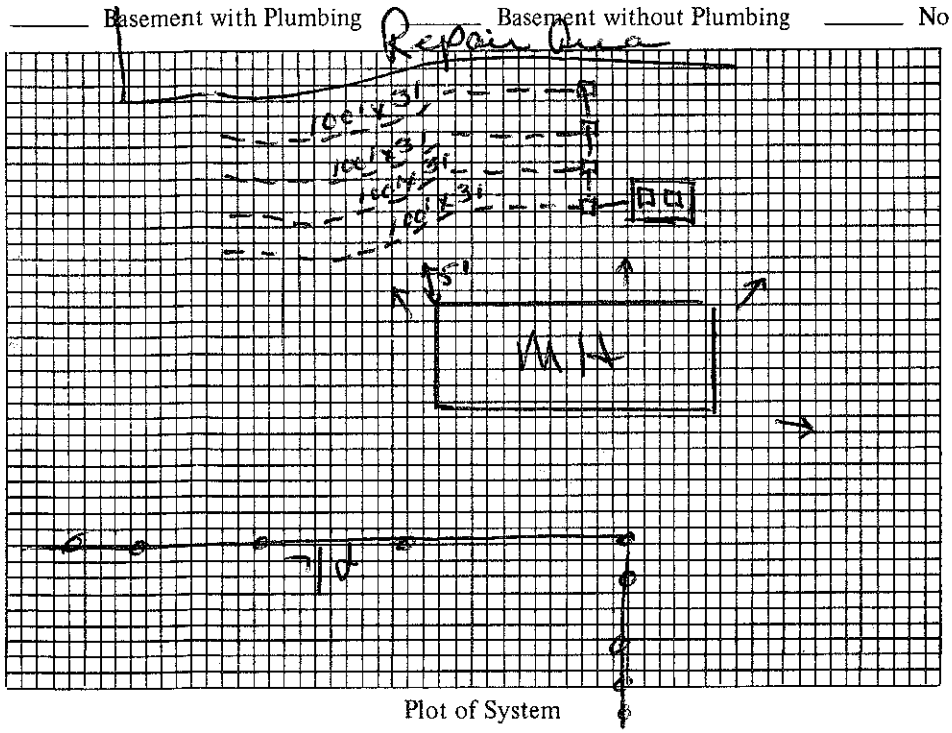

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4 @ 100'x3'
Sq. Ft. 1200 Linear Ft. 400
Depth of Stone in Lines 12"

Water Supply: Individual (✓) NOT DRILLED YES
Public ( )

Installed by Cedarwood Septic Svcs.

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: Trail not on site yet - Lines on contour, upper run 40" deep to trench bottom. Tight for space without clearing more trees

CERTIFICATE OF COMPLETION BY Wesley Sparks RS. DATE 1/10/92

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

IREDELL COUNTY HEALTH DEPARTMENT

13794

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Joel W Cook DATE 12/11/91 PERMIT NO. 25-A-65

PHONE: Business _____ Home 528-6300

LOCATION TODAS RD, 2IN TR ON CORNELIUS RD, TR ON TODAS RD ~½ mile on (L) S. R. No. _____

SUBDIVISION NAME N/A LOT NO. N/A SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil P - C - C (SBK - SS)
Percolation Rate 4
Topography 2-4%
Depth to Water Table >48"
Rock or other impervious formations None found

Lot Area 26,000 FT²

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

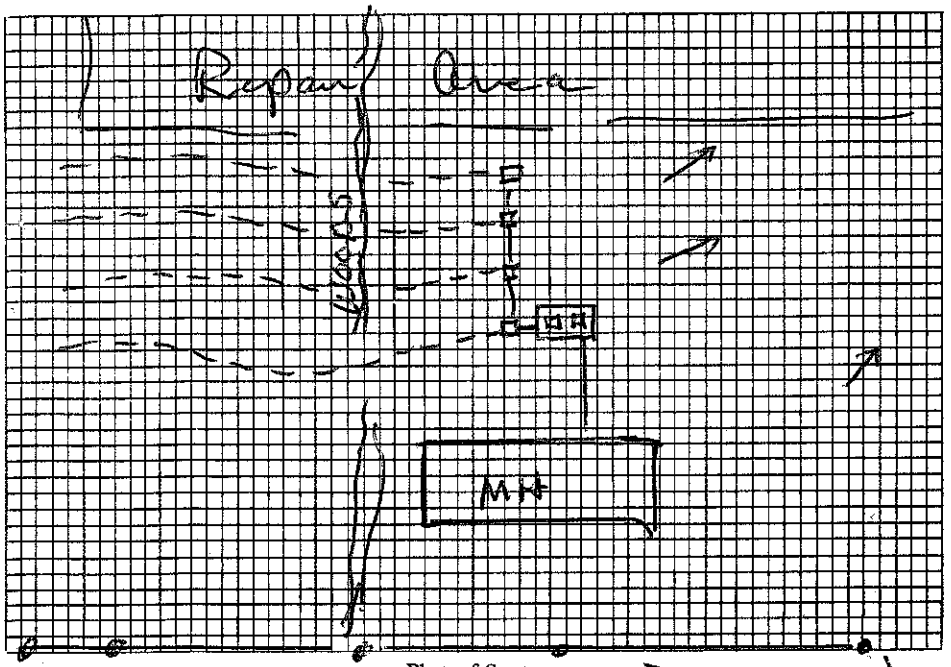

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 4 @ 100' x 3'
Sq. Ft. 1200 Linear Ft. 400
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Joel Wayne Cook

IMPROVEMENTS PERMIT BY OPEN PASTURE Wesley Sparks

COMMENTS: Keep trenches shallow no deeper than 36" to trench bottom. Lines on slope contour.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold