Department of Environment, Health, and Natural Resources
Division of Environmental Health
On-site Wastewater Section

Sheet: **1 OF 1**
PIN #: **4649-37-8156**
Lot #:
Permit #: **175318**
AppID:

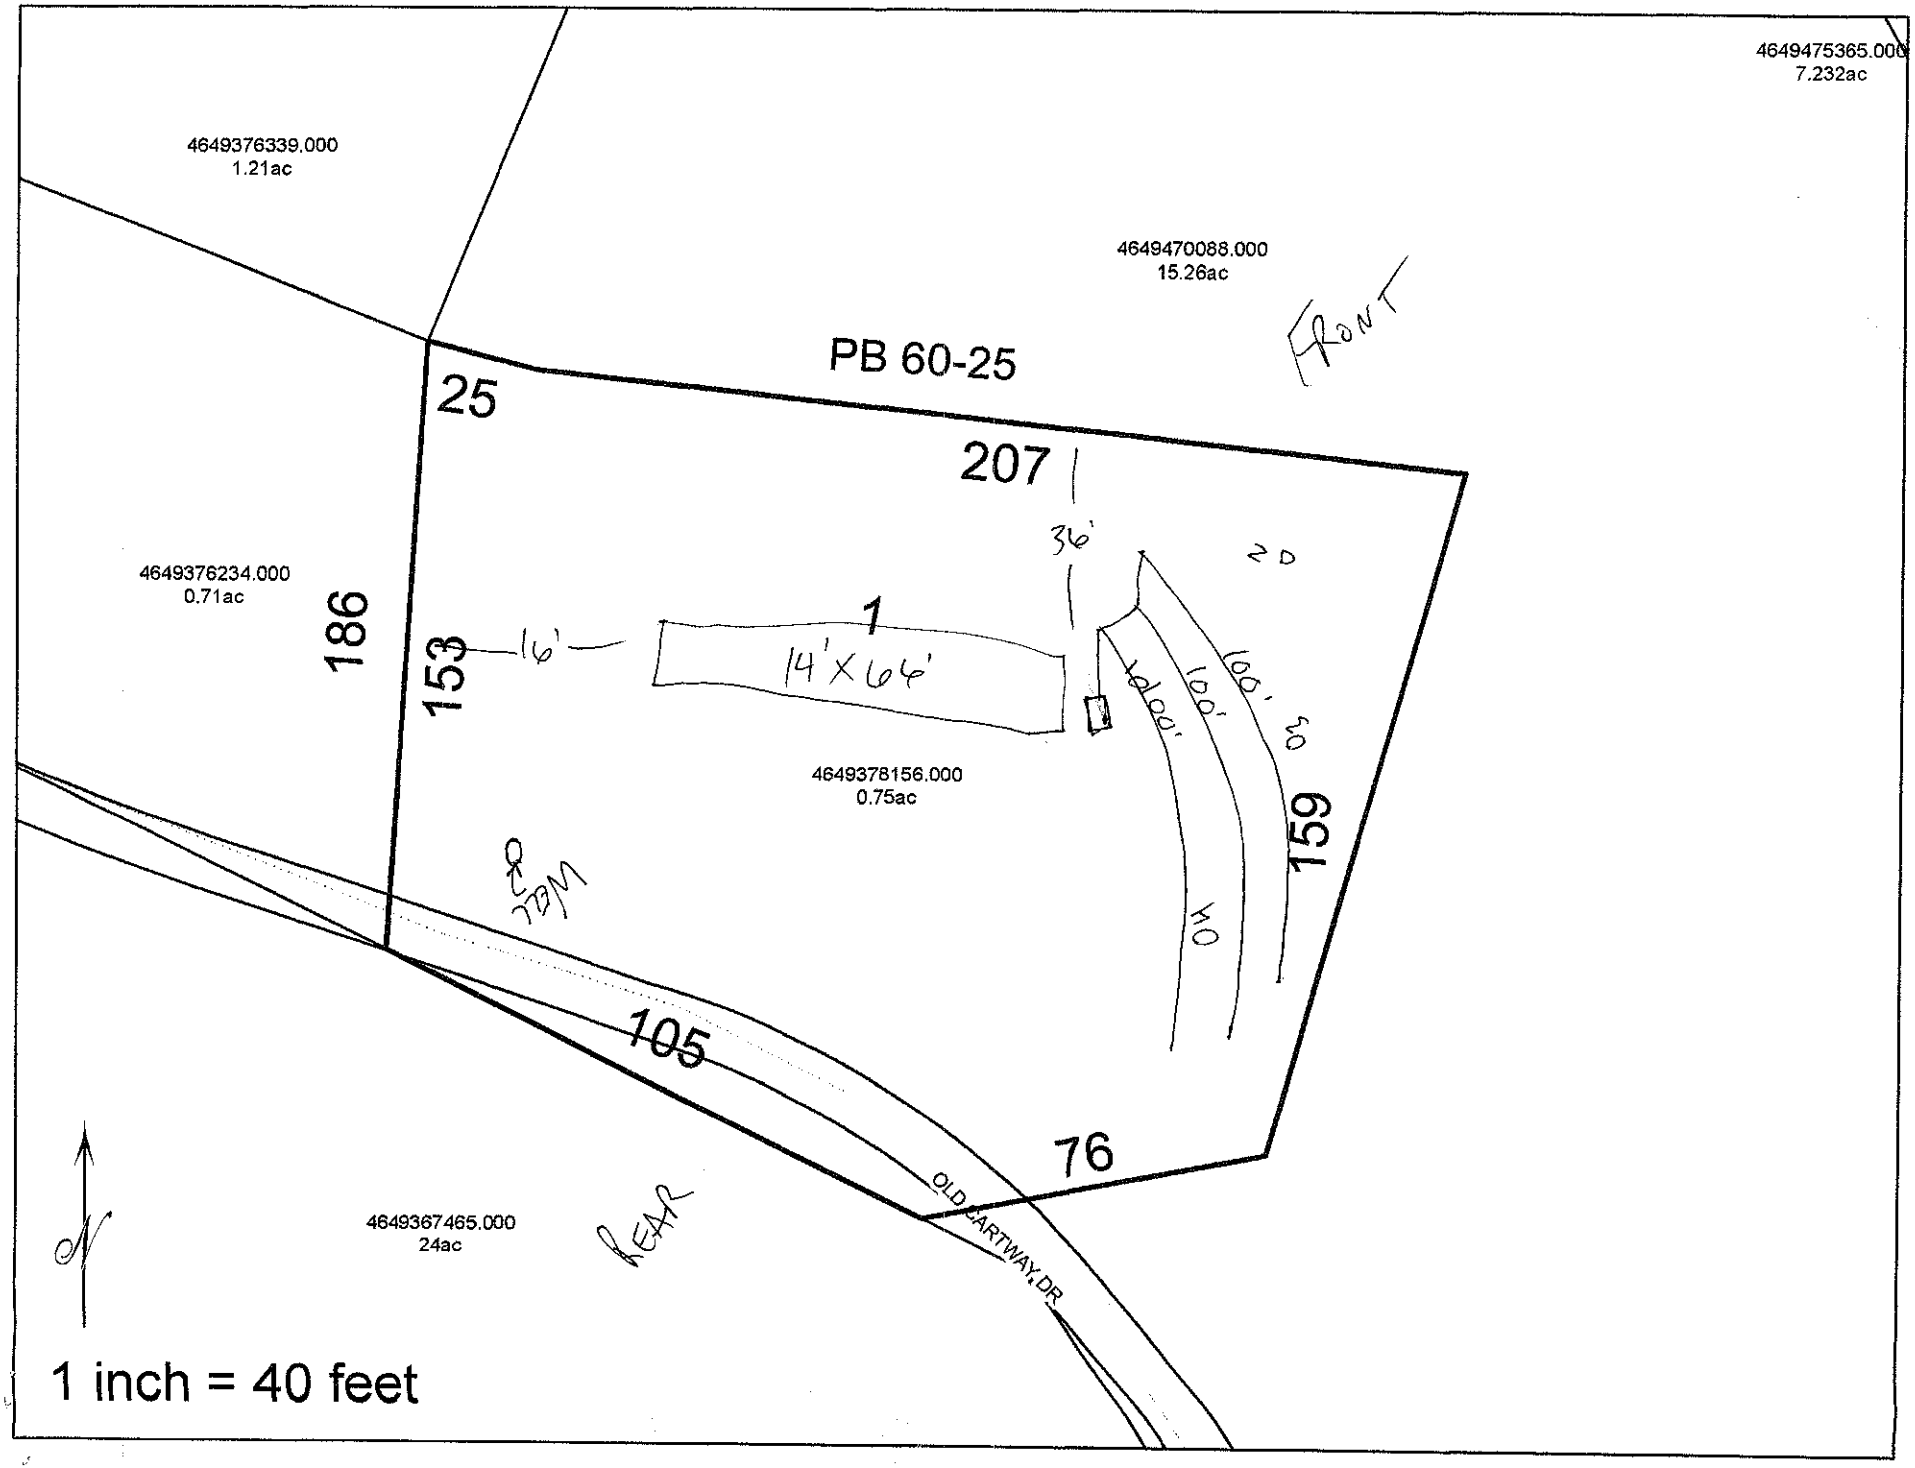
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

Owner: **NICHELLE WILLIAMS**
Applicant: **ERIC WARD**
Address: **125 OLD CARTWAY DR.**
Date Evaluated: **10/12/2012**
Proposed Facility: **SFR** Design Flow (.1949) **360 GPD** Property Size: **.75 AC**
Location of Site: **000 OLD CARTWAY DR.** Property Recorded: **YES**
Water Supply: [ ] Public [X] Individual [X] Well [ ] Spring [ ] Other
Evaluation Method: [X] Auger Boring [ ] Pit [ ] Cut
Type of Wastewater: [X] Sewage [ ] Industrial Process [ ] Mixed

PROFILE #	.1940 Landscape Position/ Slope%	Horizon Depth (IN.)	SOIL MORPHOLOGY 1941		b PROFILE FACTORS				Profile Class & LTAR
			1941 Structure/ Texture	1941 Consistence Mineralogy	.1942 Soil Wetness/ Color	.1943 Soil Depth (IN.)	.1956 Sapro Class	.1944 Restr Horiz	
AB 1	LS 5%	0-48	C,M,SBK	SS,FR	NA	48"	NA	48"+	.3
AB 2	LS 5%	0-30	C,M,SBK	SS,FR	NA	48"	NA	48"+	.3
		30-48	CL,M,SBK	SS,VFR					
AB 3	LS 5%	0-24	C,M,SBK	SS,FR	NA	48"	NA	48"+	.3
		24-48	CL,M,SBK	SS,VFR					
AB 4	LS 5%	0-48	C,M,SBK	SS,FR	NA	48"	NA	48"+	.3

Description	Initial System	Repair System
Available Space (.1945)	PS	PS
System Type(s)	G-25%	G-25%
Site LTAR	.3	.3

Other Factors (.1946):
Soil Evaluation By: **BEN ALDRIDGE**
Others Present: **ERIC WARD, CRAIG THOMPSON**
Site Classification (.1948): **PS**
Site Evaluation By: **BEN ALDRIDGE**
Others Present: **ERIC WARD, CRAIG THOMPSON**


4649475365.000
7.232ac
4649376339.000
1.21ac
4649470088.000
15.26ac
PB 60-25
FRONT
25
207
36'
20
4649376234.000
0.71ac
186
153
16'
1
14'X64'
100'
100'
100'
10
10
159
4649378156.000
0.75ac
WELL
105
76
OLD CARTWAY DR
4649367465.000
24ac
REAR
N
1 inch = 40 feet