4649 48 0413

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Phillip Craig Brown DATE 6/21/88 PERMIT NO. _____

PHONE: Business _____ Home 528-6247

LOCATION 115-21 N. TL 1312 (Flower House Loop) TL 1313 (Carlyle Rd.) On left. Beside 2nd church S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes ( )	No (✓)	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable	Yes (✓)	No ( )	

Lot Area 20000 ft² +

Character & Porosity of Soil clay
Percolation Rate ~.4 gpd/ft
Topography 2-4%
Depth to Water Table 4' +
Rock or other impervious formations none observed

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

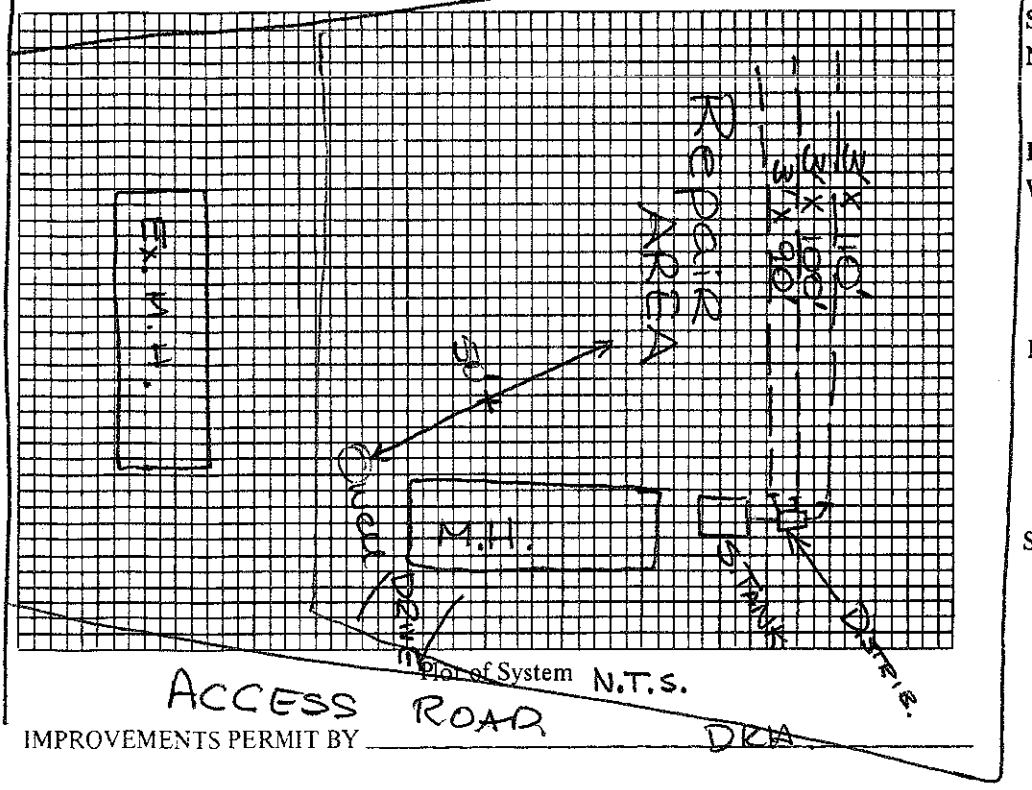

Plot of System N.T.S.

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines _____
Water Supply: Individual ( )
Public ( )

Installed by Dennis Gallihar.

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____ DRA

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Andrew C. Pierce DATE 6/21/88

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

06351

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Phillip Craig Brown DATE Mar 23, 88 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 115-21 N. TR 1312 (Flower House Loop) TR 1313 (Carlyle Rd.) on left beside 2nd church S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes ( ) No (✓)

Auto. Wash. Machine Yes (✓) No ( )

Site ~~Suitable~~ PS Yes (✓) No ( )

Lot Area 20000 ft²+

Character & Porosity of Soil Clay


Percolation Rate 4+

Topography 2-4%

Depth to Water Table 4'+

Rock or other impervious formations more clay.

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

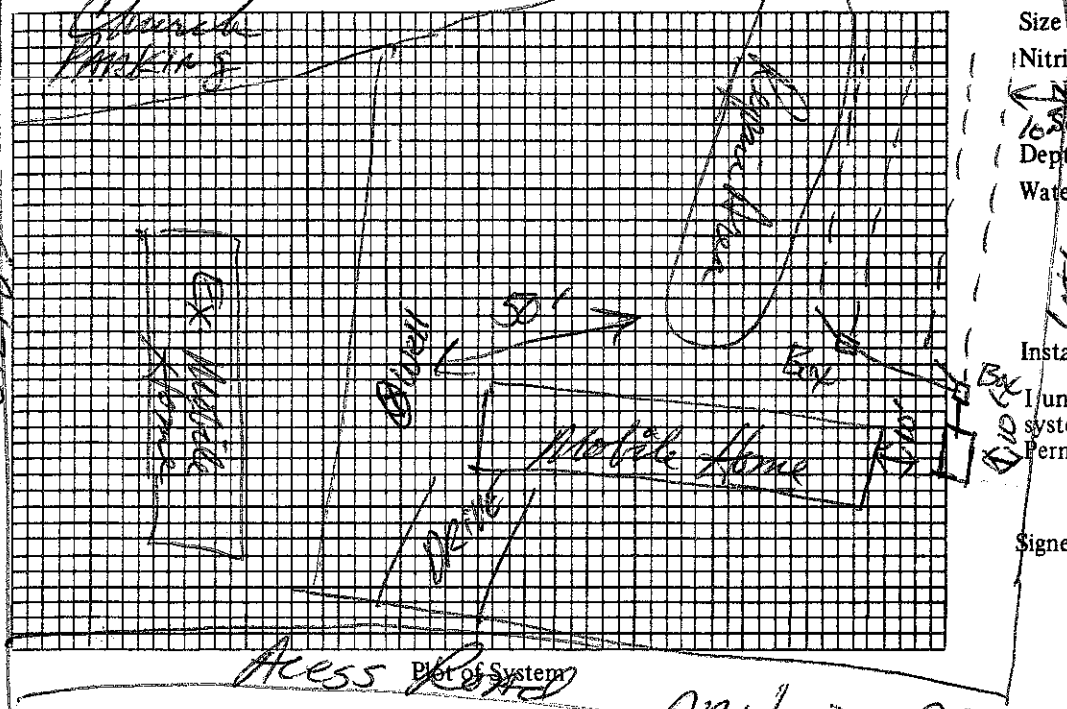

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 4-5

Sq. Ft. 900 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual (✓) Existing

Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: Utility use drop boxes if preferred. Follow contour. Install drainfield with 18" cover over stone.

Relayout of permit issued 4-27-87

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

0351 3.00

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Phillip Craig Brown DATE 4-27-87 PERMIT NO.

PHONE: Business Home

LOCATION 115-21 N. TL 1312 (Flower House Loop) TL 1313 (Carlyle Rd.) ~1 mile on left just past yellow brick church & behind white MH.

SUBDIVISION NAME S. R. No.

LOT NO. SECTION OR BLOCK NO.

House ( ) Mobile Home (✓) Business ( ) Other

No. Bedrooms 4 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes ( ) No (✓)

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes ( ) No ( )

Lot Area ~20000 ft²

Character & Porosity of Soil clay


Percolation Rate ~.4

Topography 2%

Depth to Water Table 44

Rock or other impervious formations none obs.

Basement with Plumbing Basement without Plumbing ✓ No Basement

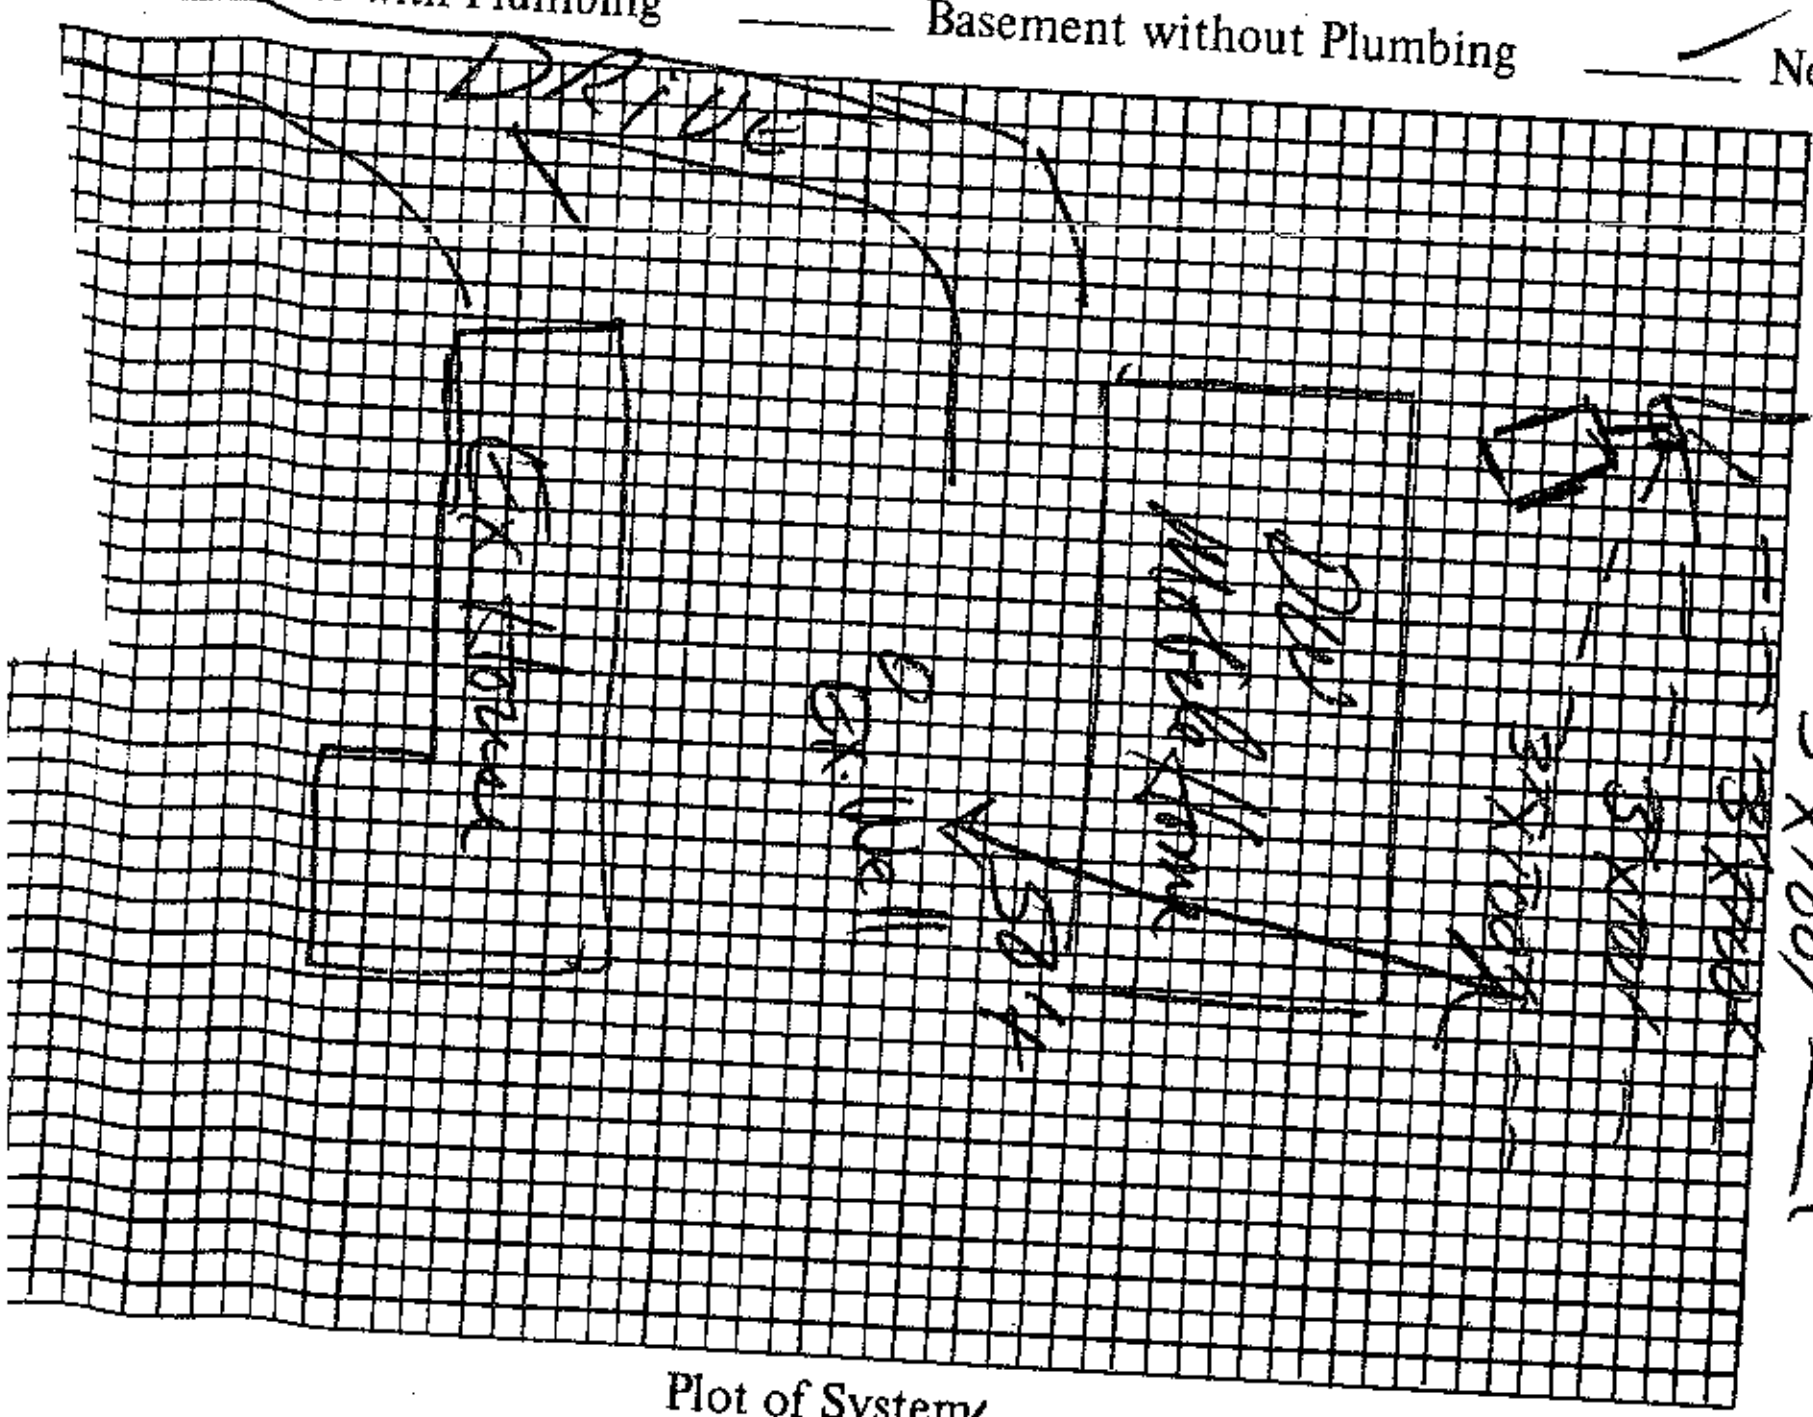

Plot of System

Size of Tank 1250 Gals.

Nitrification Field:

No. of Lines 4

Sq. Ft. 1200 Linear Ft. 400

Depth of Stone in Lines 12"

Water Supply: Individual (✓) Existing

Public ( )

Installed by

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Phillip Craig Brown

IMPROVEMENTS PERMIT BY D.R. Hinson, R.S.

COMMENTS: Keep system as shallow as possible (~12" ave.)

CERTIFICATE OF COMPLETION BY

EXISTING SYSTEM CHECKED BY: DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS. DATE

VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold