DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

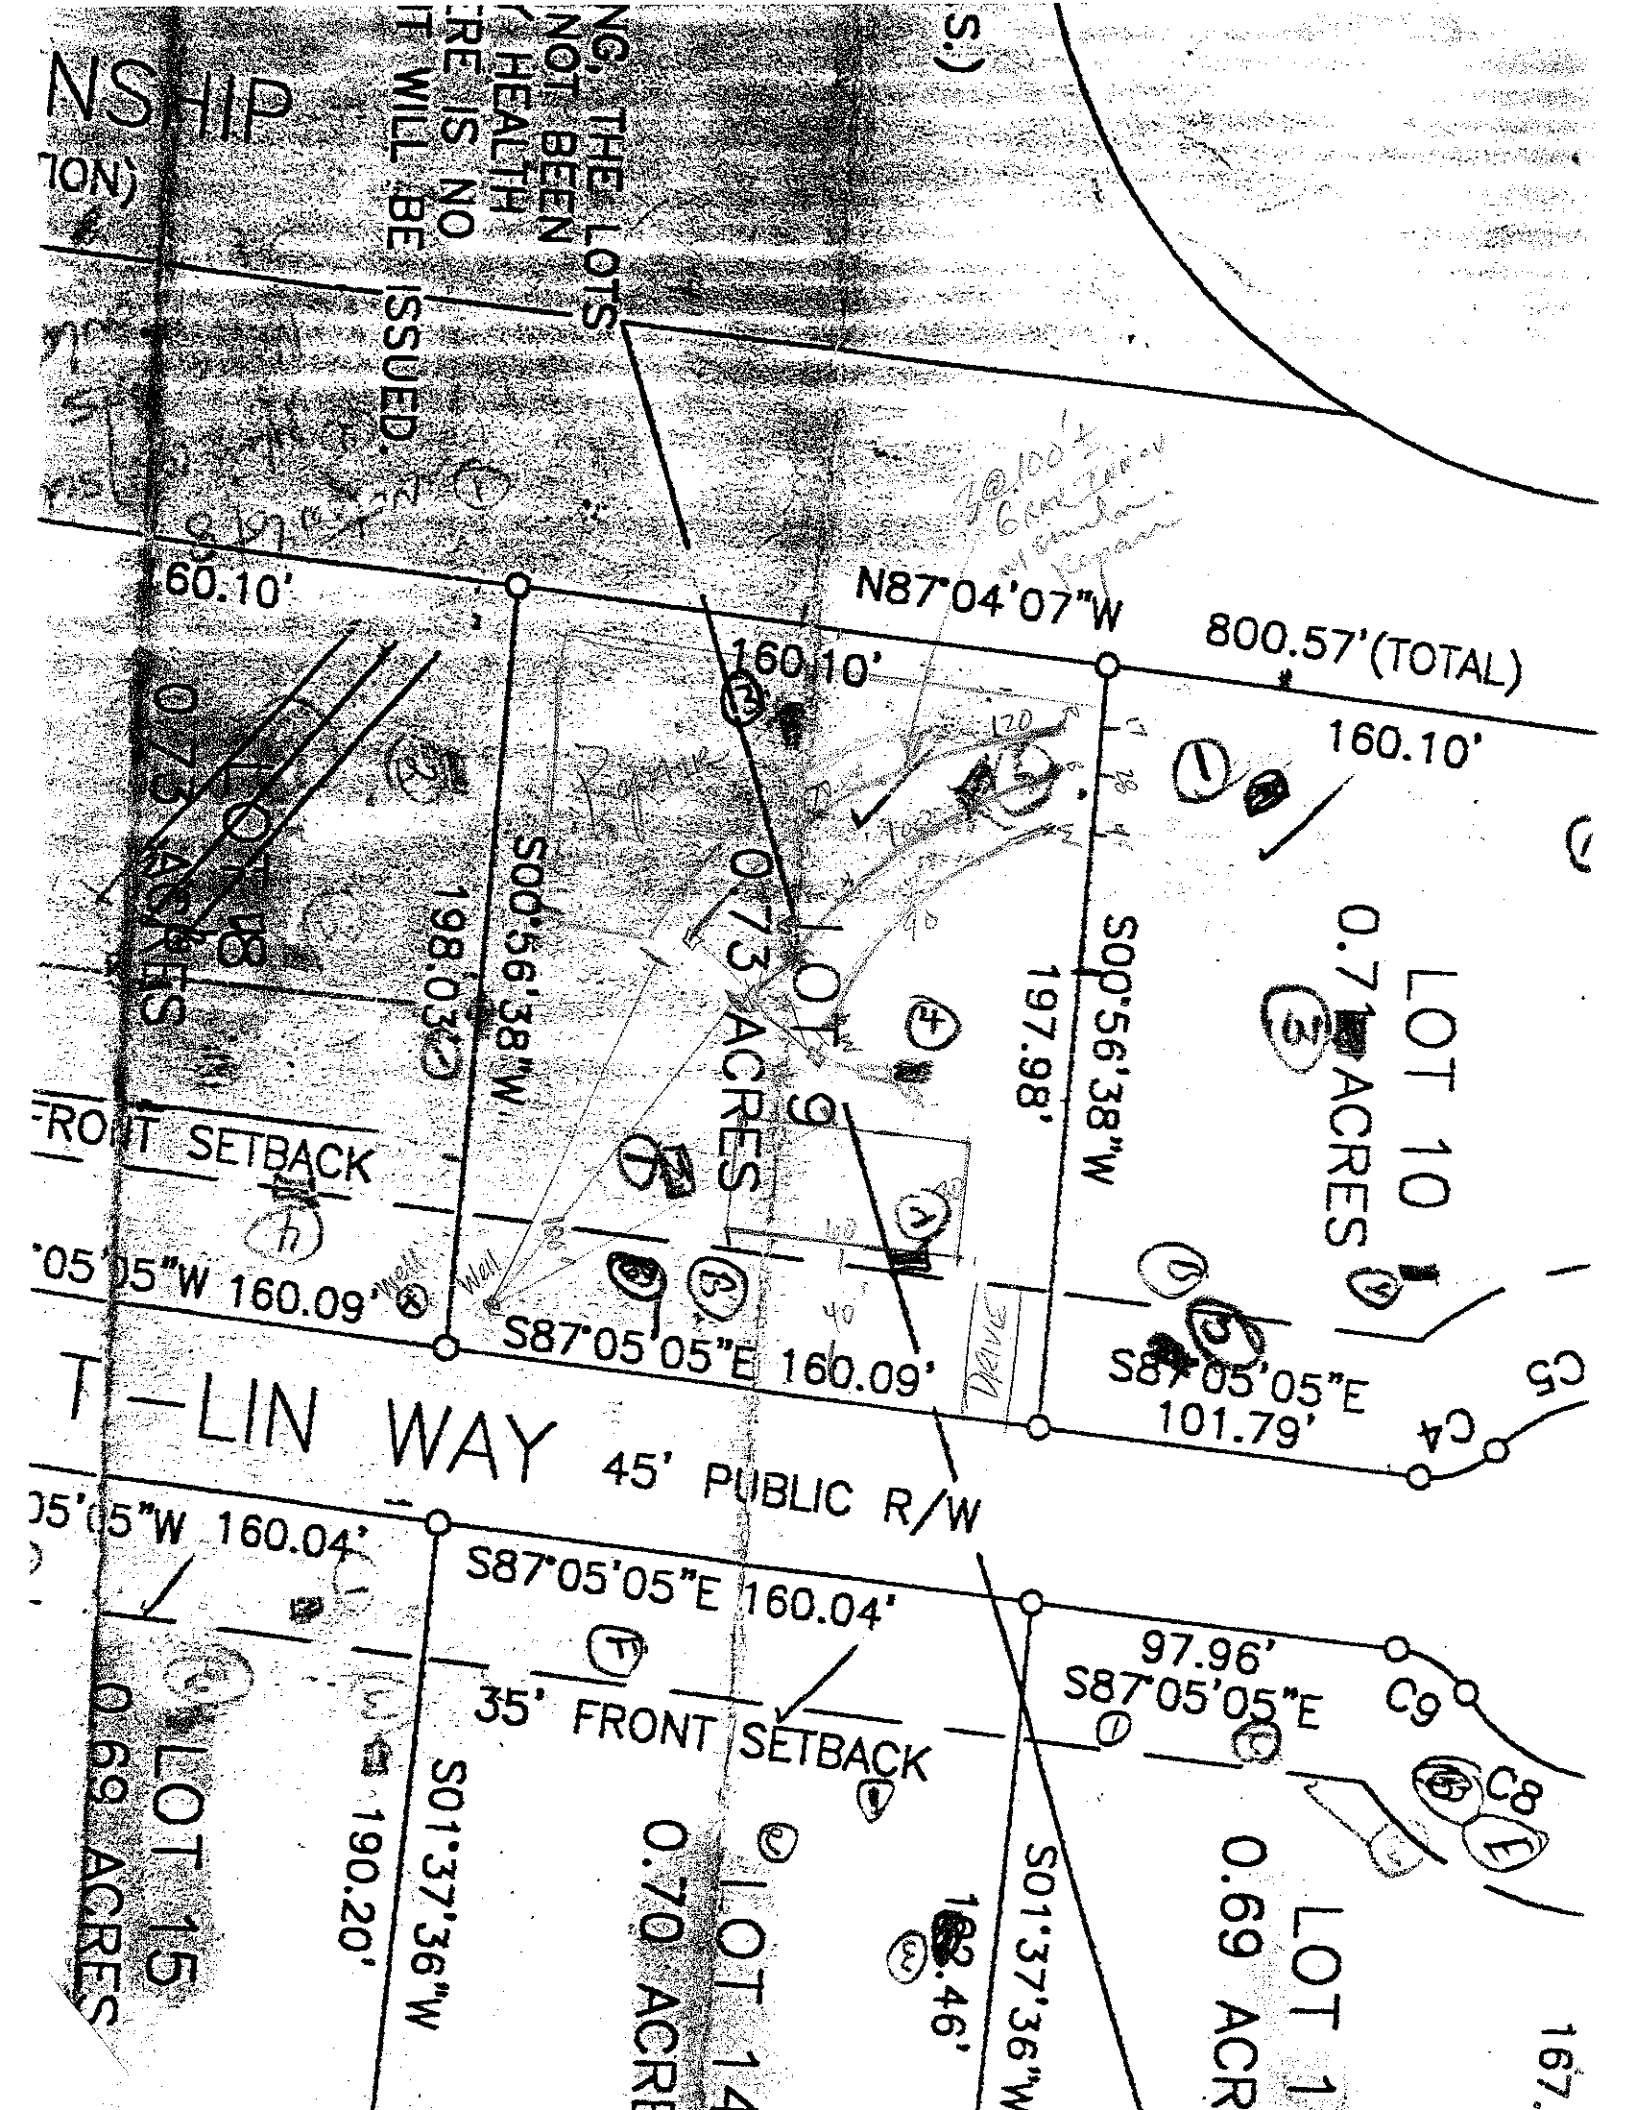
OWNER: _____ APPLICATION DATE _____
ADDRESS: _____ DATE EVALUATED: 4-19-02
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: lot 9 Magic Town PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut (#5) 0-13 13-61 mixed sl/c fi sp-sssp .3
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-7	gr brn scl	fri sssp					
		7-31	SBK RC	fri SP sssp					
		31-70	mottled grscl	fri sssp	sandy loam & sandy clay loam				.3
2		0-4	BSCL GR	fri sssp					
		4-32	SBK RC	fri SP					
		32-66	MASSIVE CL	fri sssp					.3
3		0-6	BSCL WEBK	fri sssp					
		6-61	SBK RCCL	fri SP					PS .3
4		0-7	BSCL GR	fri sssp					
		7-25	SBK RC	fri SP					PS .3
		25-60	MASSIVE CL	fri sssp					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____

COMMENTS: _____


NSHIP
TION)
NOT BEEN
HEALTH
RE IS NO
T WILL BE ISSUED.
S.)
60.10'
N87°04'07"W
800.57'(TOTAL)
160.10'
160.10'
S00°56'38"W
198.03'
0.73 ACRES
LOT 9
0.73 ACRES
S00°56'38"W
197.98'
LOT 10
0.71 ACRES
FRONT SETBACK
'05'05"W 160.09'
S87°05'05"E 160.09'
S87°05'05"E
101.79'
T-LIN WAY 45' PUBLIC R/W
05'05"W 160.04'
S87°05'05"E 160.04'
35' FRONT SETBACK
97.96'
S87°05'05"E
S01°37'36"W
190.20'
LOT 15
0.69 ACRES
LOT 14
0.70 ACRES
S01°37'36"W
LOT 1
0.69 ACR
Well
Well
Drive
C4
C5
C8
C9