PROPERTY ID #: _____

COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICATION DATE _____

ADDRESS: _____

PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ DATE EVALUATED: 4-19-02

LOCATION OF SITE: Lot 23 Main Tract PROPERTY SIZE: _____

WATER SUPPLY: ☐ Private ☐ Public ☑ Well ☐ Spring ☐ Other _____ PROPERTY RECORDED: _____

EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut

TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	wk sbk loam fri						-3
		6-22	SAP rock lr sso						
		22-45	MWSBK grvl fri sso						
		45-66	wk sbk grvl sandy lm fri sap						
2		0-12	RC SAM	fi SP					PS -3
		12-54	MFSBK RCL	fi SSSP					
3		0-27	RC SBK	fi SP					PS -3
		27-62	MFSBK RCL	fi SSSP	common SAP				
4		0-16	RC SBK	fi SP					PS -3
		16-96	MFSBK CL	fi SSSP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

COMMENTS: _____


OTHER FACTORS (.1946): _____

SITE CLASSIFICATION (.1948): _____

EVALUATED BY: _____

OTHER(S) PRESENT: _____

0-5 BSCL fr fi SSSP
5-20 SBK RCL fi SSSP
20-43 MWSBK RCL fi SSSP SP -3

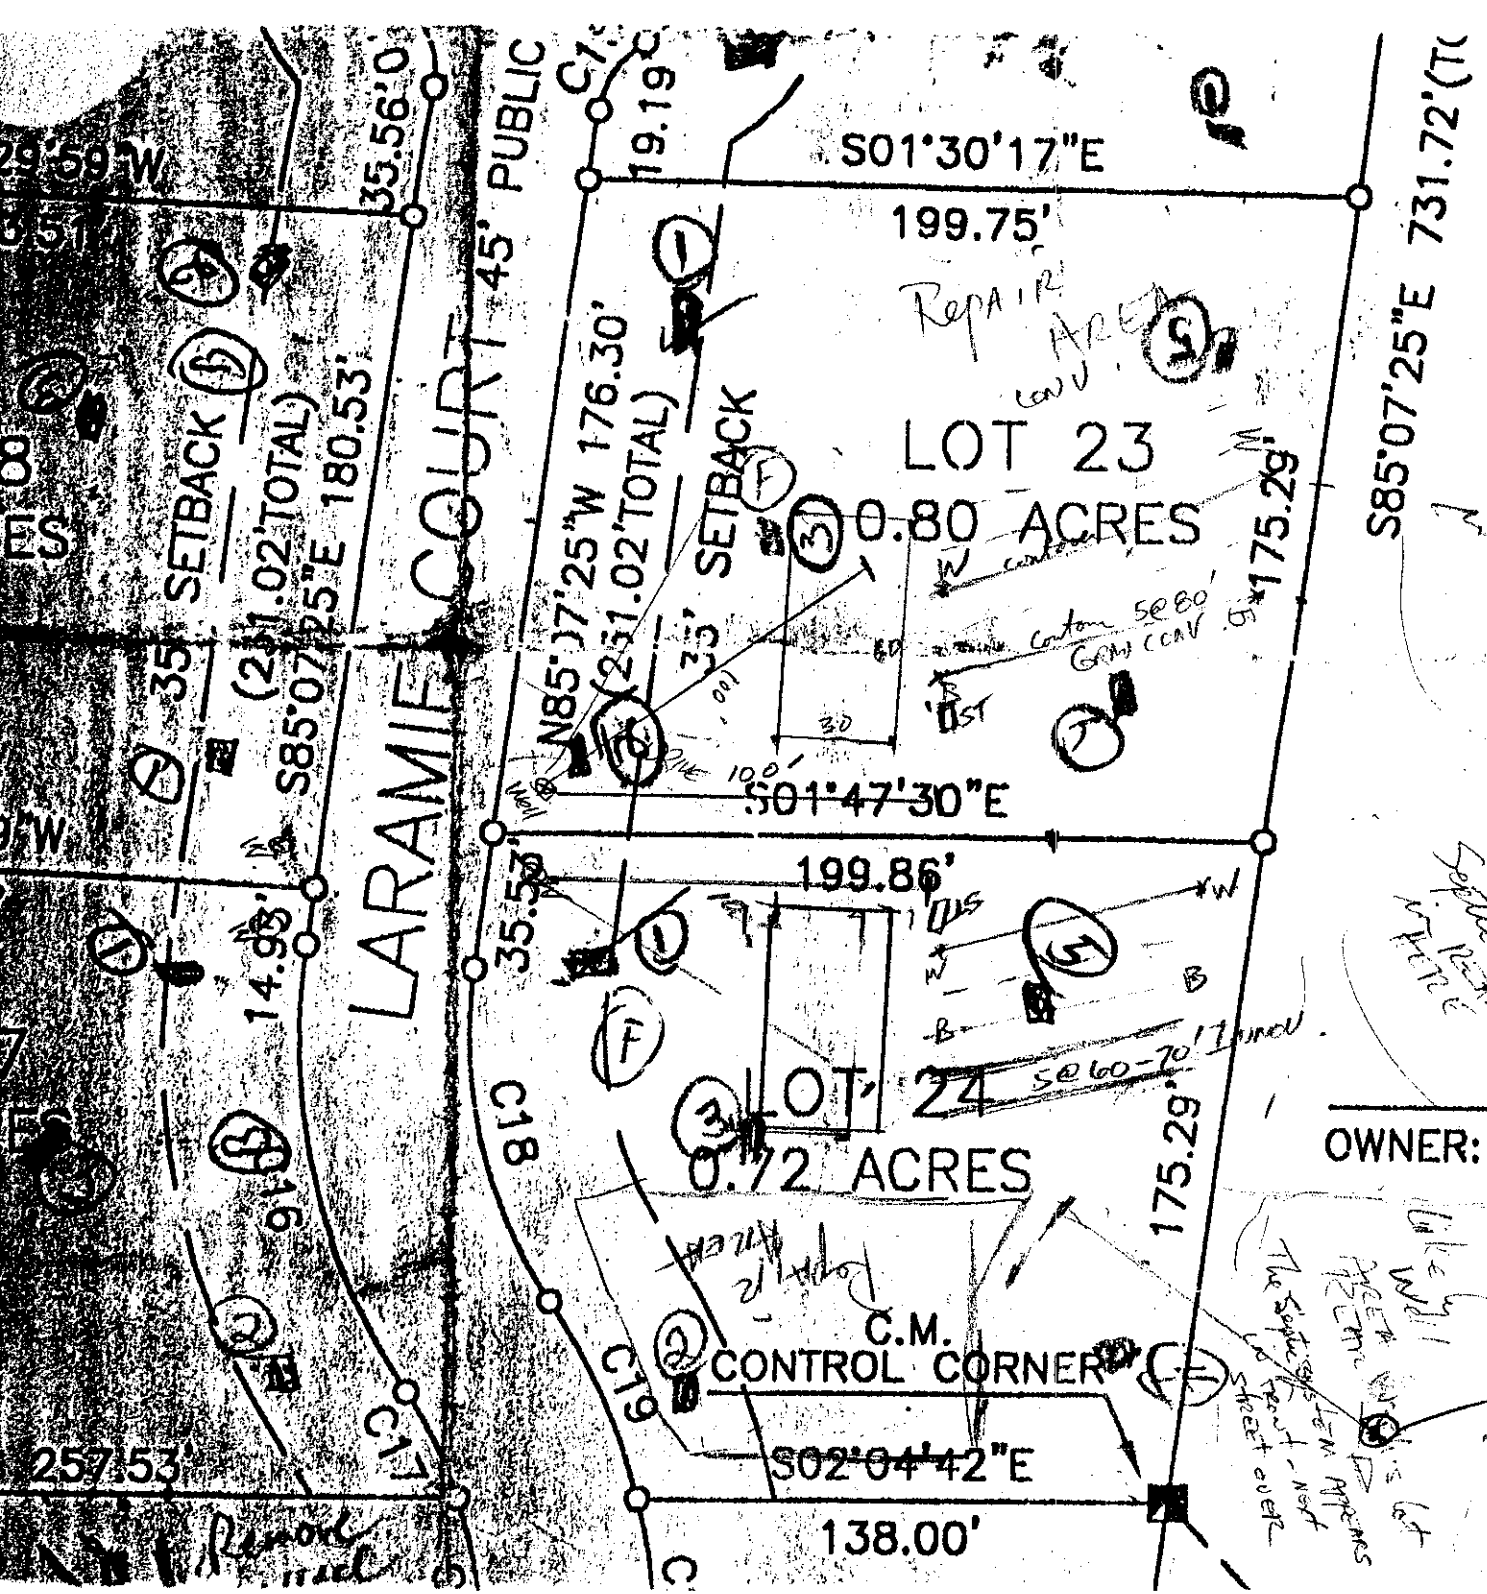

APPROVED_____

DISTRICT ENG

DATE_____

PUBLIC PLAT DECLARATIO
THIS SUBDIVISION CONTA
HEREBY DECLARED PUBL
OF ALL PUBLIC STREETS
SUBDIVISION SHALL BE T
OF PRIMESTAR PROPER
AND IT SHALL BE THEIR
BRING SUCH STREETS UP
OF THE NORTH CAROLIN
TRANSPORTATION BEFORE
ARE ADDED INTO THE N.

OWNER:

RONALD
PRIMEST
1709 SO
KANNAPO

WESTWINDS—PHASE II
MB.32 PG.50