
APPROVED BY
NTA INC. 01/07/2011
Approval of this document does not authorize or approve any deviation or variations from the requirements of applicable State Laws
Mike Fuller

Acknowledgement Of Plans Submittal ONLY!
Date 8-5-11
Date 8-5-11

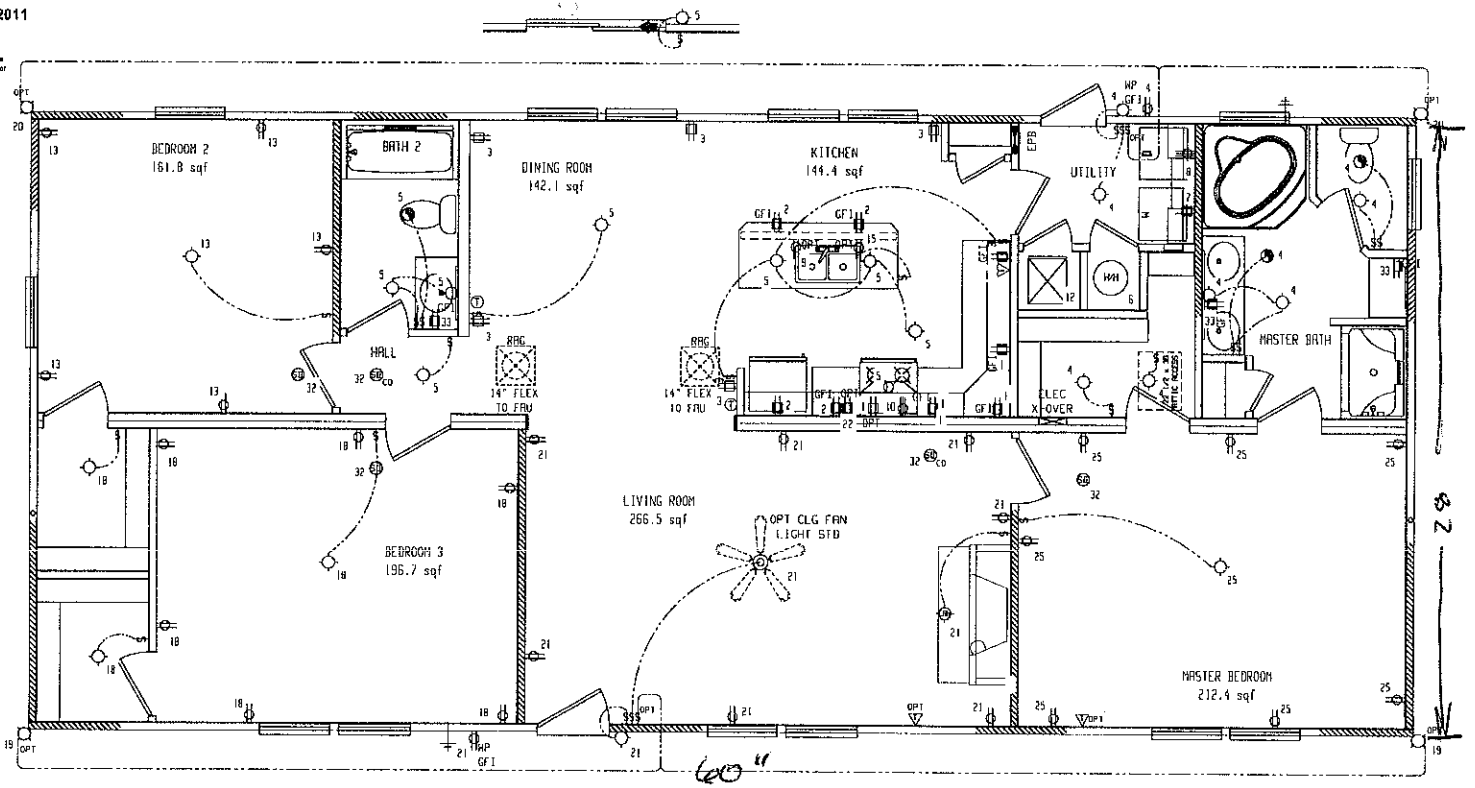


NOTE: ON MODULARS, 15 & 20 AMP BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN DWELLING UNIT FAMILY ROOMS, DINING ROOMS, LIVING ROOMS PARLORS, LIBRARIES, DENS, BEDROOMS, SUNROOMS, RECREATION ROOMS, CLOSETS, HALLWAYS, OR SIMILAR ROOMS OR AREAS MUST BE PROTECTED BY AN ARC-FAULT INTERRUPTER IN ACCORDANCE WITH SECTION 210.12 OF THE NEC. AFCI IS NOT REQUIRED FOR SMOKE DETECTORS IN SOUTH CAROLINA

ELECTRICAL SCHEDULE

| CIR. NO. | DESCRIPTION | BRK. AMP. | VOLTS | COPPER WIRE |
|---|---|---|---|---|
| 1 | PORTABLE APPLIANCES | 20 | 120 | 12 |
| 2 | PORTABLE APPLIANCES | 20 | 120 | 12 |
| 3 | PORTABLE APPLIANCES | 20 | 120 | 12 |
| 4 | GEN. LIGHTING GFI RCPT. | 15 | 120 | 14 |
| 5 | GEN. LIGHTING GFI RCPT. | 15 | 120 | 14 |
| 6 | ELEC. WATER HEATER | CIRCUITS VARY, SEE DRAWING PAGE PLN-3.1 FOR HUD, PLN-1.1 FOR MOD | | |
| 7 | WASHER RECEPT. | 20 | 120 | 12 |
| 8 | DRYER RECEPT. | 30 | 240 | 10 |
| 9 | OPT. DISHWASHER | 15 | 120 | 14 |
| 10 | ELECT. RANGE/CKTOP | 60 | 240 | 6 |
| 11 | GAS FURNACE | 15 | 120 | 14 |
| 12 | ELECTRIC FURNACE | CIRCUITS VARY, SEE DRAWING PAGE PLN-3.5 FOR HUD, PLN-1.5 FOR MOD | | |
| 13 | GEN. LIGHTING GFI RCPT. | 15 | 120 | 14 |
| 14 | OPT. COOLER BOX | 15 | 120 | 14 |
| 15 | OPT. GARBAGE DISPOSAL | 15 | 120 | 14 |
| 16 | FREEZER | 20 | 120 | 12 |
| 17 | OPT. WHIRLPOOL | 20 | 120 | 12 |
| 18 | GEN. LIGHTING GFI RCPT. | 15 | 120 | 14 |
| 19 | GEN. LIGHTING GFI RCPT. | 15 | 120 | 14 |
| 20 | GEN. LIGHTING GFI RCPT. | 15 | 120 | 14 |
| 21 | GEN. LIGHTING GFI RCPT. | 15 | 120 | 14 |
| 22 | OPT. MICROWAVE | 20 | 120 | 12/2 |
| 24 | ELECT. BUILT-IN OVEN | 20 | 240 | 12/2 |
| 25 | GENERAL LIGHTING | 15 | 120 | 14 |
| 26 | GENERAL LIGHTING | 15 | 120 | 14 |
| 27 | GENERAL LIGHTING | 15 | 120 | 14 |
| 28 | GENERAL LIGHTING | 15 | 120 | 14 |
| 29 | GENERAL LIGHTING | 15 | 120 | 14 |
| 30 | GENERAL LIGHTING | 15 | 120 | 14 |
| 31 | SITE INSTALLED HEAT PUMP | 40 | 240 | 8/3 |
| 32 | SMOKE ALARMS | 15 | 120 | 14 |
| 33 | BATH GFI | 20 | 120 | 12 |

BRAND: OAKWOOD
SERIES: VN28

CMH MANUFACTURING, INC.

| REVISIONS | BY | DATE |
|---|---|---|
| | | |

GENERAL NOTES
LOCK-OUT BREAKER ON CIRCUIT #6

DRAWING TITLE
ELECTRICAL PLAN

| MODEL NAME | SQ. FT. |
|---|---|
| 2507 | 1600 |

| PLANT | DESCRIPTION | MODEL NO. |
|---|---|---|
| 957 | 28X60 3BR-2BA | 2507 |

| DRAWN BY | ORIG. DATE | DATE PRINTED | SHEET NO. |
|---|---|---|---|
| JDC | 04/12/2007 | 01/05/2011 | 11-1 |