IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Herbert E. Tennant DATE 3/30/84 PERMIT NO. 61

PHONE: Business _____ Home _____

LOCATION 1155 on left on corner of 1138 (Rhubyfenion Road)

S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home ( ) Business (X) Other 24 SEAT TAVERN

No. Bedrooms _____ No. Bathrooms 2


Garbage Disposal Unit Yes ( ) No (X)
Auto. Dishwasher Yes ( ) No (X)
Auto. Wash. Machine Yes ( ) No (X)
Site Suitable for 1138 Yes (X) No ( )
Lot Area 1.75 ACRE

Character & Porosity of Soil Clay
Percolation Rate 2-4 gal 1ft 24 hrs
Topography 2-4%
Depth to Water Table _____
Rock or other impervious formations None observed

1000 gal pump TANK
New septic TANK
Size of Tank 1500 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 1200 Linear Ft. 400
Depth of Stone in Lines 12"

Water Supply: Individual (X)
Public ( )

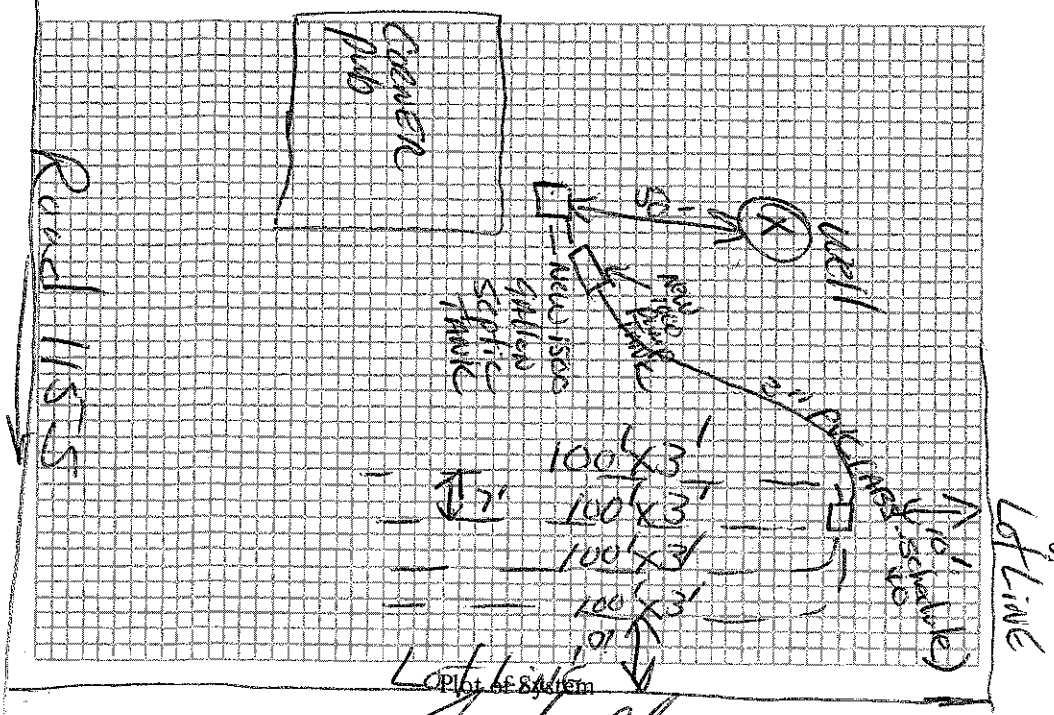

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Herbert E Tennant

IMPROVEMENTS PERMIT BY Fred Clemmer

COMMENTS: START Nitrification Line deep to avoid use of stepdowns; Pump old tank and backfill w/ clean clay. Note presence of natural gas lines!

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.
Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold