DEPARTMENT OF ENVIRONMENT, HEALTH, AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #:
COUNTY: Iredell

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: G T Contracting / James Covington APPLICANT:
ADDRESS: APPLICATION DATE: DATE EVALUATED: 4/14/16
PROPOSED FACILITY: PROPOSED DESIGN FLOW (.1949): PROPERTY SIZE:
LOCATION OF SITE: 188 Presbyterian PROPERTY RECORDED:
WATER SUPPLY: ☒ Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☒ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LAND-SCAPE POSITION/ SLOPE %	HORI-ZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	4%	0-4"	Brw SCL w SBK SS, SP, SE, FR						PS .3+
		4-48"	Rd/Brw to Rd C/CL m-w SBK SS, SP, SE, FR w/ common Mica flakes			48"			
2	5%	0-4"	Brw SCL w SBK SS, SP, SE, FR						PS .3
		4-48"	Rd/Brw to Rd C/CL m-w SBK SS, SP, SE, FR			48"			
3	4%	0-4"	Brw SCL w SBK SS, SP, SE, FR						PS .3
		4-48	Rd/Brw to Rd C/CL m-w SBK SS, SP, SE, FR			48"			
4	5%	0-5"	Brw SCL w SBK SS, SP, SE, FR						PS .3
		5-48	R C/CL m-w SBK SS, SP, SE, FR			48"			


DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	PPBPS	Same
Site LTAR	.3	.3

OTHER FACTORS (.1946): None
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: Maria Dotson
OTHER(S) PRESENT: James Covington, R. Dobson

Soil Boring locations

CONNECTGIS WEB HOSTING

North Carolina Iredell County

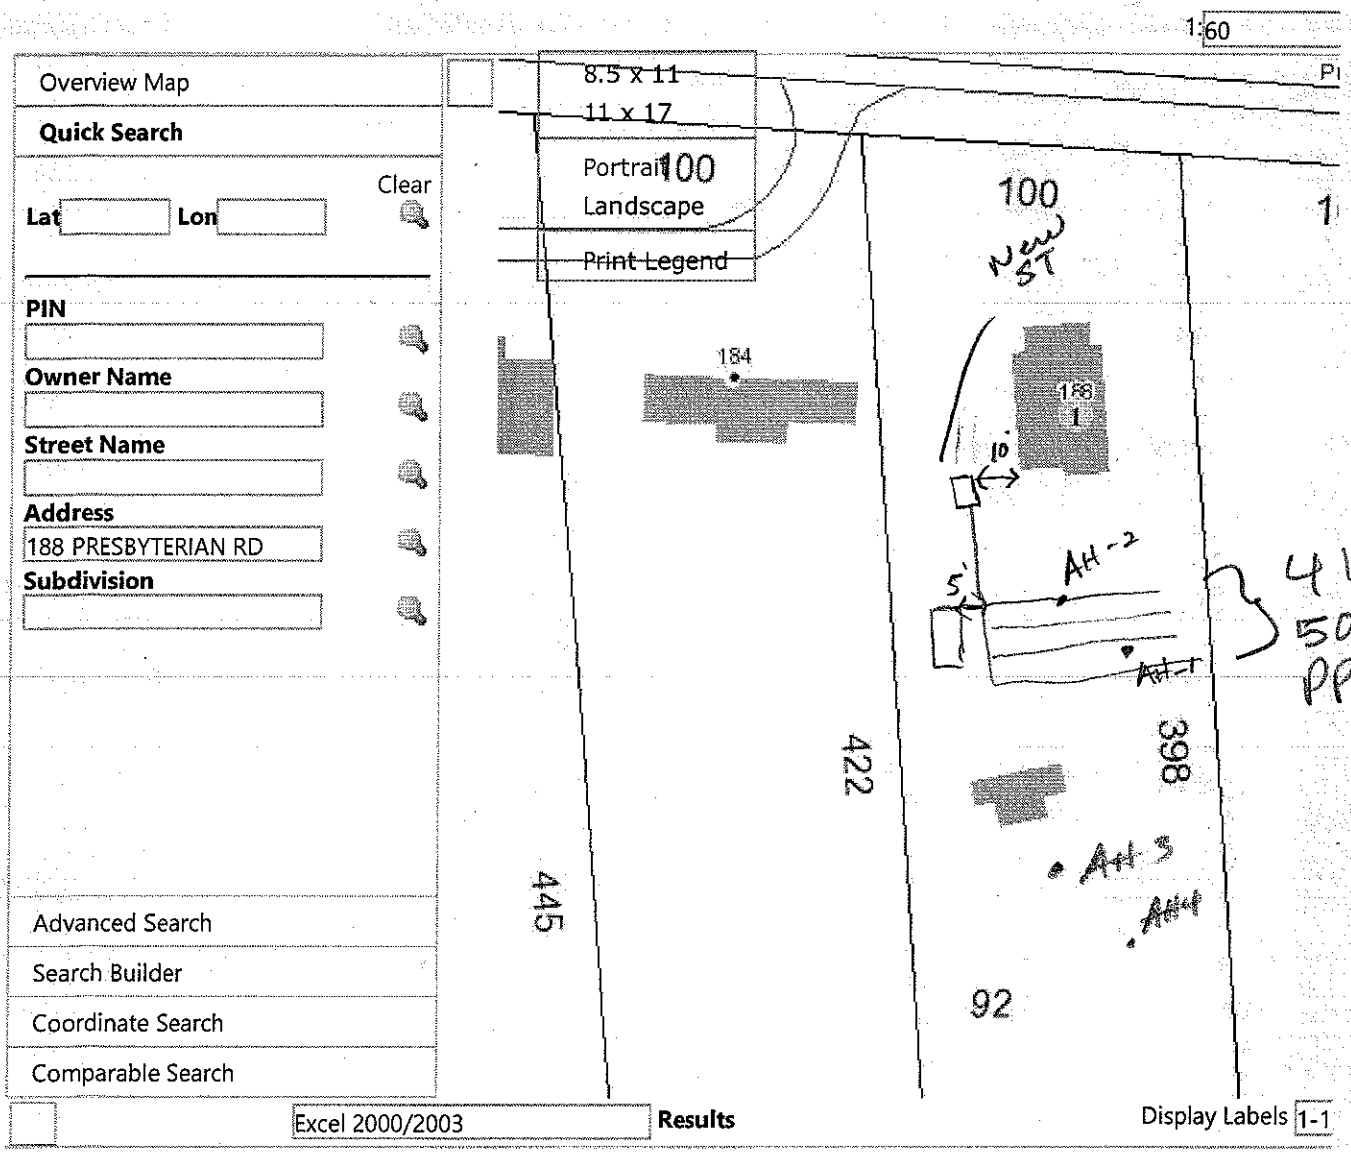

©2009-2016 Dude Solutions. All Rights Reserved. | Software Notices