DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: Covington
ADDRESS: Beside 188 Presbyterian Rd
PROPOSED FACILITY: SFR
PROPOSED DESIGN FLOW (.1949): 360
LOCATION OF SITE: _____
APPLICATION DATE 6-24-08
DATE EVALUATED: 6-26-08
PROPERTY SIZE: .88
PROPERTY RECORDED: Yes

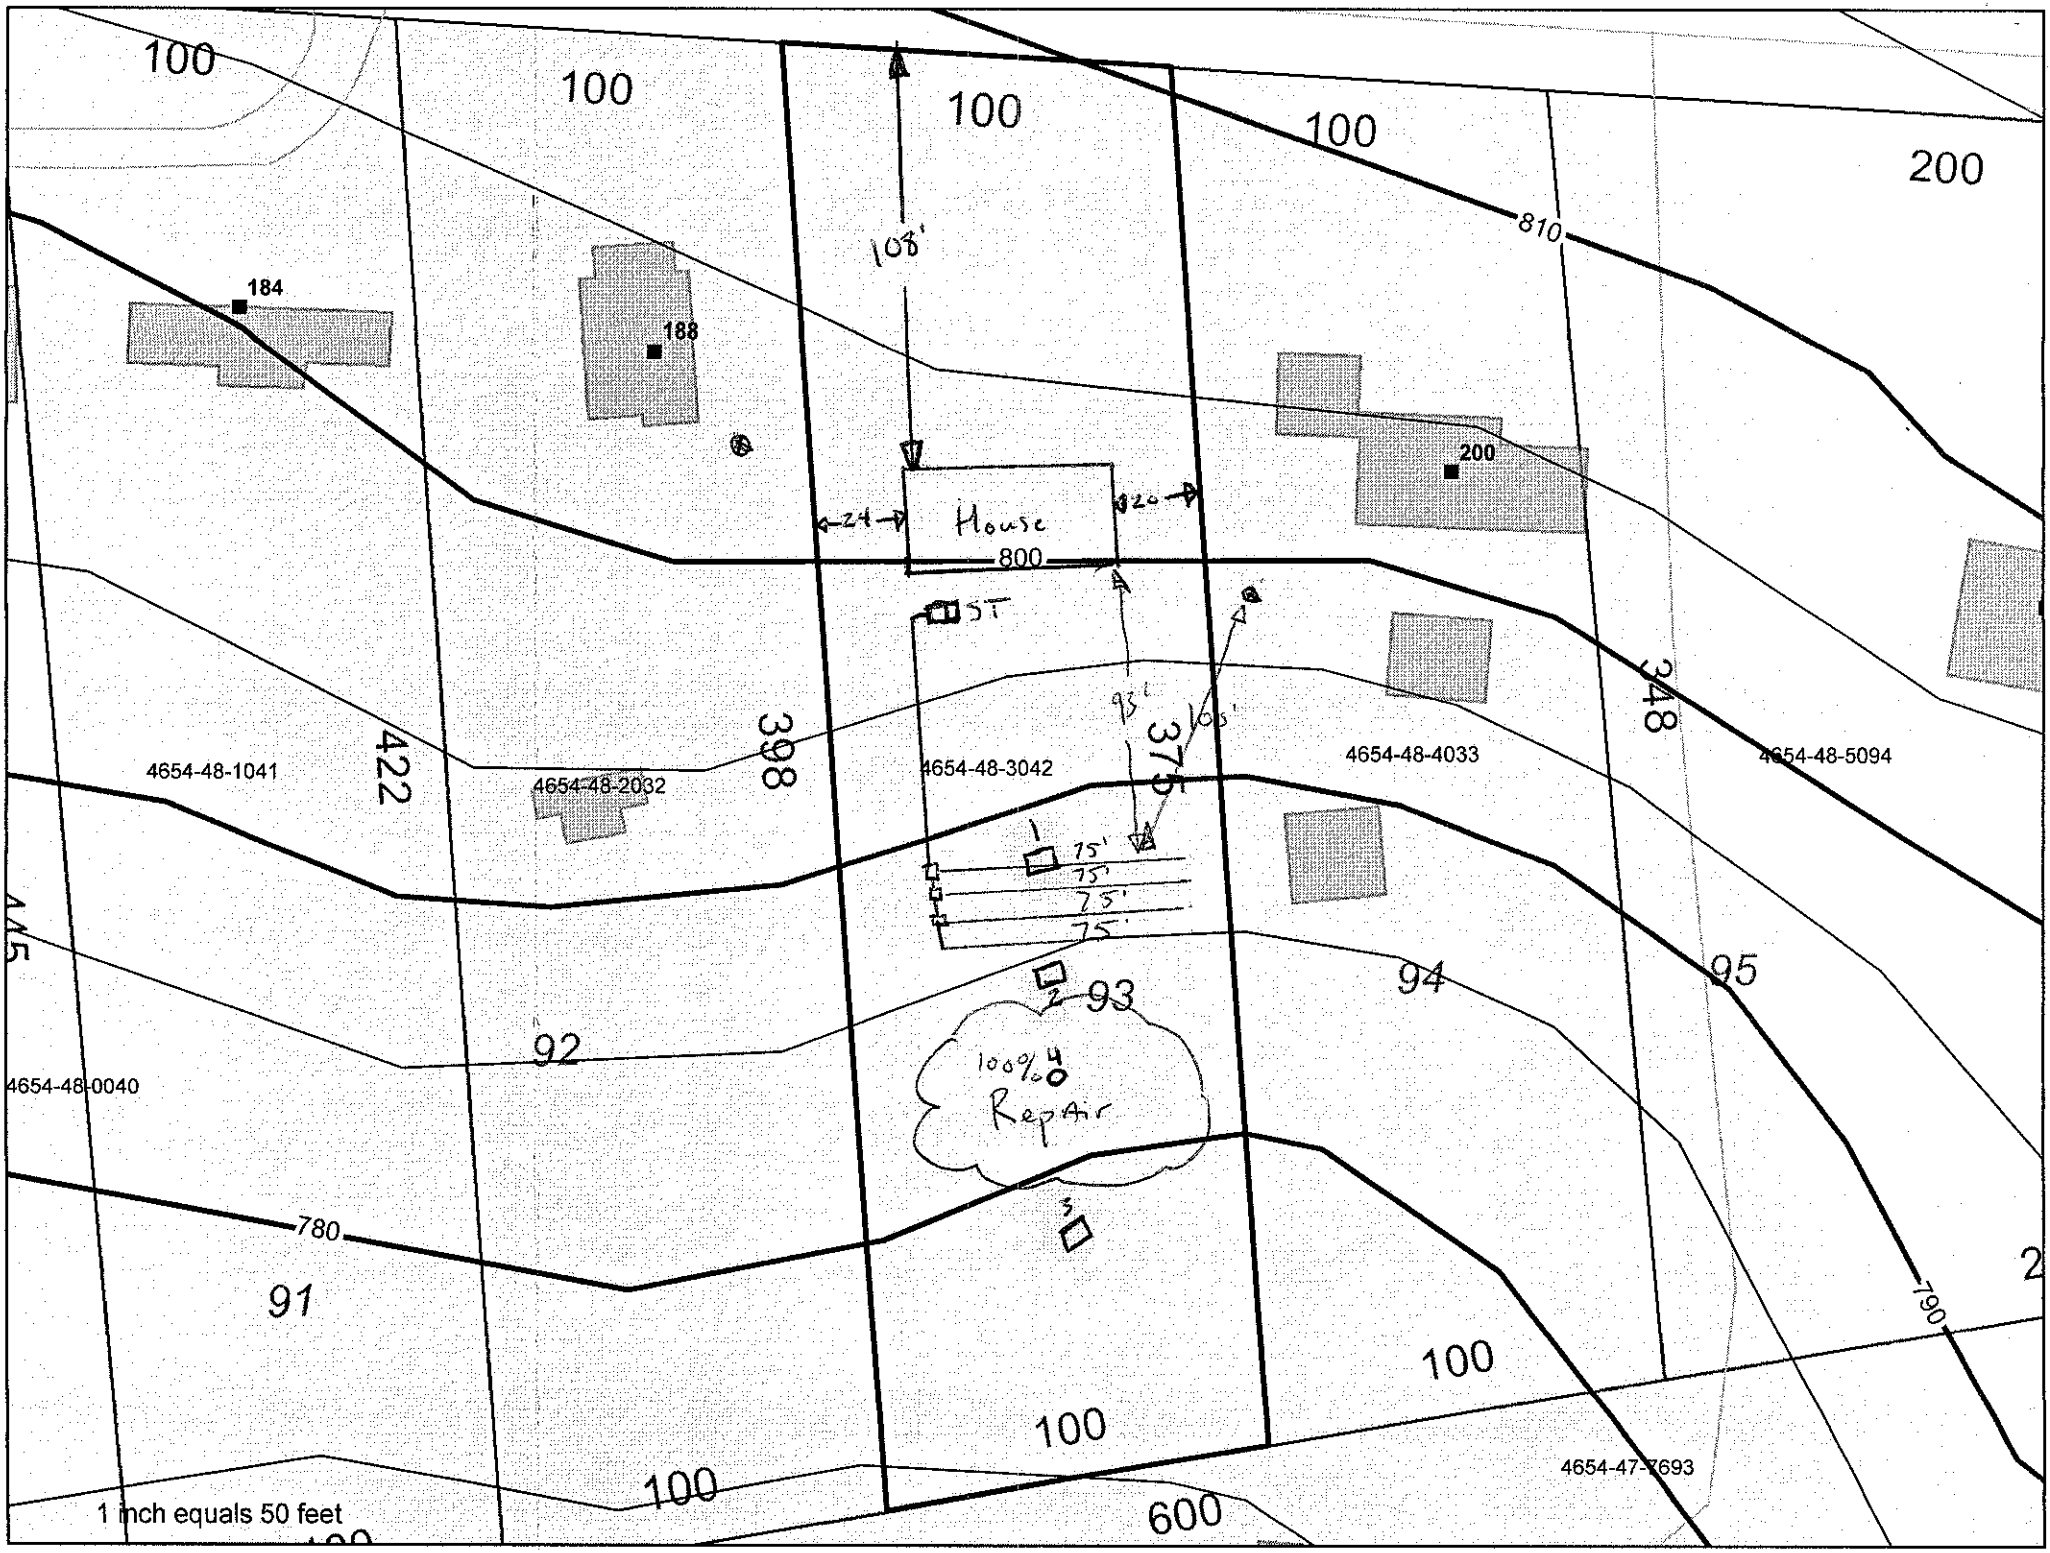
WATER SUPPLY: ☐ Private ☐ Public ☒ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☒ Auger Boring ☒ Pit ☐ Cut
TYPE OF WASTEWATER: ☒ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	OTHER PROFILE FACTORS .1943 SOIL DEPTH	OTHER PROFILE FACTORS .1956 SAPRO CLASS	OTHER PROFILE FACTORS .1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-20	CLmsBk	SS SP SexpF	Sap inc	20"			.35
		20-67	LSapmsBk	NS NP NexpF					
2		0-34	CLmsBk	SSSPSexpF	Few sap inc	60"			.3
		34-60	CmsBk	SS SP SexpF					
3		0-17	SCLmsBk	SSSPSexpF	Few sap inc. Chroma 2	49"			.3 to 49"
		17-49	CmsBk	SSSPSexpF					
		49-60	CmsBk	S SP SexpF					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	PS	PS
System Type(s)	25%	25%
Site LTAR	.3	.3

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: J-Allen
OTHER(S) PRESENT: _____

COMMENTS: _____


100
100
100
100
200
810
108'
184
188
200
24
House
20
800
ST
93'
105'
348
398
375
422
4654-48-1041
4654-48-2032
4654-48-3042
4654-48-4033
4654-48-5094
1
75'
75'
75'
75'
2
93
94
95
92
100% Repair
4654-48-0040
780
91
3
100
100
100
790
4654-47-7693
600
1 inch equals 50 feet