4655347114

IREDELL COUNTY HEALTH DEPARTMENT

10302 (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Herbert Tennant DATE Oct. 25, '89 PERMIT NO. ID-845

PHONE: Business _____ Home _____

LOCATION 115 S. TR 1223 (Eastpoint Lane) TR 1224 at end on left

SUBDIVISION NAME _____ S. R. No. _____

LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)
Auto. Dishwasher	Yes (✓)	No ( )
Auto. Wash. Machine	Yes (✓)	No ( )
Site ~~Suitable~~ PS	Yes ( )	No ( )

Lot Area 20000ft²

Character & Porosity of Soil Clay
Percolation Rate 40
Topography Flat
Depth to Water Table 4ft
Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

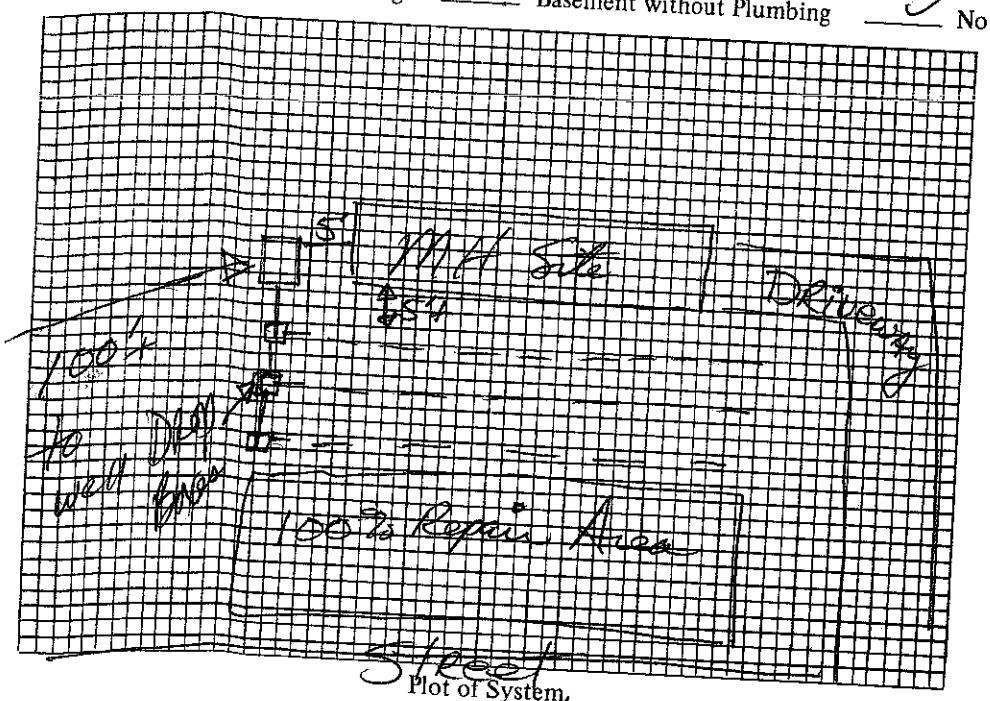

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Owner

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY DRH

COMMENTS: _____

ERTIFICATE OF COMPLETION BY DRHuson RS

STING SYSTEM CHECKED BY: _____ DATE 10-25-89

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

t is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making
vements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

IREDELL COUNTY HEALTH DEPARTMENT

10302 (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Herbert [redacted] Tennant DATE Oct. 20, 88 PERMIT NO. 10-8-A-5

PHONE: Business _____ Home _____

LOCATION 1155. to 1223 (Eastport Lane) TR 1224 to end on left S. R. No. _____


SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site ~~Suitable~~ PS Yes (✓) No ( )
Lot Area 20000 ft²+

Character & Porosity of Soil clay
Percolation Rate 40+
Topography 4-6%
Depth to Water Table 4ft
Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

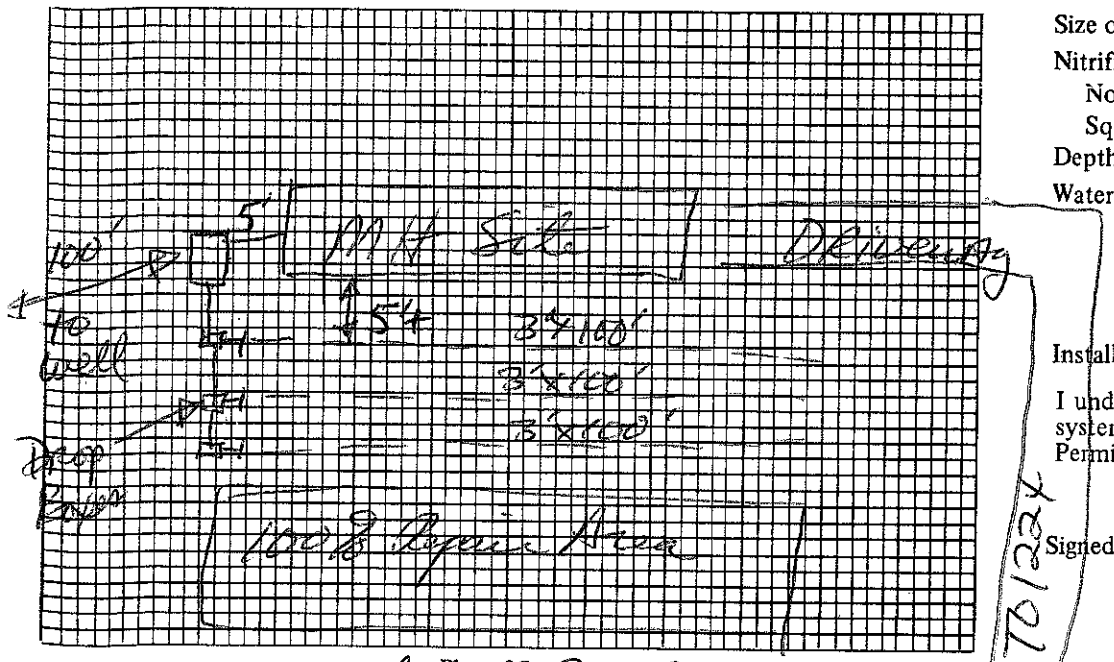

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"
Water Supply: Individual (✓) Ex.
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: H E Tennant

IMPROVEMENTS PERMIT BY _____

COMMENTS: Follow contour with drainfield. Trench bottom depth approx. 30".

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

rmit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making provements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold