
Thomas Willig

CONNECTGIS WEB HOSTING

IREDELL COUNTY NORTH CAROLINA

Soil Boring Locations 1:100

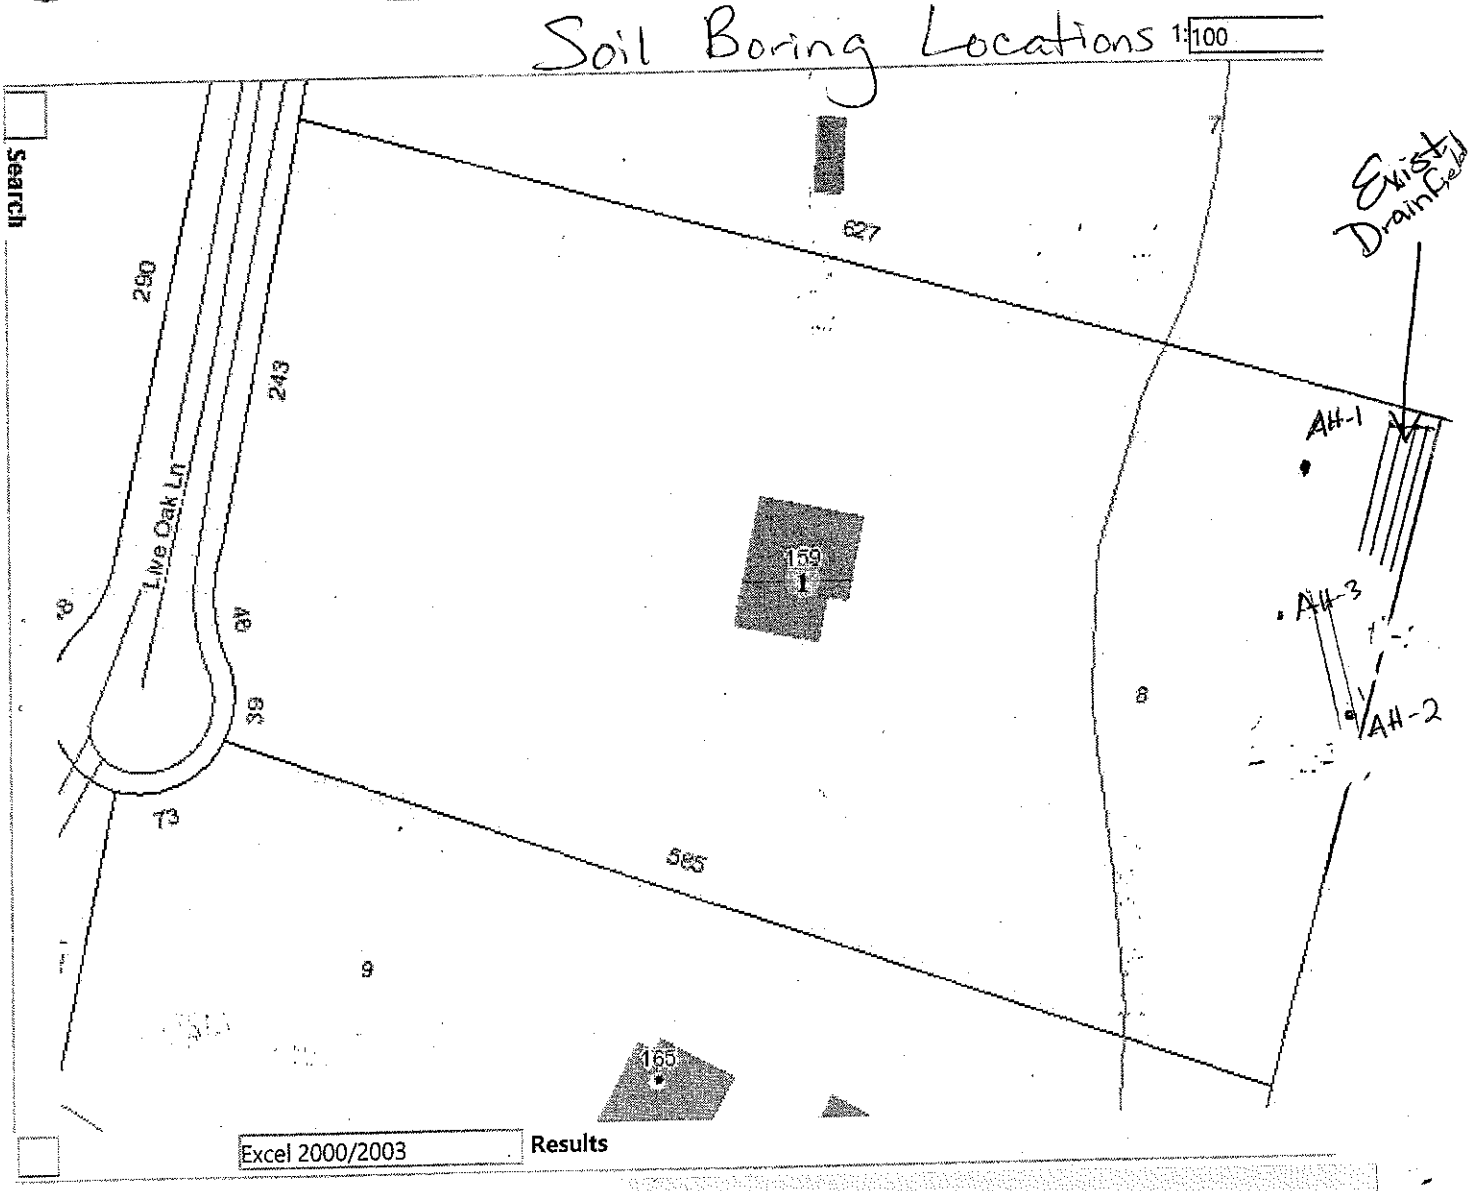

Excel 2000/2003 Results

	Date	Initials
Drain Lines Checked	8/12/15	MD
Tanks Checked		
Pressure Manifold or Valve Box Checked	8/18/15	SC
Pressure Head Set	8/18/15	SC
Electrical Checked	8/18/15	SC
Floats Set	8/18/15	SC
Alarm Checked	8/18/15	SC
Maintenance Contract Y / N	8/18/15	SC

Needs Maint. Contract - attached

IREDELL COUNTY HEALTH DEPARTMENT

0733

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System - G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Tony Neville DATE 10-24-88 PERMIT NO. 4655-35-2322

PHONE: Business _____ Home _____

LOCATION 155 S. to 1136 (Faith Rd) R into Caldwell Est. 3rd on left

S. R. No. _____

SUBDIVISION NAME The Caldwell Estates LOT NO. 8 SECTION OR BLOCK NO. _____

J & J LAND & TIMBER

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 2 No. Bathrooms 2½

Garbage Disposal Unit Yes (✓) No ( )

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area ~2 AC

Character & Porosity of Soil Arkaqo Drainfield Clay

Percolation Rate 5


Topography Gently

Depth to Water Table 34

Rock or other impervious formations none to

250 pt.

✓ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

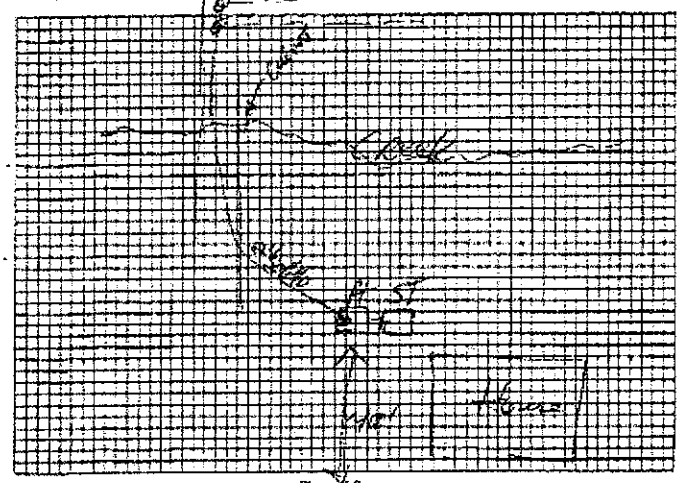

Plot of System

Size of Tank 1250 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 420 Linear Ft. 267

Depth of Stone in Lines 12"

Water Supply: Individual (✓) pd

Public ( )

Installed by [illegible]

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY [illegible]

COMMENTS: Alarm to Hold Backing Water

Landscape over drainfield area.

CERTIFICATE OF COMPLETION BY [illegible] DATE 10-24-88

EXISTING SYSTEM CHECKED BY. _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

Lines measure 264'