4655429277

08690

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Gary Vance DATE June 16, '88 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 155 S. to 1137 (Midway Lake Rd.) to 1272 (Vance Farm Rd.) at end S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

Fixture Temporary

House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2½

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site ~~Suitable~~ IS Yes (✓) No ( )

Lot Area 10 AC

Character & Porosity of Soil clay


Percolation Rate 2.4

Topography 4-6%

Depth to Water Table 4'+

Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

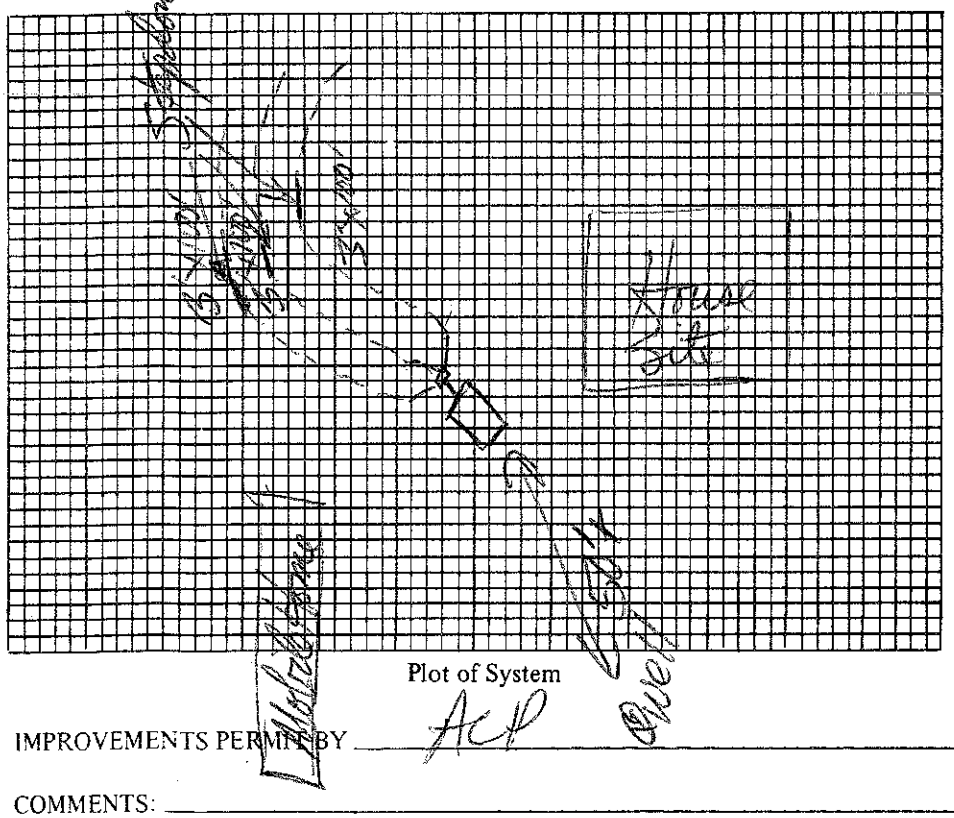

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 900 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by A J Erwin

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY ACP

COMMENTS: _____

CERTIFICATE OF COMPLETION BY [signature] DATE June 16, '88

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

08690

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Gary Nance DATE 4/19/88 PERMIT NO.

PHONE: Business Home 892-4237

LOCATION 115 S. TL Midway Lake Road TL Nance Farm Rd. At end. S. R. No.

SUBDIVISION NAME LOT NO. SECTION OR BLOCK NO.

~~FUTURE~~

House ( ) Mobile Home (✓) Business ( ) Other

No. Bedrooms 3 No. Bathrooms 2 1/2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Character & Porosity of Soil Clayey

Percolation Rate ~Aggd/ff2


Topography 2% J

Depth to Water Table 4'+

Rock or other impervious formations none observed.

Lot Area 10 ACRES

____ Basement with Plumbing ____ Basement without Plumbing ✓ No Basement

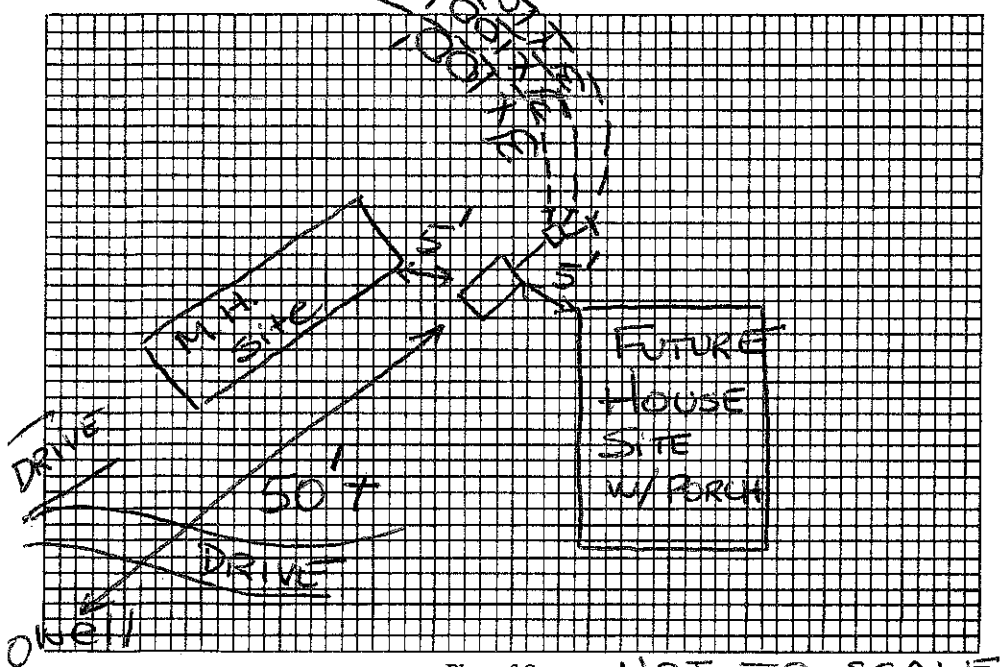

Plot of System NOT TO SCALE

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 900 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Gary Nance

IMPROVEMENTS PERMIT BY Andrew C. Price

COMMENTS: Keep tank away from house/MH at least 5'

LINES SHOULD BE SHALLOW AND ON CONTOUR.

CERTIFICATE OF COMPLETION BY DATE

EXISTING SYSTEM CHECKED BY: DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold