0873

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Tom Poteat DATE 5/2/88 PERMIT NO.

PHONE: Business ______ Home 663-2992

LOCATION 21 S TR 1100 TL Lazy Lane 2nd lot on left. S. R. No. ______

SUBDIVISION NAME Carefree Estates LOT NO. 14 SECTION OR BLOCK NO. ______


House (X) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes (✓) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
~~Site Suitable~~ P.S. ~~Yes ( ) No ( )~~ lot line
Lot Area 30000

Character & Porosity of Soil Clayey
Percolation Rate ~.4
Topography 4%
Depth to Water Table 4'+
Rock or other impervious formations none observed.

10'

______ Basement with Plumbing ______ Basement without Plumbing ✓ No Basement

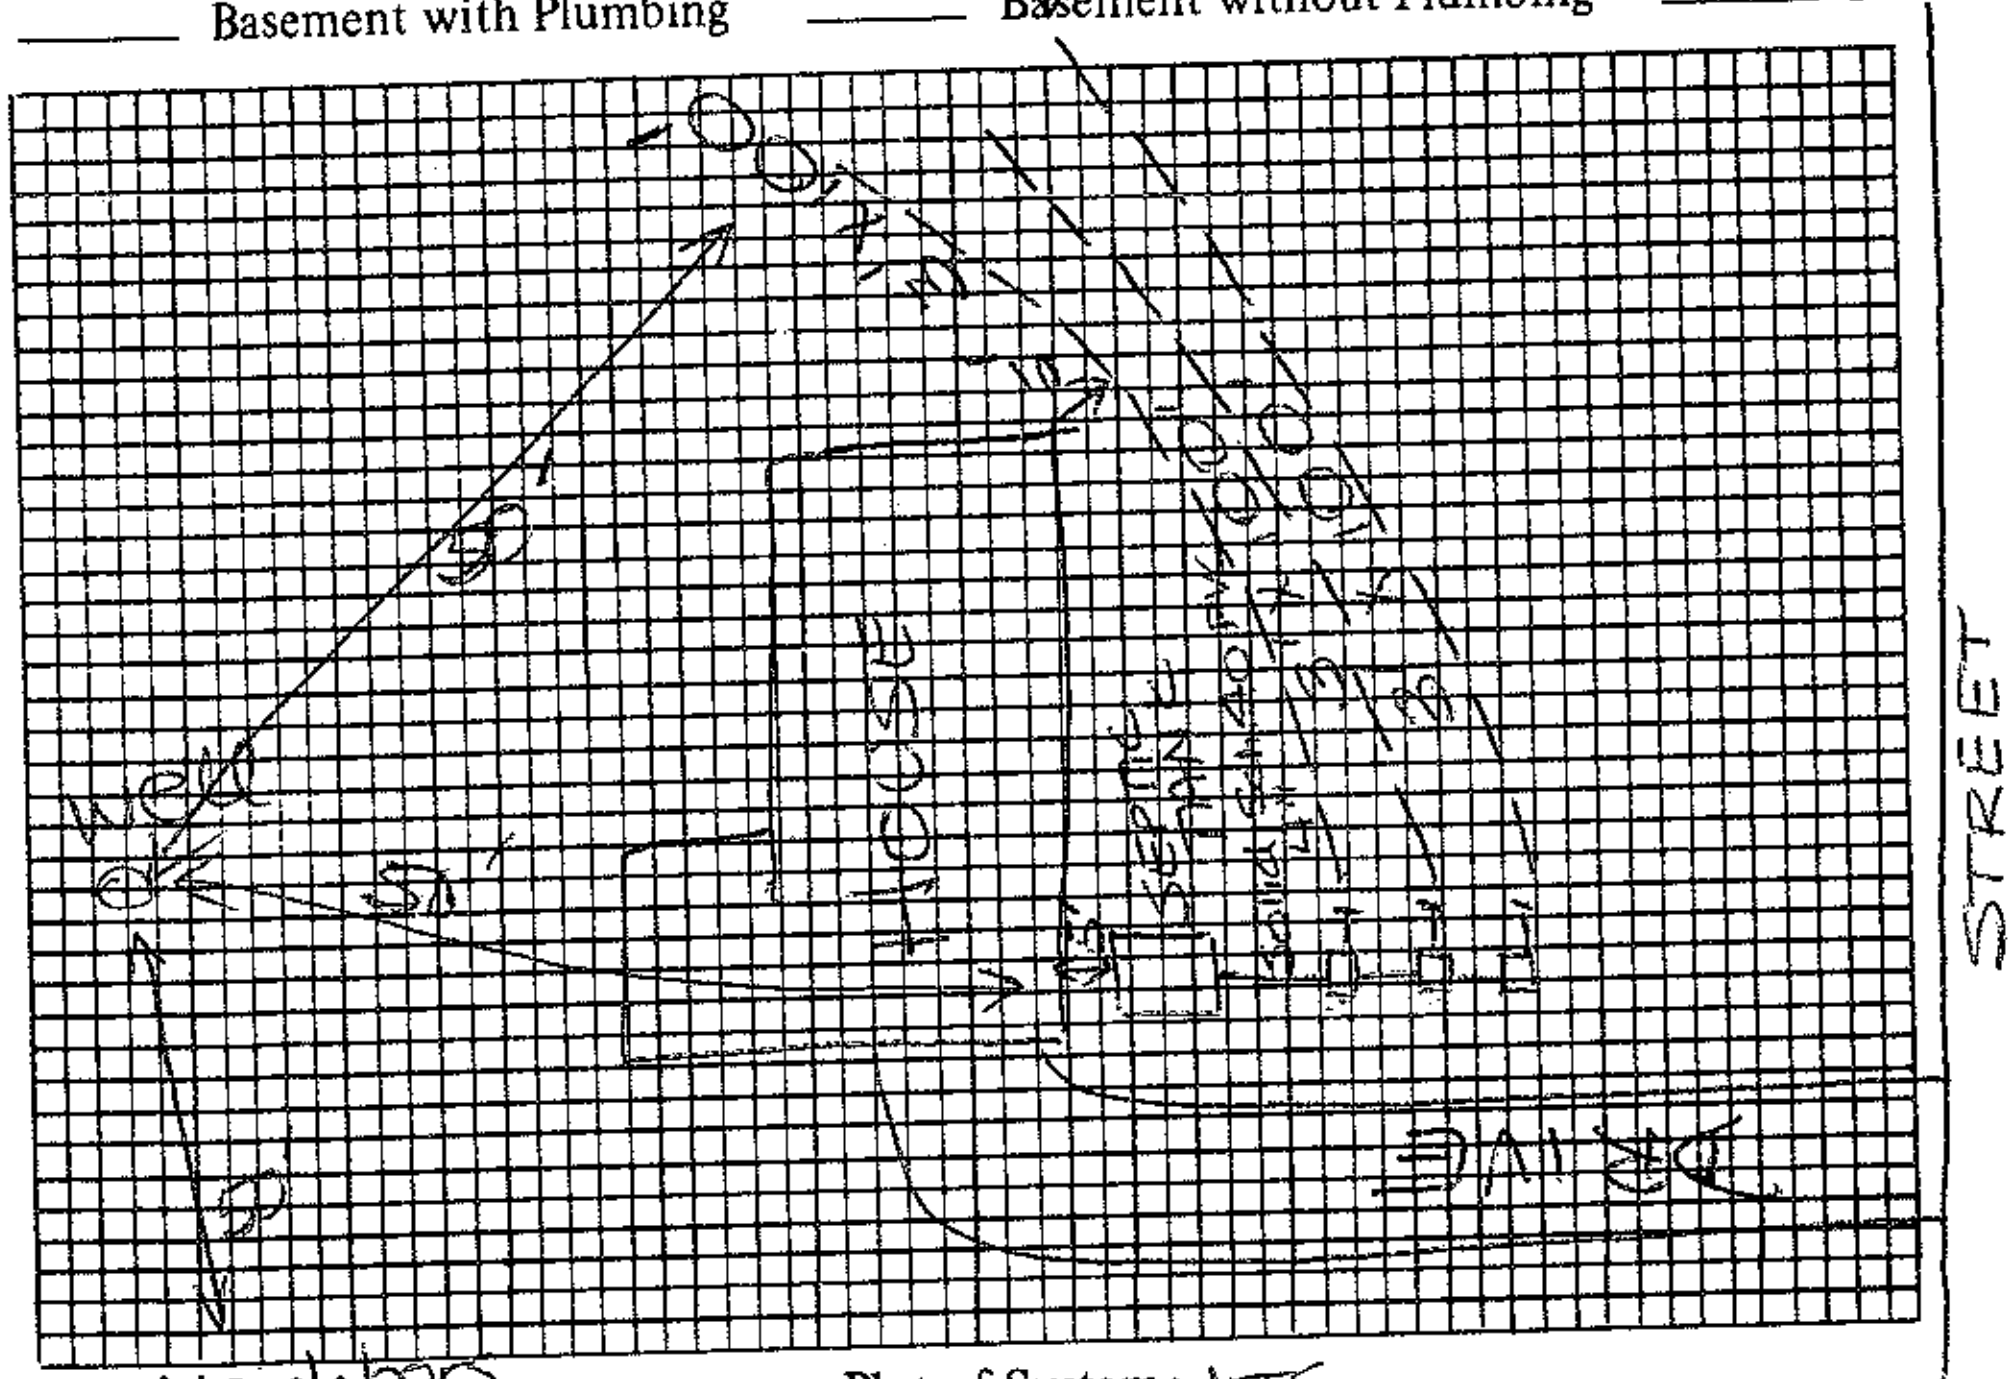

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. 900 Linear Ft. 300
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed Thomas E Poteat

Neighbors system

Plot of System N.T.S.

IMPROVEMENTS PERMIT BY Audie C. Price

COMMENTS: Set tank 5' off house foundation and do not pour sidewalk over tank. Run lines shallow and on contour. Use drop boxes to distribute effluent. And to maintain a shallow installation.

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold