1612

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Andy Smith DATE Jan. 16, '91 PERMIT NO. 1J33A1

PHONE: Business ______ Home ______

LOCATION South Broad St. TR Lowrance Ave TL Norman Dr. TR Club Dr. 1st lot on Right S. R. No. ______

SUBDIVISION NAME Wilton Forest LOT NO. 1 SECTION OR BLOCK NO. ______

House (✓) Mobile Home ( ) Business ( ) Other ______


No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes (✓) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes ( ) No ( )

Character & Porosity of Soil ps clay / trans
Percolation Rate ~.35
Topography ~15%
Depth to Water Table 4'+
Rock or other impervious formations NONE obs.

Lot Area 135'± x 190'±

✓ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

* 1250 pumptank

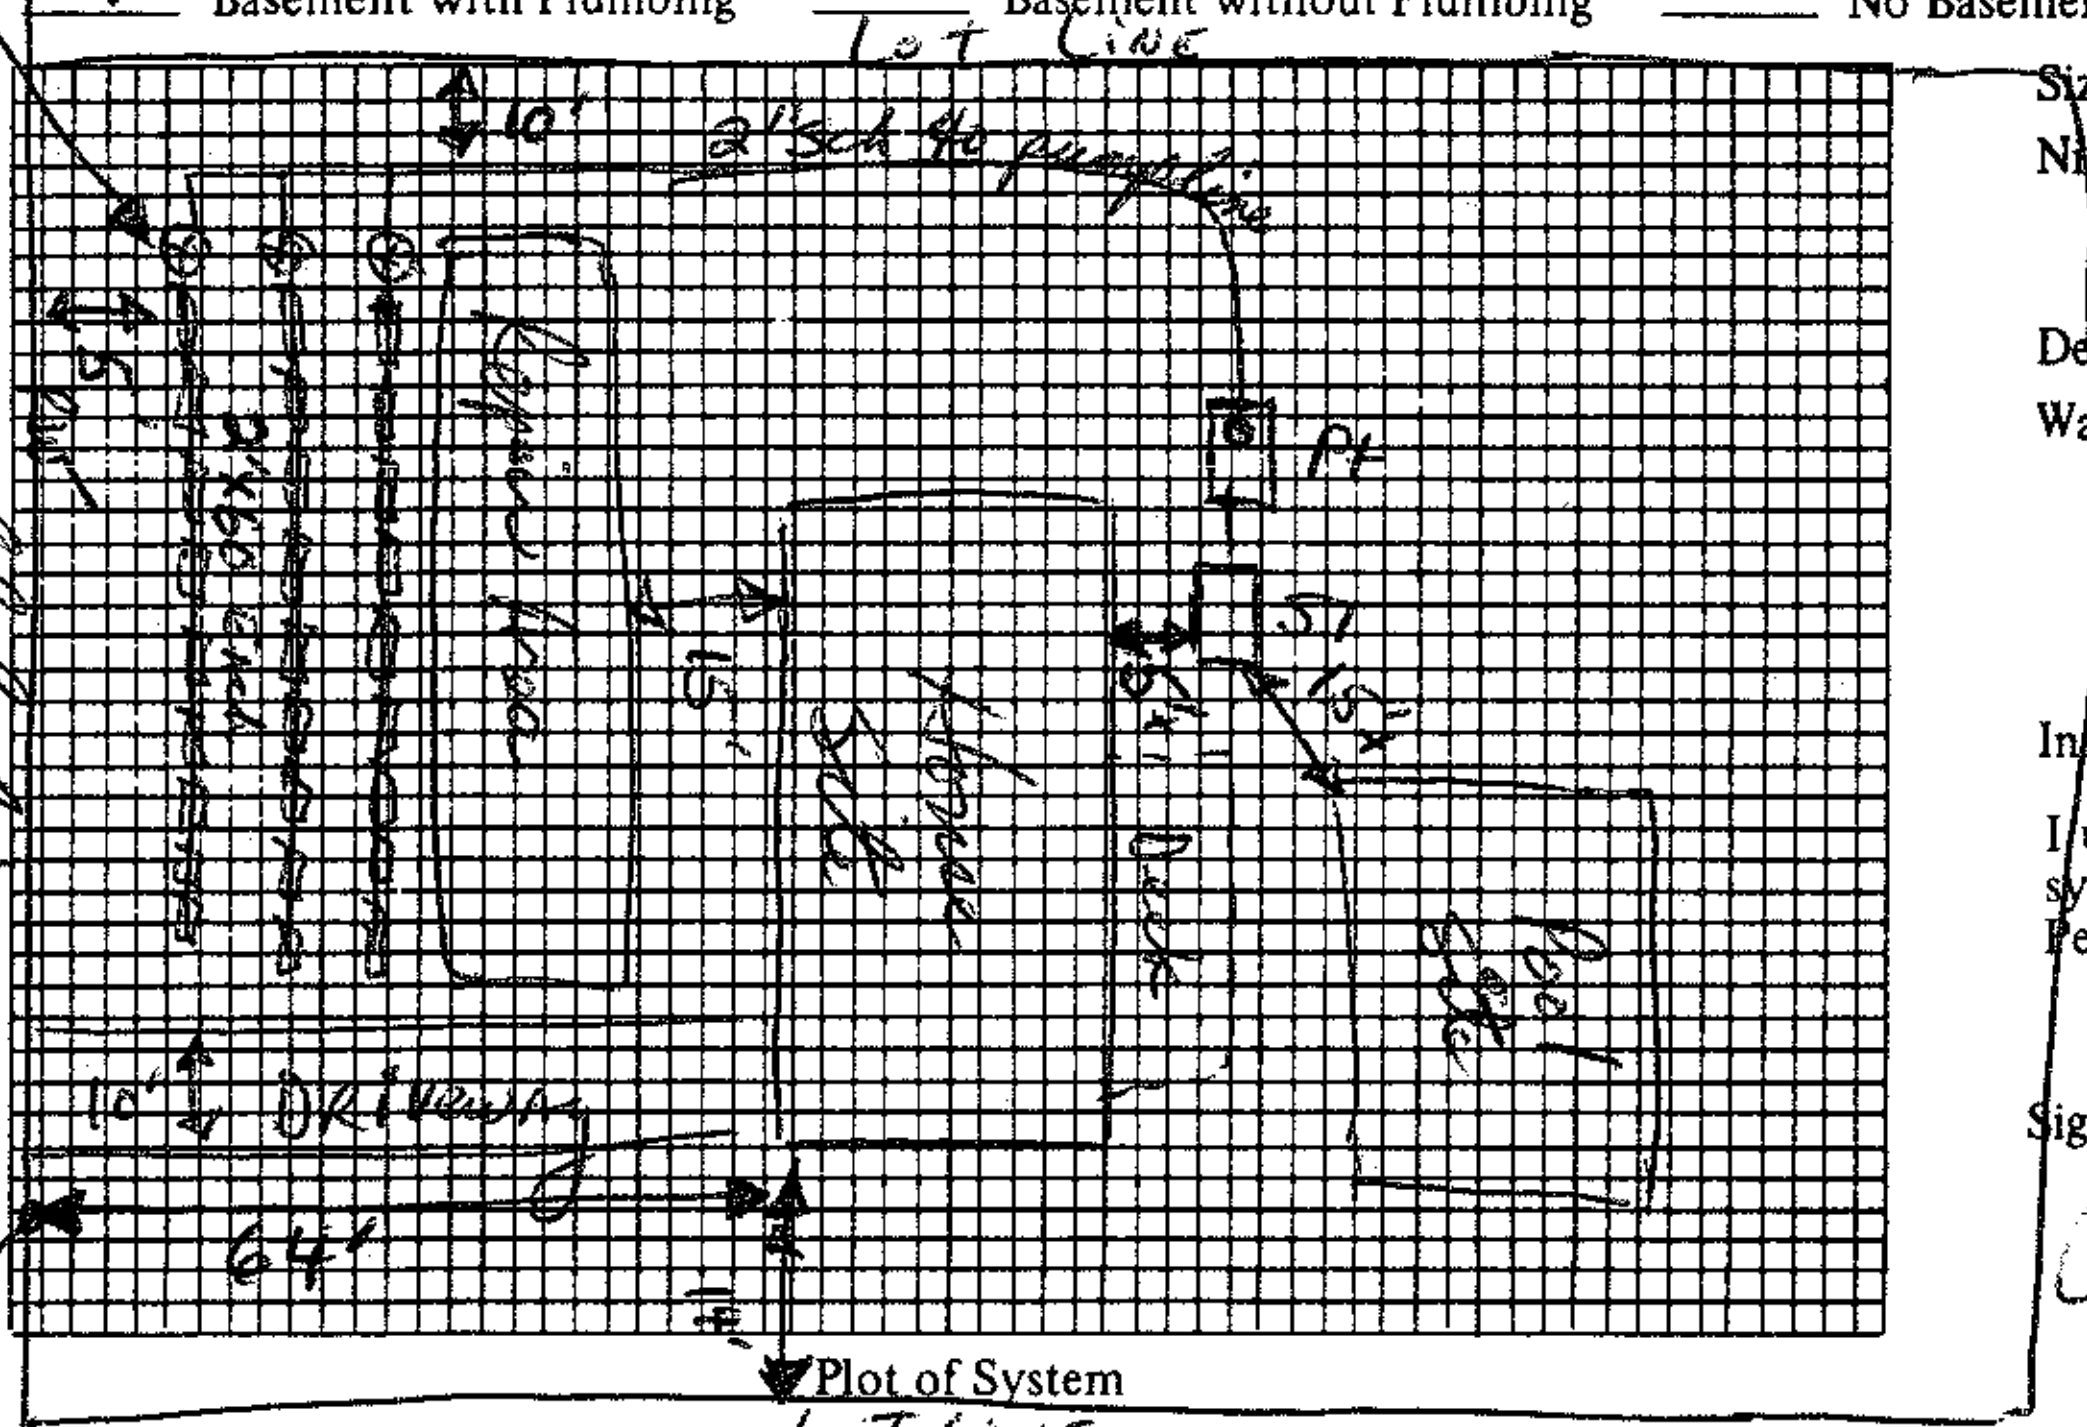

Plot of System

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. ______ Linear Ft. 180' of
Depth of Stone in Lines 16" ITJ
Water Supply: Individual ( )
Public (✓) panels pressure closed

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed X [signature]

Pump specs: 18 gpm. AT Approx. 26' TDH

IMPROVEMENTS PERMIT BY [signature], EHC

COMMENTS: 42 panels total in approx 3 ditches 2'x60' each. 30" max. trench bottom depth. ONE 5/32" per panel in 1¼" sch 40 laterals through each panel trench. House to be located setbacks of left side line and front lot corners as specified above. Grass over drainfield area.

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit. * If 1250 pump tank is not available, use next largest available size.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold