4656878282

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR George Gardness DATE 4-15-86 PERMIT NO. 180

PHONE: Business ______ Home ______

LOCATION S Mt. Main TL Brawley TL then TR on Ridge Ave.
525
S. R. No. ______

SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______


House ( ) Mobile Home (✓) Business ( ) Other ______

No. Bedrooms 2 No. Bathrooms 1

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil	clay
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	.3gal/ft2/day
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	2-10%
Site Suitable	Yes (✓)	No ( )	Depth to Water Table	4'
			Rock or other impervious formations	None obs

Lot Area 20,000ft2

______ Basement with Plumbing ______ Basement without Plumbing ✓ No Basement

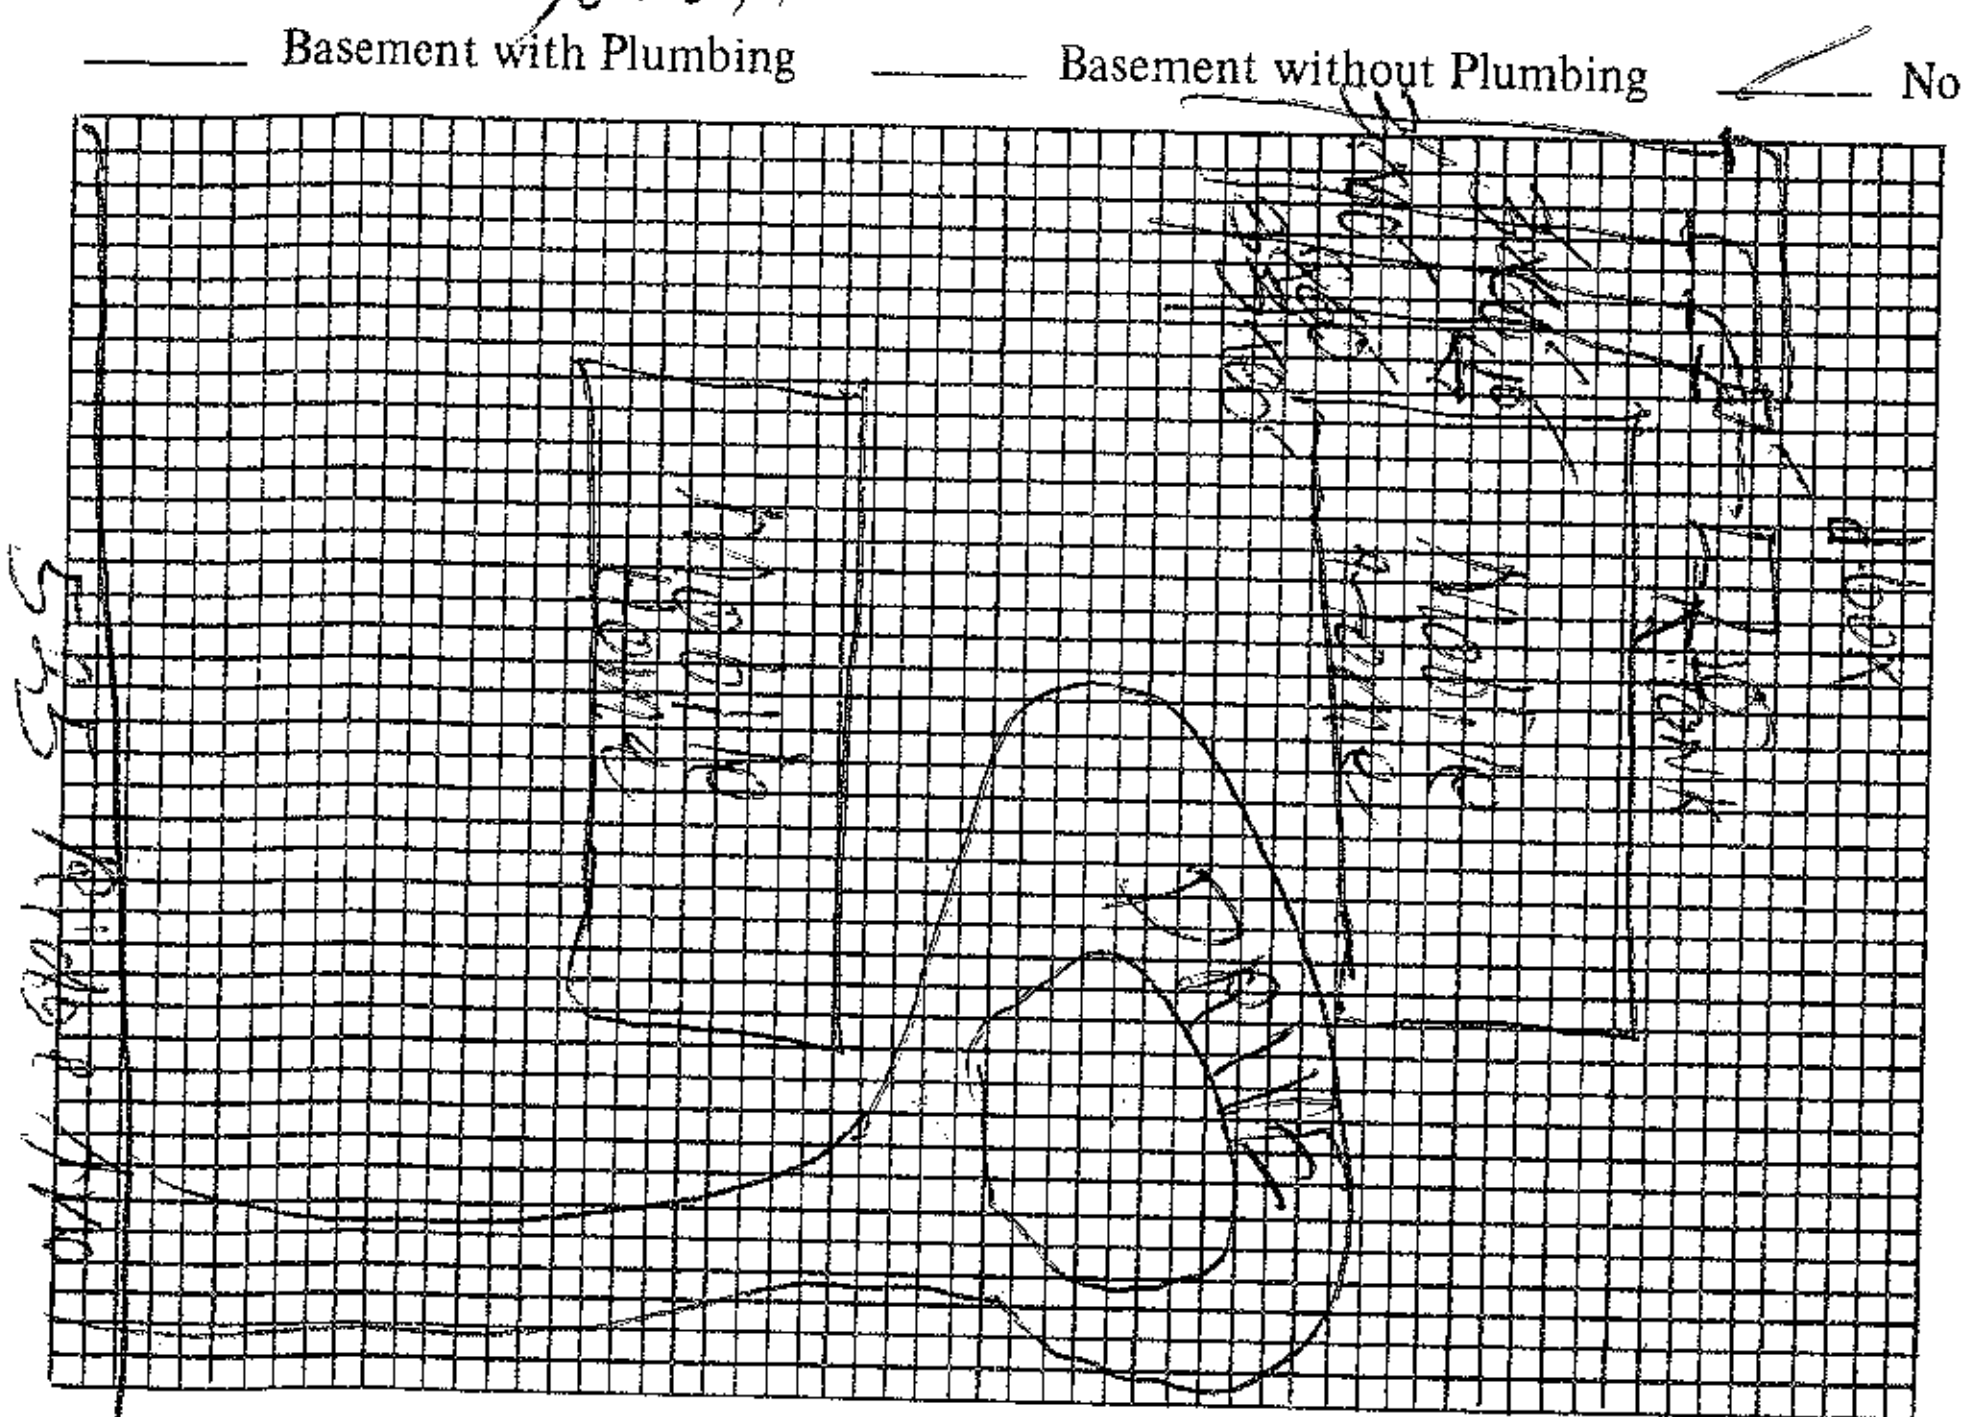

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 720 Linear Ft. 240
Depth of Stone in Lines 12"

Water Supply: Individual ( )
Public (✓) city water

Installed by Bridges

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY Charles K. Barnett

COMMENTS: ______

CERTIFICATE OF COMPLETION BY Charles K. Barnett DATE 4-15-86

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

4.00

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR George Gardners DATE 4-4-86 PERMIT NO. 137

PHONE: Business _____ Home _____

LOCATION N. Main TL Brawley TR TL then TR lot on left Ridge Ave 525

SUBDIVISION NAME _____ S. R. No. _____

LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 2 No. Bathrooms 1

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil Sl sy
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate 3 gal/ft2/day
Auto. Wash. Machine	Yes (✓)	No ( )	Topography 2 to 10%
Site Suitable	Yes (✓)	No ( )	Depth to Water Table 4'
			Rock or other impervious formations None obs

Lot Area _____

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement



Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 800 Linear Ft. 267
Depth of Stone in Lines 12"

Water Supply: Individual (✓) city water
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Danny S. King

IMPROVEMENTS PERMIT BY Charles T. Bryant

COMMENTS: keep system shallow and follow contour. ditches no more than 3' deep and keep on upper part of hill

CERTIFICATE OF COMPLETION BY _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS. DATE _____

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold