4657 22 2936

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Millard Arthur Corriher DATE 5/19/88 PERMIT NO. _____

PHONE: Business _____ Home 663-4702 b/f 2:00

LOCATION 21 South of 150 TR 1st Dry Dock Loop On left ~ 1/4 mile S. R. No. _____

SUBDIVISION NAME Lakeview Development LOT NO. 7&8 SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes	(✓)	No	( )	
Auto. Dishwasher	Yes	(✓)	No	( )	
Auto. Wash. Machine	Yes	(✓)	No	( )	
Site Suitable	Yes	(✓)	No	( )	

Character & Porosity of Soil clayey
Percolation Rate .35
Topography 2-4%
Depth to Water Table 4'+
Rock or other impervious formations none observed

Lot Area 20,000 ft²

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

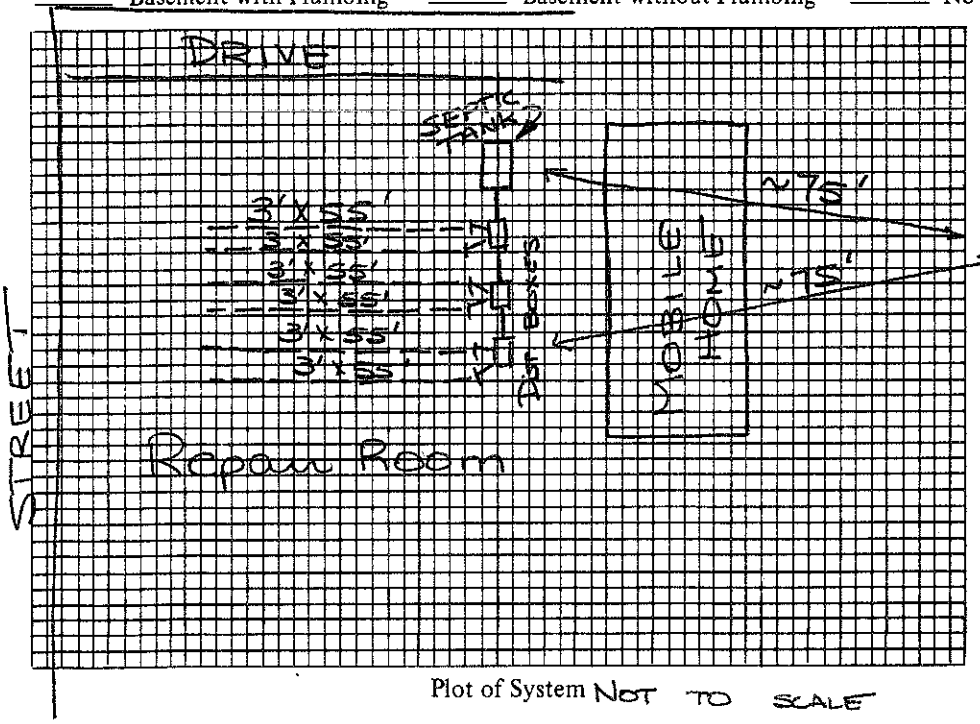

Plot of System NOT TO SCALE

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 6
Sq. Ft. 990 Linear Ft. 330
Depth of Stone in Lines 12"
Water Supply: Individual (X)
Public ( )

Installed by W. Potts

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY A.C.P.

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Andre C. Price DATE 5/19/88

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

Mooresville 0193

11:00

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Millard Arthur Corriher DATE 12/30/87 PERMIT NO.

PHONE: Business Home 663-4702 b/f 2:00

LOCATION 2/5 of 150 TR 1st Dry Dock Loop On left ~1/4 mile S. R. No.

SUBDIVISION NAME Lakeview Development LOT NO. 7 & 8 SECTION OR BLOCK NO.

House (✓) Mobile Home ( ) Business ( ) Other


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes	(✓)	No	( )	
Auto. Dishwasher	Yes	(✓)	No	( )	
Auto. Wash. Machine	Yes	(✓)	No	( )	
Site Suitable	Yes	(✓)	No	( )	

Character & Porosity of Soil Clayey
Percolation Rate ~.35
Topography 2-4%
Depth to Water Table 4'+
Rock or other impervious formations none observed

Lot Area 20000ft²+

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

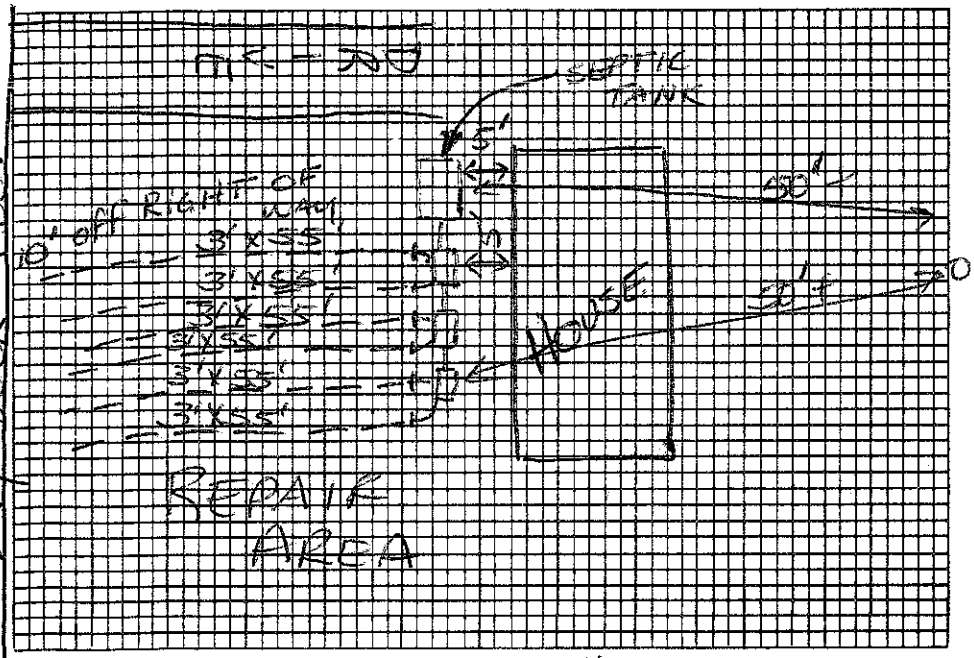

Plot of System NOT TO SCALE

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 6
Sq. Ft. 990 Linear Ft. 330
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Millard A. Corriher

IMPROVEMENTS PERMIT BY Andrew C. Queen

COMMENTS: KEEP TANK SHALLOW. RUN LINES ON CONTOUR AND SHALLOW (24" to bottom of ditch). USE 1 DISTRIBUTION BOX FOR 2 LINES.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold