1567

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Robert L. Justice DATE Oct. 15, '90 PERMIT NO. 1K-A-48

PHONE: Business ________ Home ________

LOCATION 150 W. TL on 21 S. 1st business on Right (behind Mooresville Electric Motor Service) S. R. No. ________

SUBDIVISION NAME ________ LOT NO. ________ SECTION OR BLOCK NO. ________


House ( ) Mobile Home ( ) Business (✓) Other Office bld. (one 5,000 ft² bld with office/storage (2, 2500 ft² offices total) 2 employees per office = 4 emp. total)

No. Bedrooms —— No. Bathrooms 2-4 (100 gal/day design flow)

Garbage Disposal Unit	Yes ( )	No (✓)	Character & Porosity of Soil: pebbly
Auto. Dishwasher	Yes ( )	No (✓)	Percolation Rate: ~.35
Auto. Wash. Machine	Yes ( )	No (✓)	Topography: 2%
~~Site Suitable~~ PS	Yes (✓)	No ( )	Depth to Water Table: 4'+
			Rock or other impervious formations: none obs.

Lot Area Existing (~3 Ac)

____ Basement with Plumbing ____ Basement without Plumbing ✓ No Basement

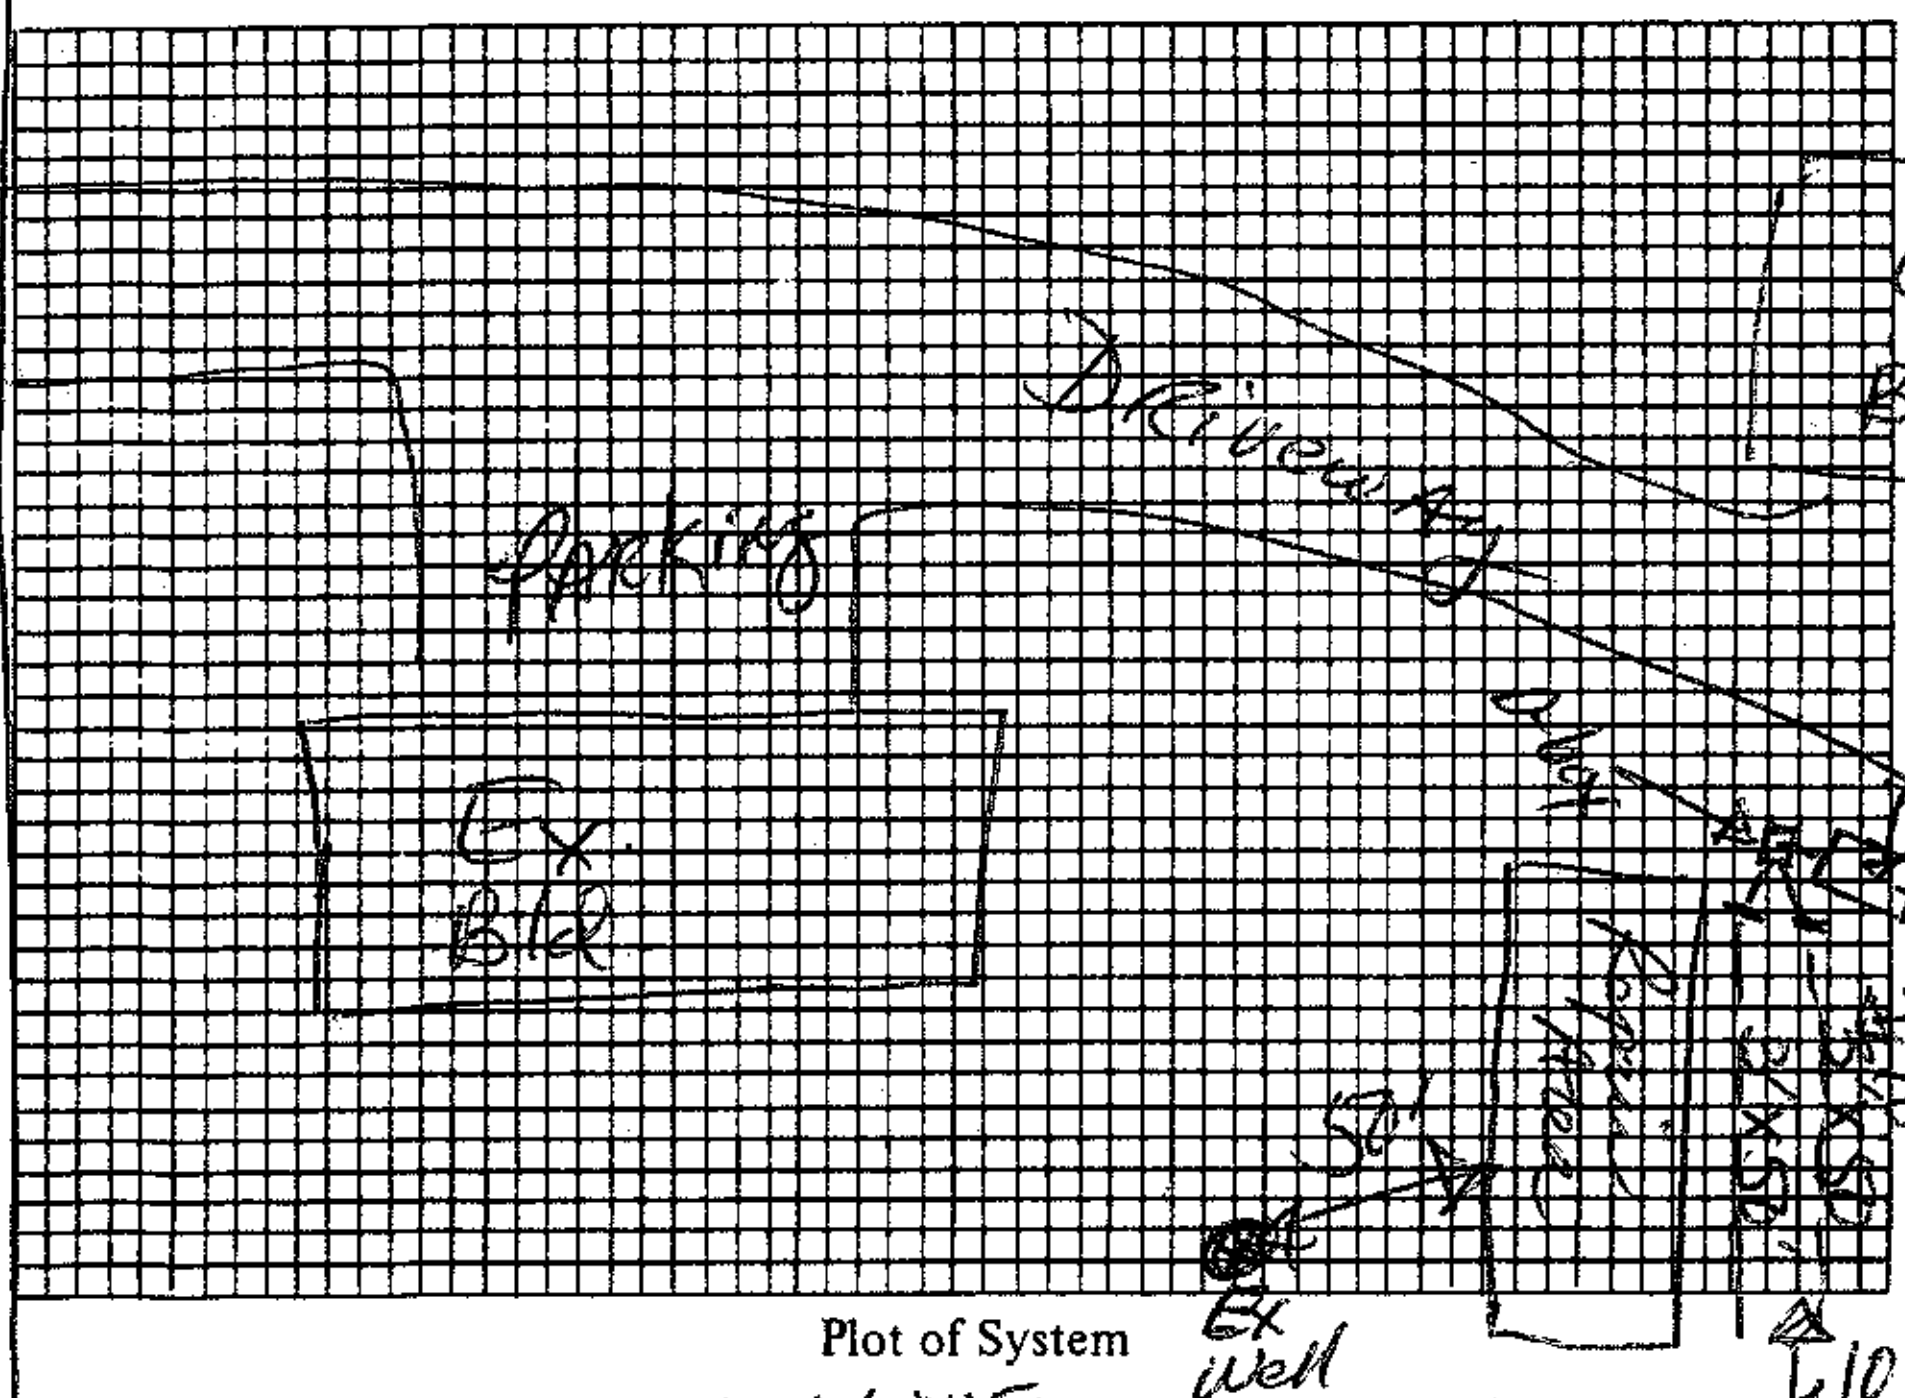

Size of Tank 1000 Gals.

Nitrification Field:

~~No. of Lines~~ 2

Sq. Ft. 300 Linear Ft. 100

Depth of Stone in Lines 12"

Water Supply: Individual (✓) Existing

Public ( )

Septic tank Installed by ________

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Robert L. Justice

Plot of System

IMPROVEMENTS PERMIT BY David R. Hinson, EHS

COMMENTS: Plumbing from new building must be "pulled out" at existing ground level and minimum fall used to septic tank and drainfield with nitrification trenches no deeper than 36" to trench bottom OR pumping will be required in order to install system at this depth.

CERTIFICATE OF COMPLETION BY ________ DATE ________

EXISTING SYSTEM CHECKED BY: ________ DATE ________

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold