DEPARTMENT OF HUMAN RESOURCES
DIVISION OF HEALTH SERVICES

SITE/SOIL EVALUATION FOR SANITARY SEWAGE SYSTEM

(Frank Burke Builders

OWNER: Correa PHONE: _____ DATE REQUESTED: _____ DATE EVALUATED: 9/1/94

ADDRESS: _____ PROPERTY IDENTIFICATION NO.: _____

COUNTY: _____ PROPERTY SIZE: ~ 2AC PROPOSED FACILITY: 3BD - 2BA

LOCATION OF SITE: Tower Rd off Runehart.

WATER SUPPLY: On-Site Well____ Community____ Public____ EVALUATION BY: Auger Boring____ Pit____ Cut____

FACTORS	PROFILE 1	2	PROFILE 3	4	PROFILE 5	6	PROFILE 7	8	PROFILE 9	10
LANDSCAPE POSITION	S									
SLOPE(%)	4-6%									
HORIZON I DEPTH	0-5									
Texture Group	l									
Consistence	S SP FR									
Structure	sbk									
Mineralogy	MIX									
HORIZON II DEPTH	6-23									
Texture Group	SL C									
Consistence	P S FR									
Structure	wk									
Mineralogy	MIX									
HORIZON III DEPTH	24-42									
Texture Group	SL C L									
Consistence	S SP FR									
Structure	MIX-TR									
Mineralogy	MIXED									
HORIZON IV DEPTH	43-									
Texture Group	C TRANS									
Consistence	P-S									
Structure	GR									
Mineralogy	1:1									
SOIL WETNESS	P									
RESTRICTIVE HORIZON	P									
SAPROLITE	P									
CLASSIFICATION	P									
LONG-TERM ACCEPTANCE RATE	(.3) 30"									

SITE CLASSIFICATION: P SITE LONG-TERM ACCEPTANCE RATE: 30" TRENCH DEPTH

EVALUATED BY: OTHER(S) PRESENT:

REMARKS:

House needs to go upslope and more toward (L) side line

Keep shallow going slightly against slope

See back

LEGEND

LANDSCAPE POSITION
R - Ridge
S - Shoulder slope
L - Linear slope
FS - Foot Slope
N - Nose slope
H - Head slope
Cc - Concave slope
Cv - Convex slope
T - Terrace
FP - Flood Plain

TEXTURE
s - sand
ls - loamy sand
sl - sandy loam
l - loam
si - silt
sil - silt loam
sicl - silty clay loam
cl - clay loam
scl - sandy clay loam
sc - sandy clay
sic - silty clay
c - clay

CONSISTENCE
Moist
vfr - very friable
fr - friable
fi - firm
vfi - very firm
efi - extremely firm

Wet
Ns - non-sticky
Ss - slightly sticky
S - sticky
Vs - very sticky

Wp - non-plastic
Sp - slightly plastic
P - plastic
Vp - very plastic

STRUCTURE
sg - single grain
m - massive
cr - crumb
gr - granular
sbk - subangular blocky
abk - angular blocky
pl - platy
pr - prismatic

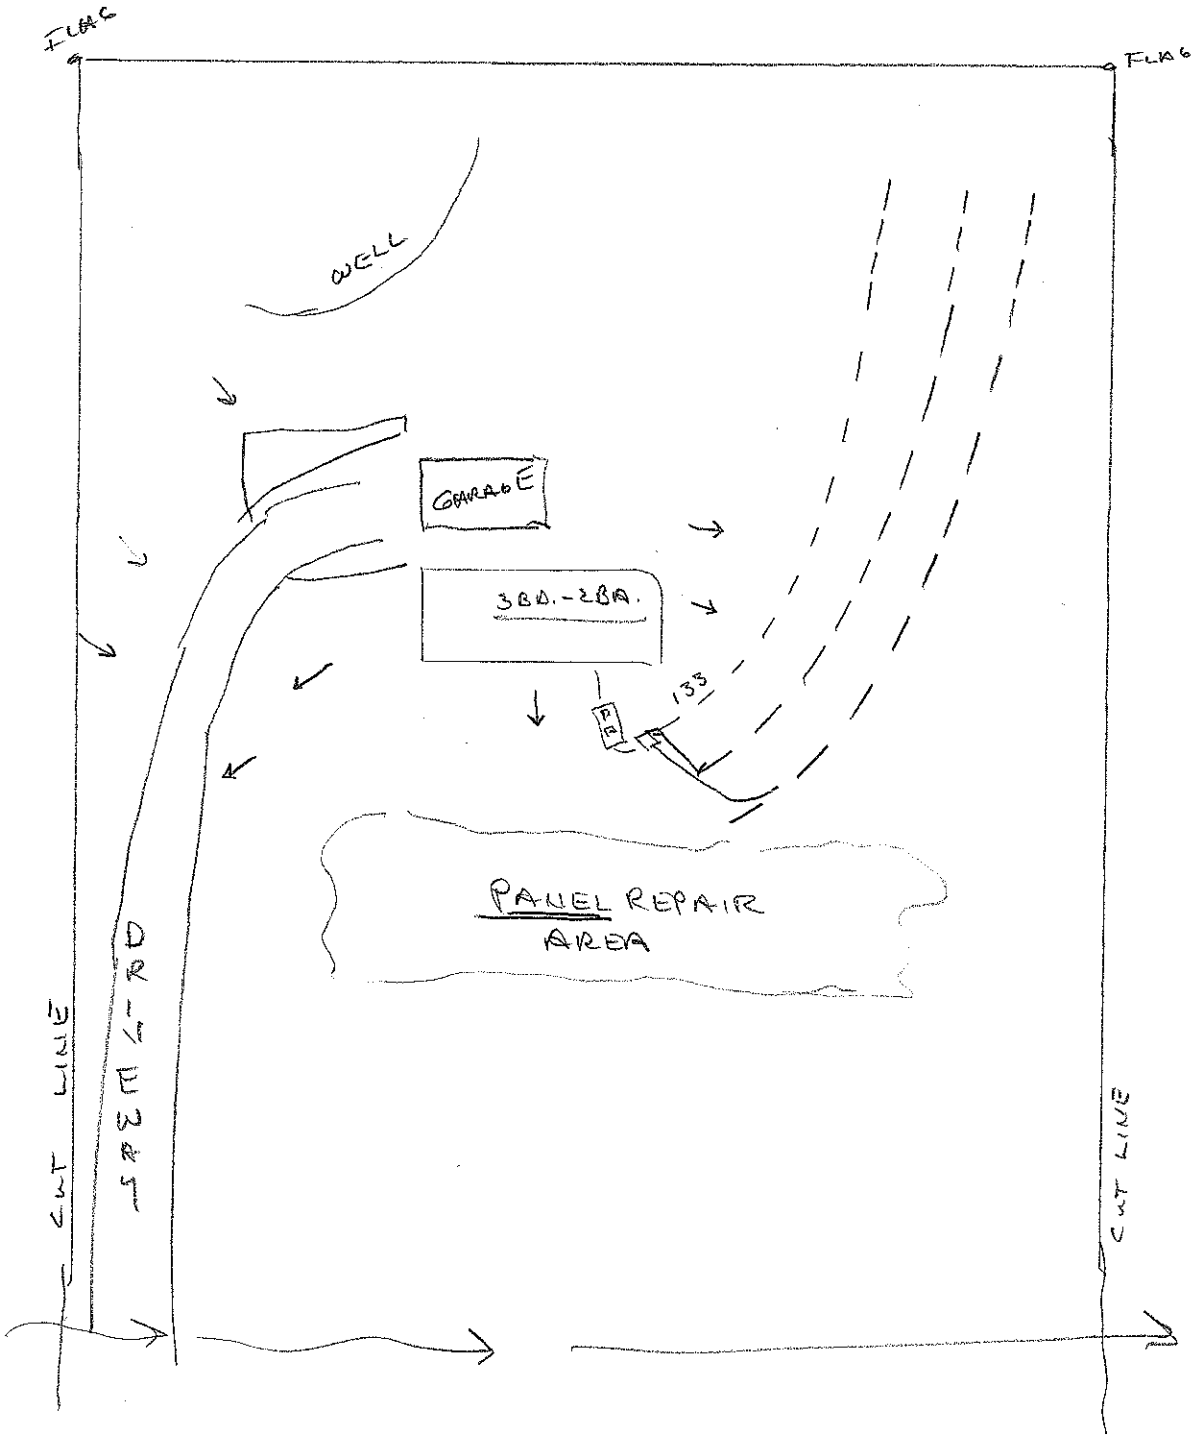
MINERALOGY
1:1, 2:1, mixed

Use the above standard abbreviations.

NOTES:
Horizon Depth --in inches
Depth of fill --in inches from land surface
Restrictive Horizon--thickness and inches from land surface
Saprolite --S (suitable) or U (unsuitable)

NOTES:
Soil Wetness --inches from land surface to free water or inches from land surface to soil colors with chroma 2 or less--record Munsell color chip designation
Classification--S (suitable), PS (provisionally suitable) or U (unsuitable)
Long-Term Acceptance Rate--gal/day/ft²

DHS 2601 (Revised)


FLAG
FLAG
WELL
GARAGE
3BD.-2BA.
133'
PANEL REPAIR
AREA
DRIVEWAY
CUT LINE
CUT LINE