4657781989

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Larry Warren DATE 4-18-85 PERMIT NO. 156

PHONE: Business ______ Home ______

LOCATION 150 TR Plaza Drive TL 1306 (Rhinehardt Rd)
3/4 mile on left just past Roger Garage S. R. No. ______


SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______

House (X) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes ( ) No (X)
Auto. Dishwasher Yes ( ) No (X)
Auto. Wash. Machine Yes (X) No ( )
Site Suitable Yes (X) No ( )
Lot Area 20,000 ft

Character & Porosity of Soil Clay loam
Percolation Rate .3 gal/ft²/day
Topography 2-8%
Depth to Water Table 4'
Rock or other impervious formations none observed

______ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

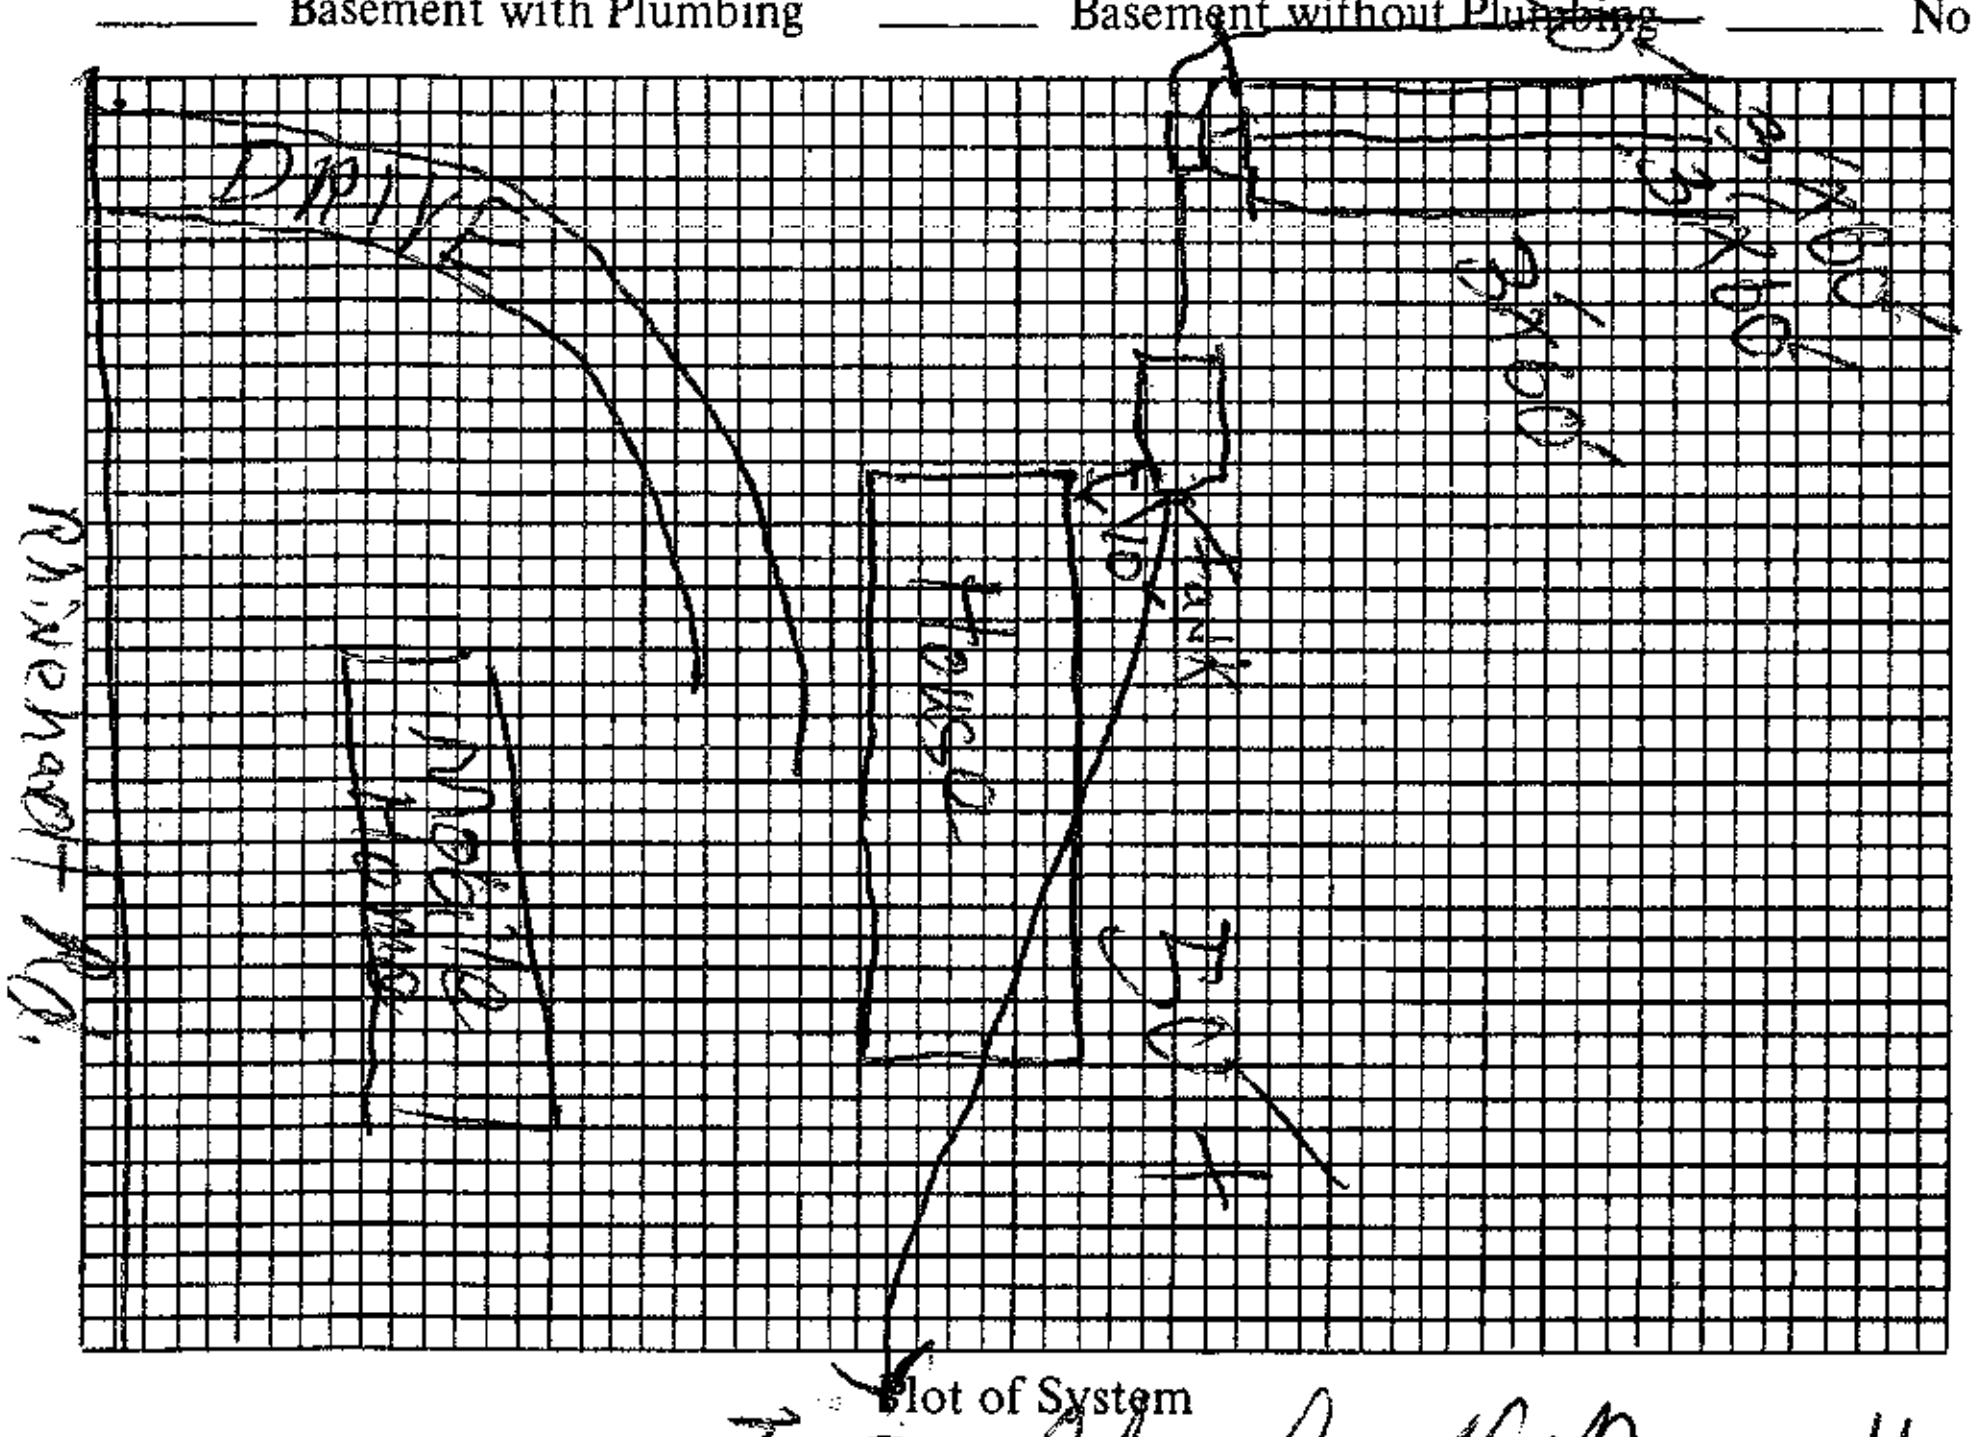

Plot of System

Size of Tank 1000 Gals.
Nitrification Field: 4
No. of Lines 4
Sq. Ft. 720 Linear Ft. 240
Depth of Stone in Lines 12"
Water Supply: Individual (X)
Public ( )

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY Charles K. Barnett & Ronnie Bradley

COMMENTS: the trenches are little too deep ~2' instead of 18" but soil look good enought to go that deep

CERTIFICATE OF COMPLETION BY Charles K. Barnett DATE 4-18-85

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

IREDELL COUNTY HEALTH DEPARTMENT

2:00

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Larry Warren DATE 7-10-84 PERMIT NO. 185

PHONE: Business _____ Home _____

LOCATION 150 W TR Plaza Drive. TL 1306 (Rhinehard Drive) 3/4 mile on Left just past Roger Garage

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____ S. R. No. _____


House (X) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (X)
Auto. Dishwasher	Yes ( )	No (X)
Auto. Wash. Machine	Yes (X)	No ( )
Site Suitable	Yes (X)	No ( )

Lot Area 20,000 ft² +

Character & Porosity of Soil clay loam
Percolation Rate .5 gal/ft²/day
Topography 2-8% slope
Depth to Water Table 4
Rock or other impervious formations none observed

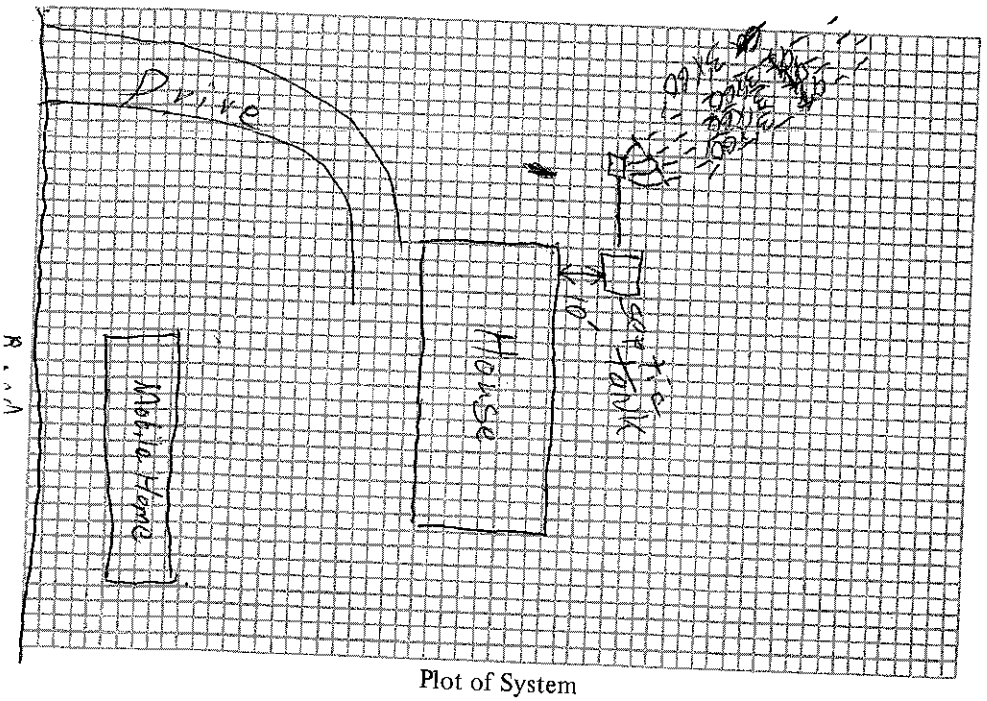

Plot of System

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 4
Sq. Ft. 720 Linear Ft. 240
Depth of Stone in Lines 12"
Water Supply: Individual (X)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Larry Warren

IMPROVEMENTS PERMIT BY Charles K. Barnett & Hayes Old

COMMENTS: keep trenches shallow no more than 18 inches deep

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold