4657 80 0716

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR MARSHALL CROUCH DATE 6/26/88 PERMIT NO. _____

PHONE: Business _____ Home 664-4291

LOCATION S. ON Broad St. TR Wilson Ave. TL Alexander ~ 3RD LOT ON LEFT S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____


House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms _____ No. Bathrooms _____
Garbage Disposal Unit Yes ( ) No (X)
Auto. Dishwasher Yes (X) No ( )
Auto. Wash. Machine Yes (X) No ( )
Site Suitable Yes (X) No ( )

Character & Porosity of Soil Clayey
Percolation Rate ~4
Topography 2-6%
Depth to Water Table 4'+
Rock or other impervious formations none obs.

Lot Area 80x200

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

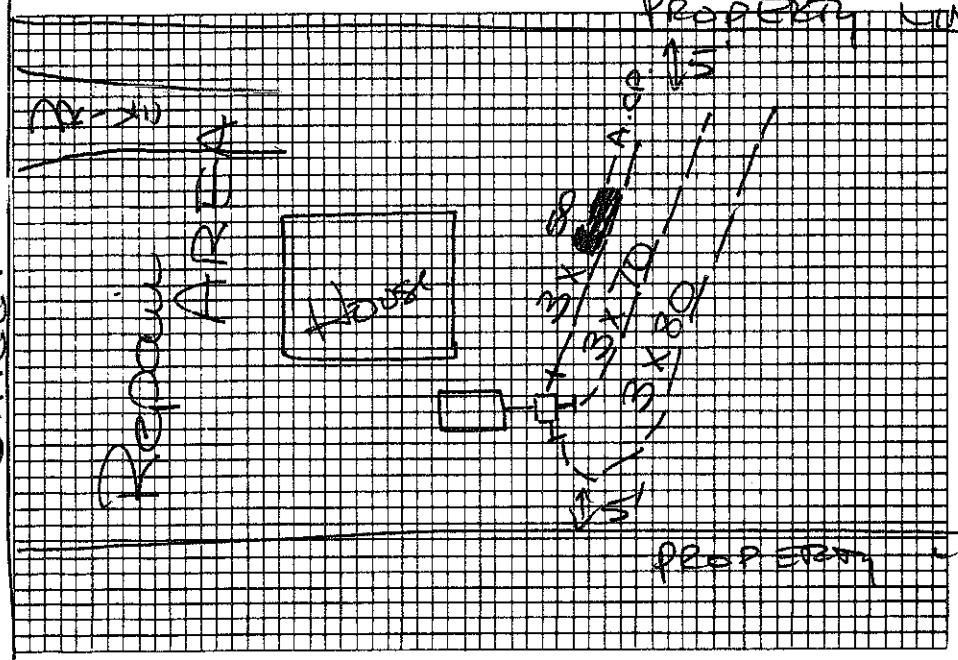

Plot of System NTS

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 3
Sq. Ft. 600 Linear Ft. 200
Depth of Stone in Lines 12"
Water Supply: Individual ( )
Public (X)
Mooresville

Installed by Julian Boulos

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY Andrew C. Price

COMMENTS: Sptem is shallow as indicated. Good job.

CERTIFICATE OF COMPLETION BY Andrew C. Price DATE 6/29/88

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

MOORESVILLE 795

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR MARSHALL CROUCH DATE 1/5/88 PERMIT NO. _____

PHONE: Business _____ Home 664-4291

LOCATION S. ON BROAD STREET TR WILSON AVE TL ALEXANDER; 3RD LOT ON LEFT S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 2 No. Bathrooms 1

Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes (✓)	No ( )	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable	Yes (✓)	No ( )	

Lot Area 8000 ft²

Character & Porosity of Soil Clayey
Percolation Rate ~.4 gpd/ft²
Topography 2-6%
Depth to Water Table 4'+
Rock or other impervious formations none observed

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

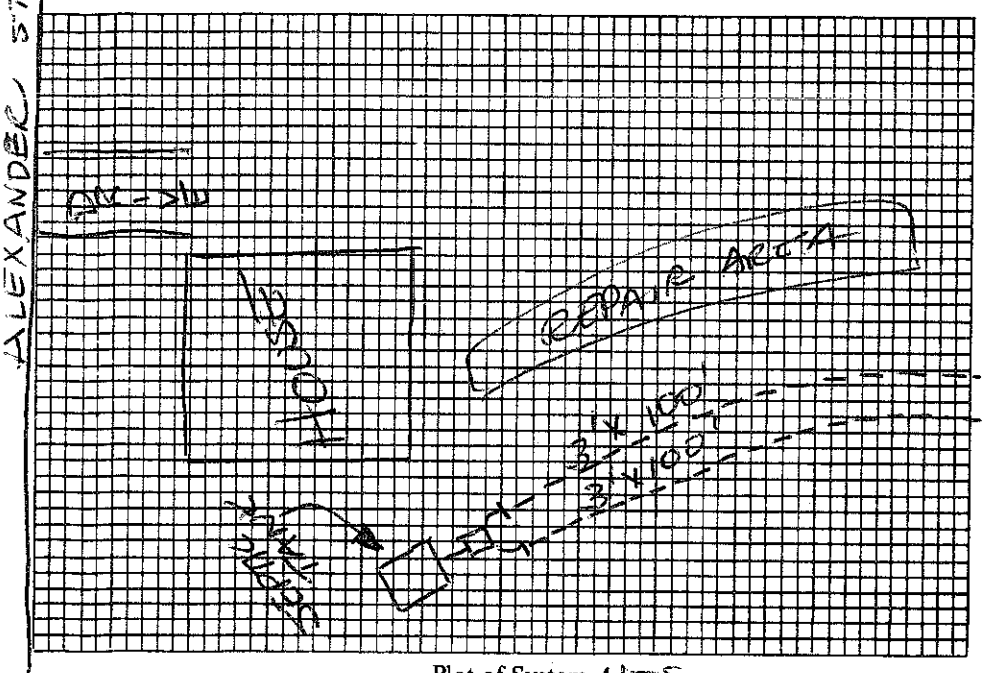

Plot of System NTS

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 2 (-3)
Sq. Ft. 600 Linear Ft. 200
Depth of Stone in Lines 12"
Water Supply: Individual ( )
Public (✓)
MOORESVILLE H2O

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: X M Crouch

IMPROVEMENTS PERMIT BY Andrea C. Quinn

COMMENTS: INSTALL TANK UPHILL AS MUCH AS POSSIBLE. SHALLOW INSTALLATION. RUN LINES (SHALLOW 30" to BOTTOM OF DITCH) ON CONTOUR! MAY USE 3 LINES (IF) NECESSARY

CERTIFICATE OF COMPLETION BY 6/14/88 System may go in ~~front~~. ACQ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold