4.30

# IREDELL COUNTY HEALTH DEPARTMENT

## (SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Donald Wilkinson Jr. DATE 9-12-84 PERMIT NO. 389

PHONE: Business ______ Home ______

LOCATION Turn on Rhinehardt Rd (near Burger King) ~ 1 mile on Rt. ~200' off road S. R. No. ______

SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

Site Suitable Yes (✓) No ( )

Lot Area 20000 ft² +

Character & Porosity of Soil clay


Percolation Rate .4

Topography 10-15%

Depth to Water Table 4' +

Rock or other impervious formations none obs.

✓ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

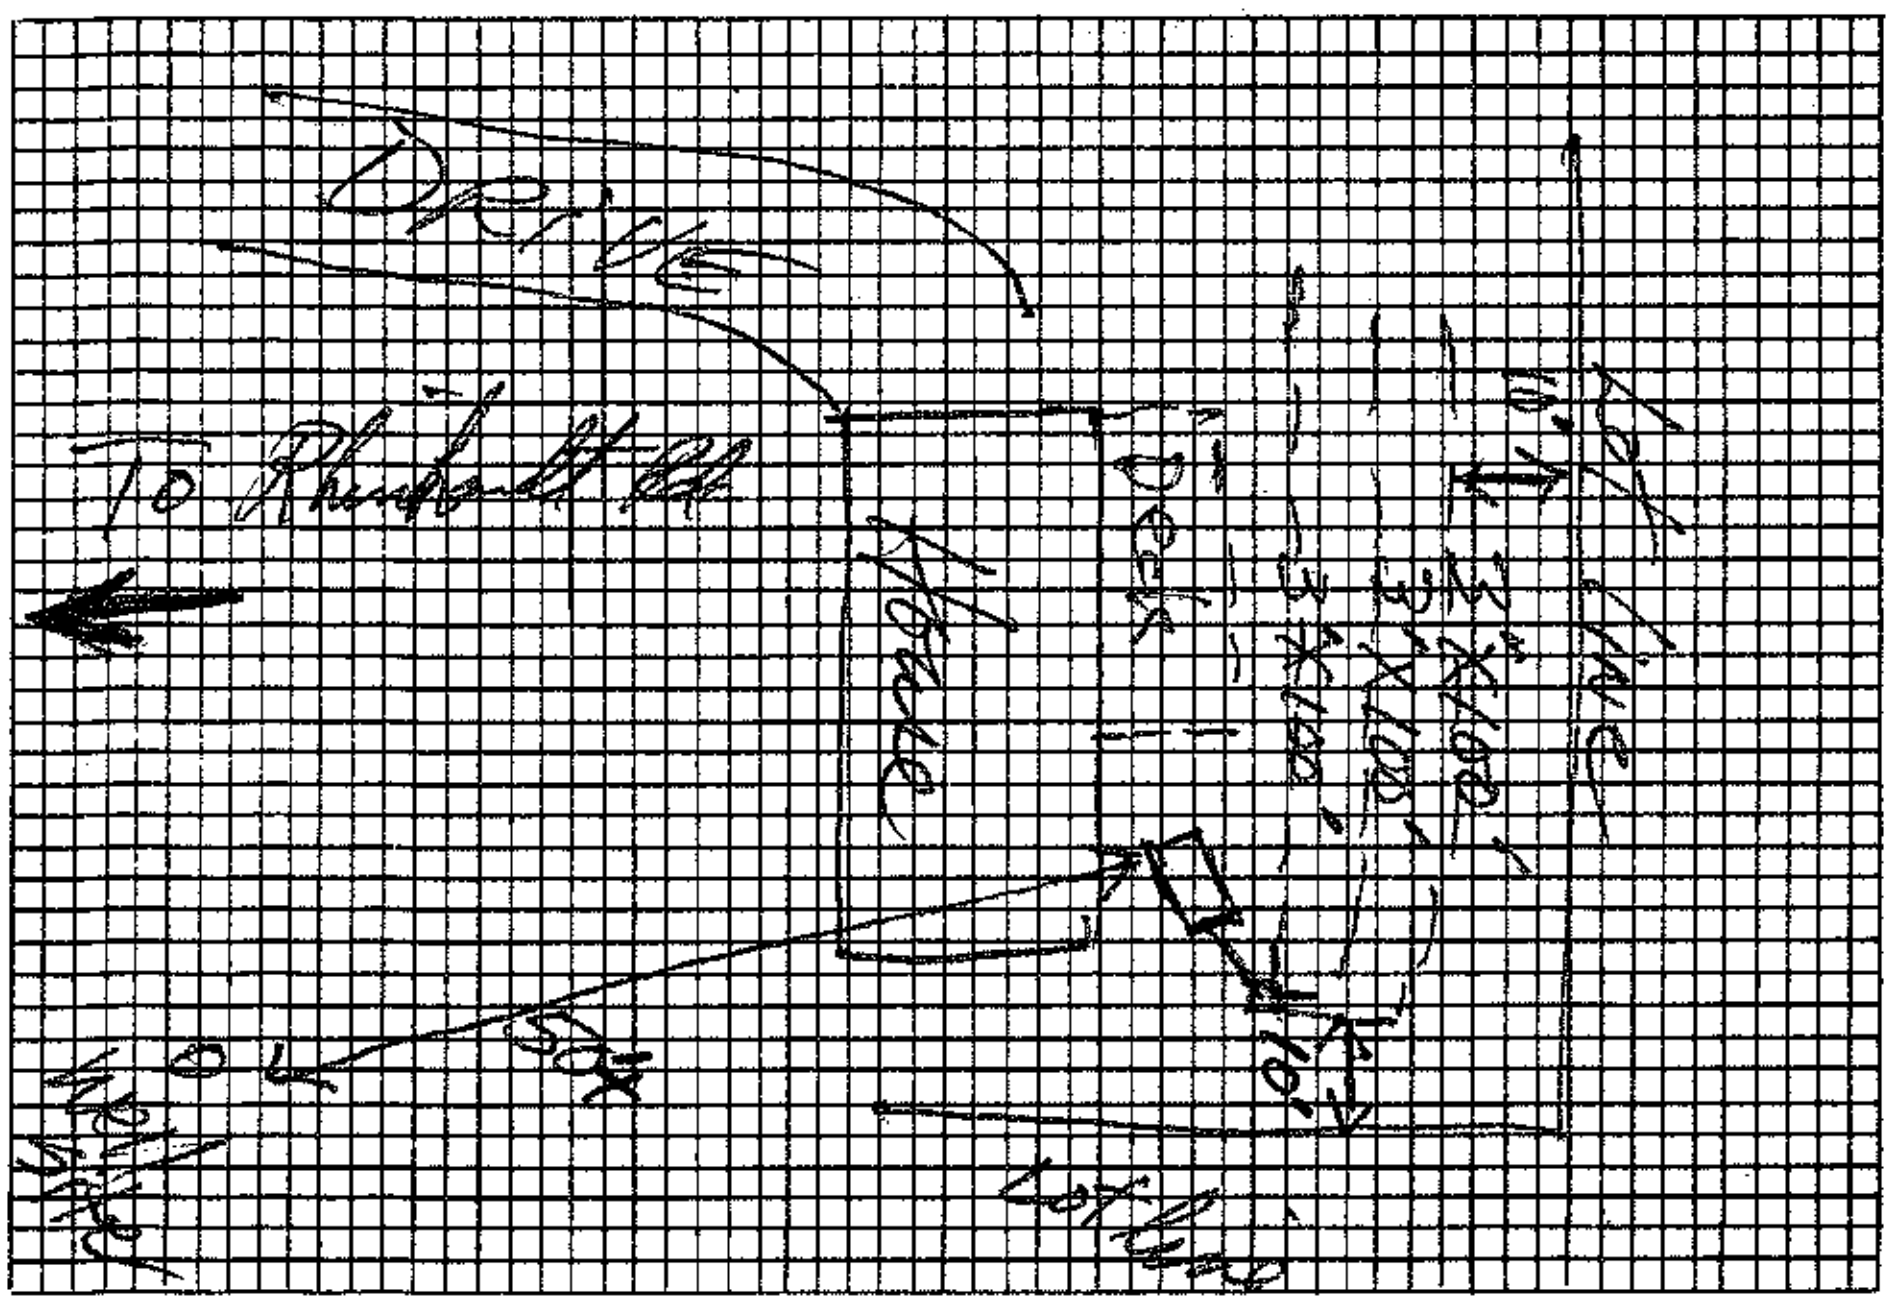


Plot of System

Size of Tank 1600 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 900 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Don Wilkinson Jr.

IMPROVEMENTS PERMIT BY David R. Hinson, R.S.

COMMENTS: Keep system as shallow as possible (12-18" cover)

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold