Pin 4658315349 2314 Charlotte Hwy
Countryside Estate
Lot 7

09125

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Carlyle Gandy DATE April 24 89 PERMIT NO. ______

PHONE: Business ______ Home ______

LOCATION Hwy 21 N. on left ~ ½ - 1 mile before jct. with SR 1302 (Cornelius Rd) S. R. No. ______

SUBDIVISION NAME Countryside Estates LOT NO. 7 SECTION OR BLOCK NO. ______

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 1½

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes (✓) No ( )

Auto. Wash. Machine Yes (✓) No ( )

~~Site Suitable~~ PS Yes (✓) No ( )

Lot Area ~35000 ft²

Character & Porosity of Soil clay


Percolation Rate ~.4

Topography 2-6%

Depth to Water Table 44"

Rock or other impervious formations none obs.

______ Basement with Plumbing ______ Basement without Plumbing ✓ No Basement

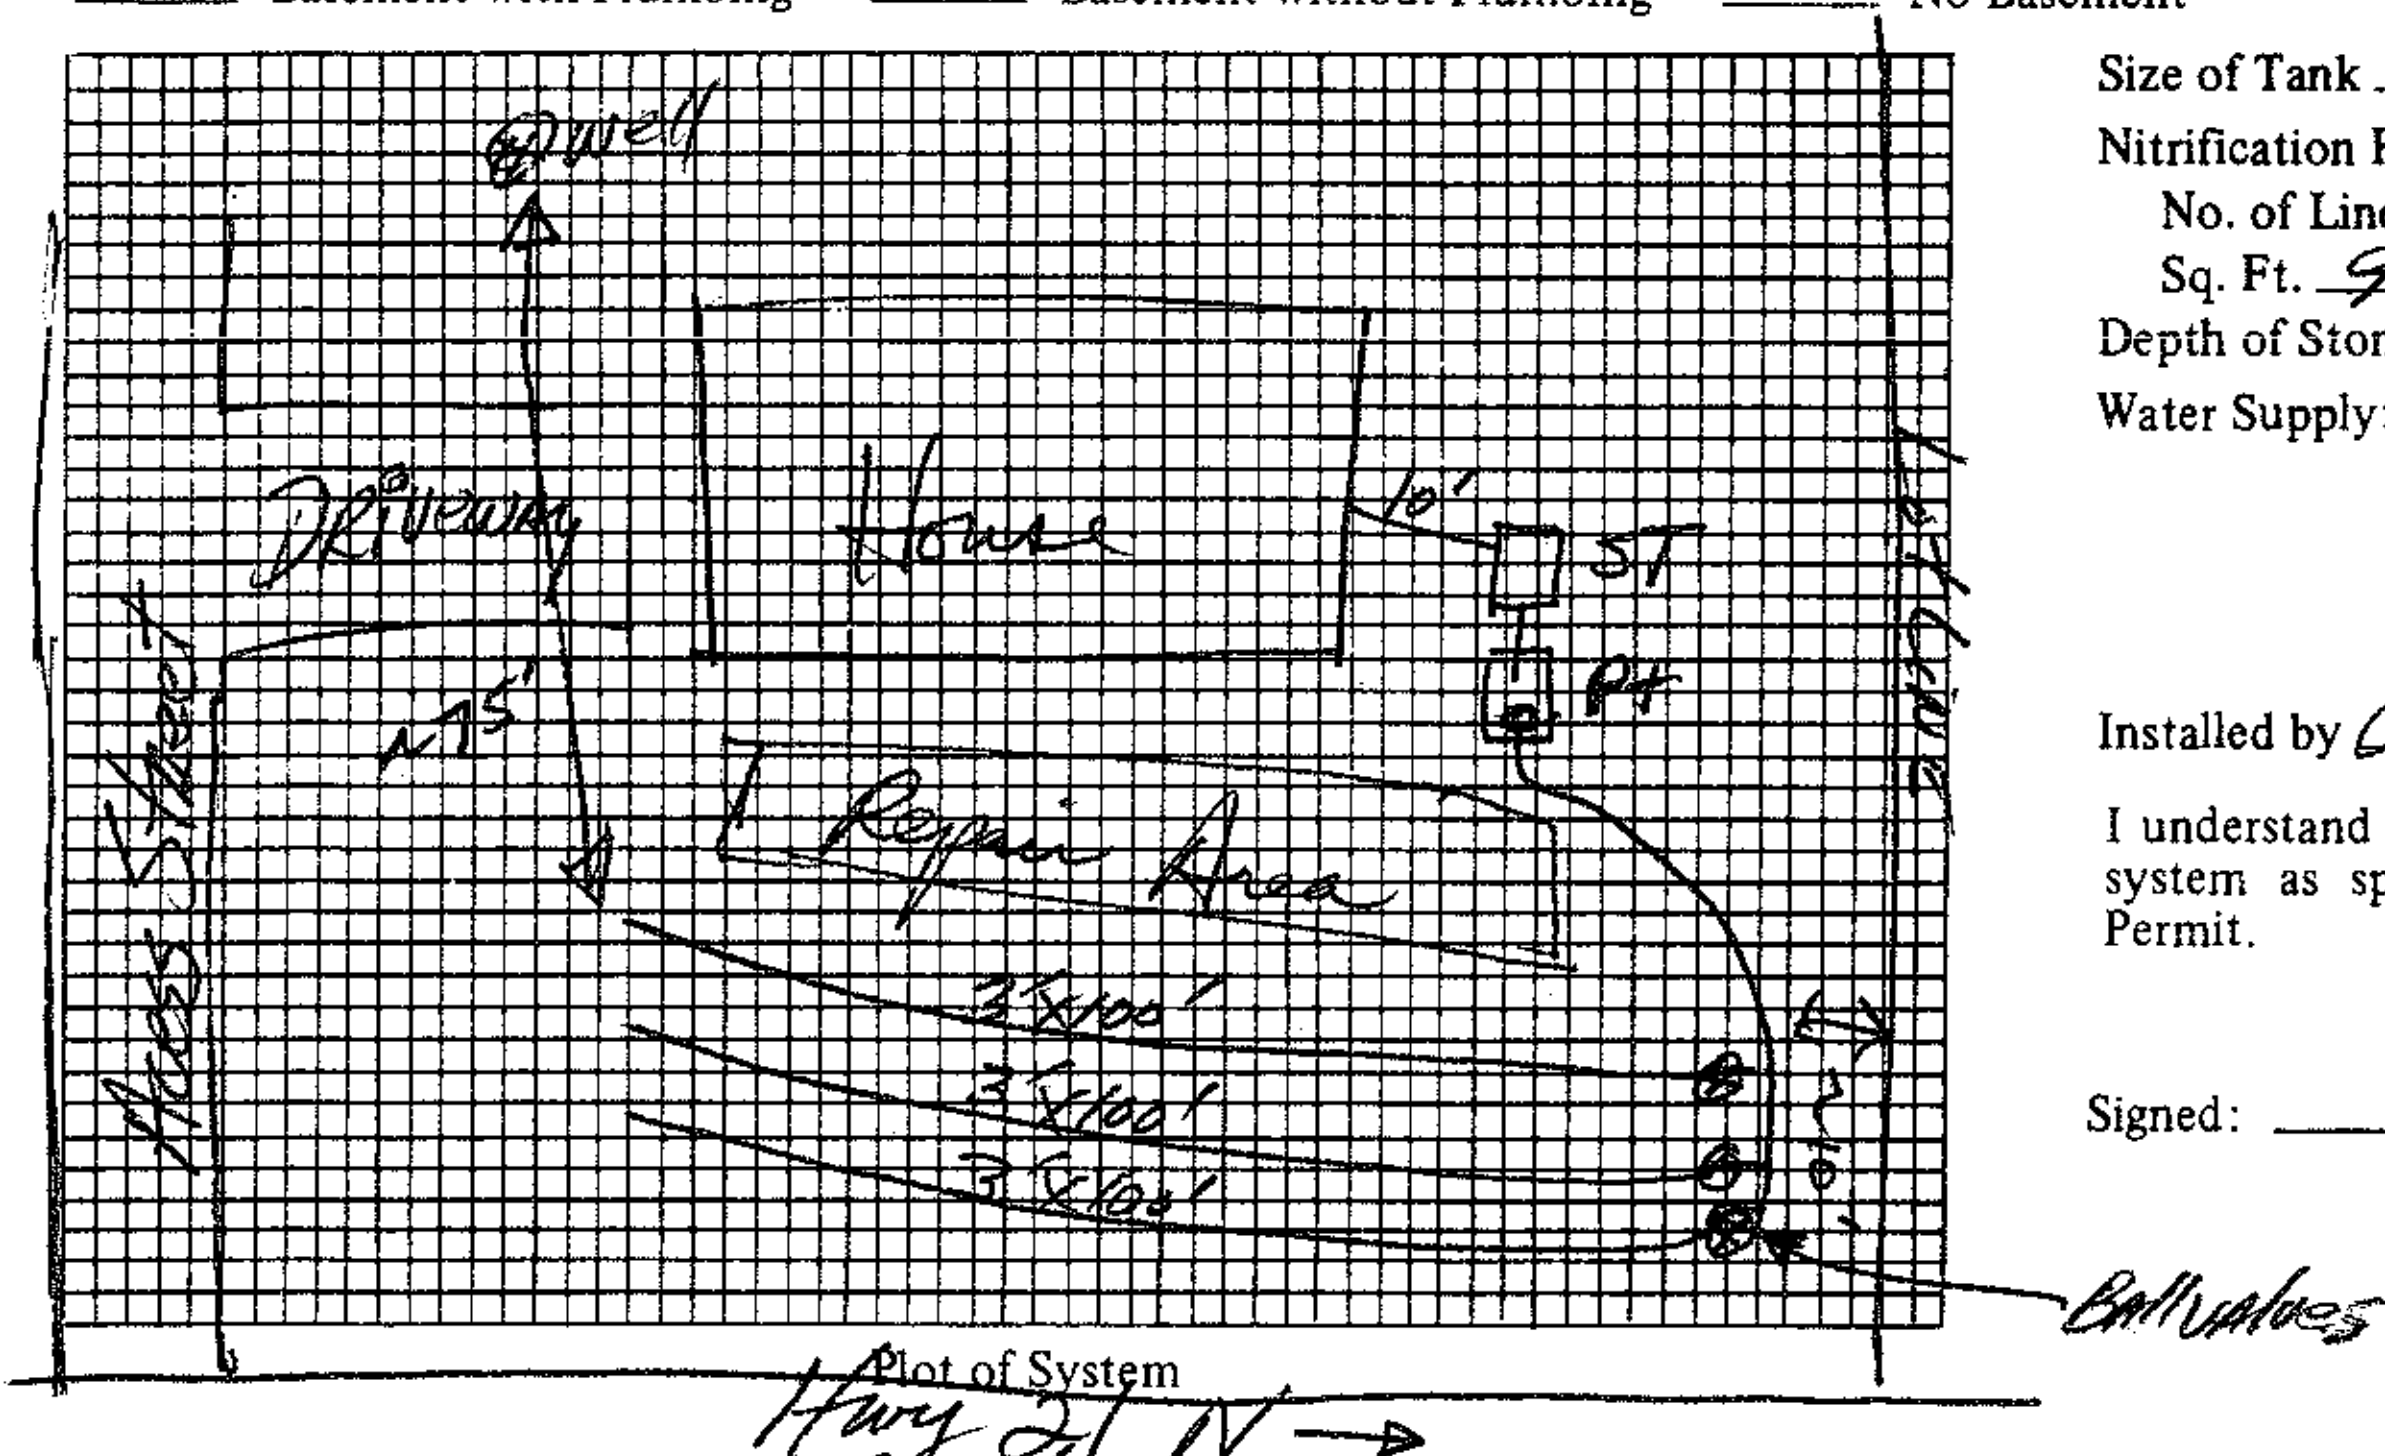

Plot of System

1000 p.t.

Size of Tank 1000 Gals.

Nitrification Field:

No. of Lines 3

Sq. Ft. 900 Linear Ft. 300

Depth of Stone in Lines 12"

Water Supply: Individual (✓)

Public ( )

Installed by Roy Beam

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY [signature]

COMMENTS: ______

CERTIFICATE OF COMPLETION BY [signature] Hinson, R.S. DATE 4-24-89

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold