4659292858 4659197809 4659195622 4659195483

IREDELL COUNTY HEALTH DEPARTMENT

Split into 4 lots

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Phyllis Jones DATE 7-16-84 PERMIT NO. 220

PHONE: Business _____ Home _____


LOCATION 115 N 1/4 mile Above 2390 TR dirt Road
X RR TRACKS Lot on left S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House ( ) Mobile Home (X) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes ( ) No (X)
Auto. Dishwasher Yes (X) No ( )
Auto. Wash. Machine Yes (X) No ( )
Site Suitable Yes (X) No ( )
Lot Area 80,000 ~~1,200~~ 1,200

Character & Porosity of Soil Clay adequate
Percolation Rate 0.5 gpd/sq ft/day
Topography Level
Depth to Water Table 4'+
Rock or other impervious formations None obs.

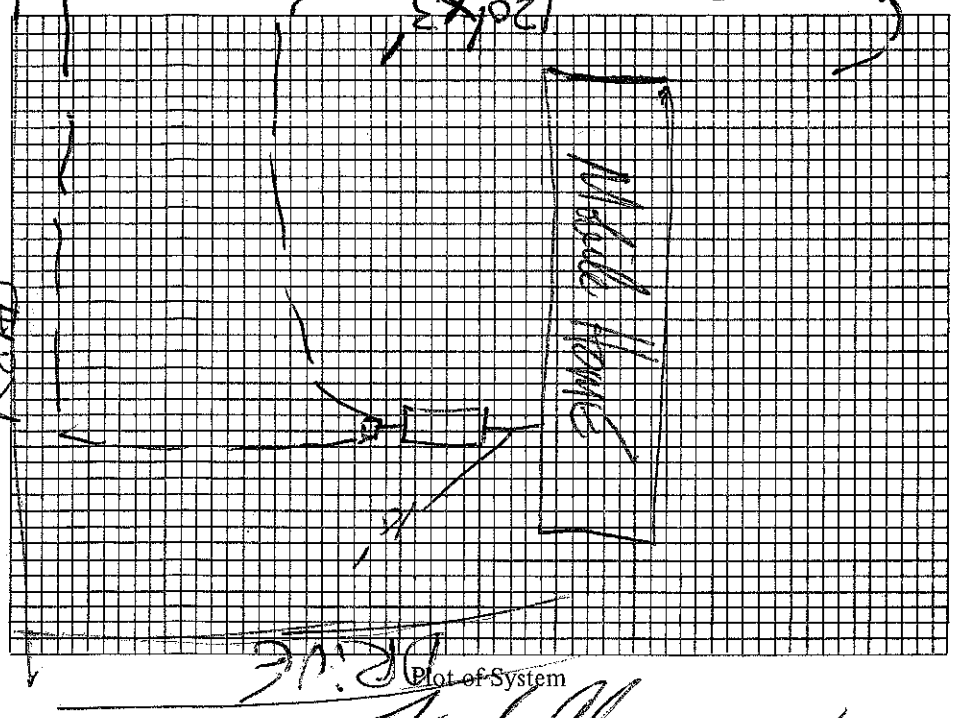

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 2
Sq. Ft. 720 Linear Ft. 2 46
Depth of Stone in Lines 12"
Water Supply: Individual (X)
Public ( )
well Next door

Installed by Tommy Cothren Taylorsville

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY Fred Clemmer

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Fred Clemmer DATE 7-16-84

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

230

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Phyllis Jones DATE 4-2-84 PERMIT NO. 63

PHONE: Business _____ Home _____

LOCATION 115 N ¼ mile above 2390 TR dirt Road X RR tracks Lot on left S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____


House ( ) Mobile Home (X) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (X)
Auto. Dishwasher	Yes (X)	No ( )
Auto. Wash. Machine	Yes (X)	No ( )
Site Suitable	Yes (X)	No ( )

Lot Area 20,000 Ft²

Character & Porosity of Soil Clay loam soft/plastic
Percolation Rate 2-40 60" 4" 1 ft/day
Topography _____
Depth to Water Table _____
Rock or other impervious formations None observed

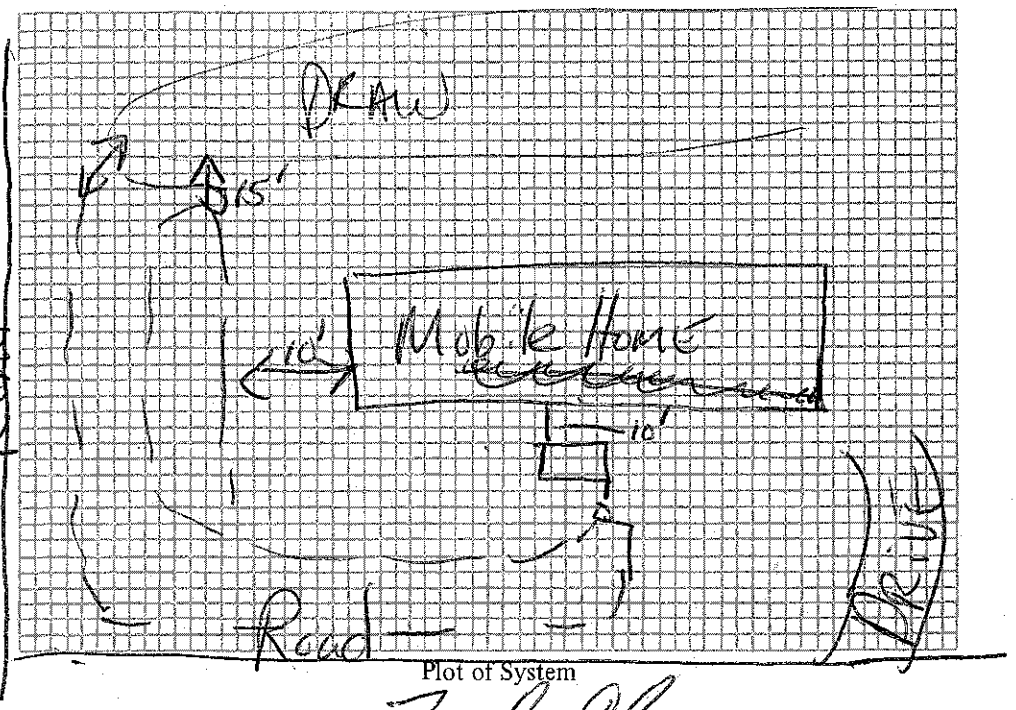

Plot of System

Size of Tank 1000 Gals.
Nitrification Field: 2
No. of Lines _____
Sq. Ft. 720 Linear Ft. 240
Depth of Stone in Lines 12"
Water Supply: Individual (X)
Public ( )
well next door

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Ken Taylor

IMPROVEMENTS PERMIT BY Fred Clemmons

COMMENTS: Keep System Shallow About 1.5' cover

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold