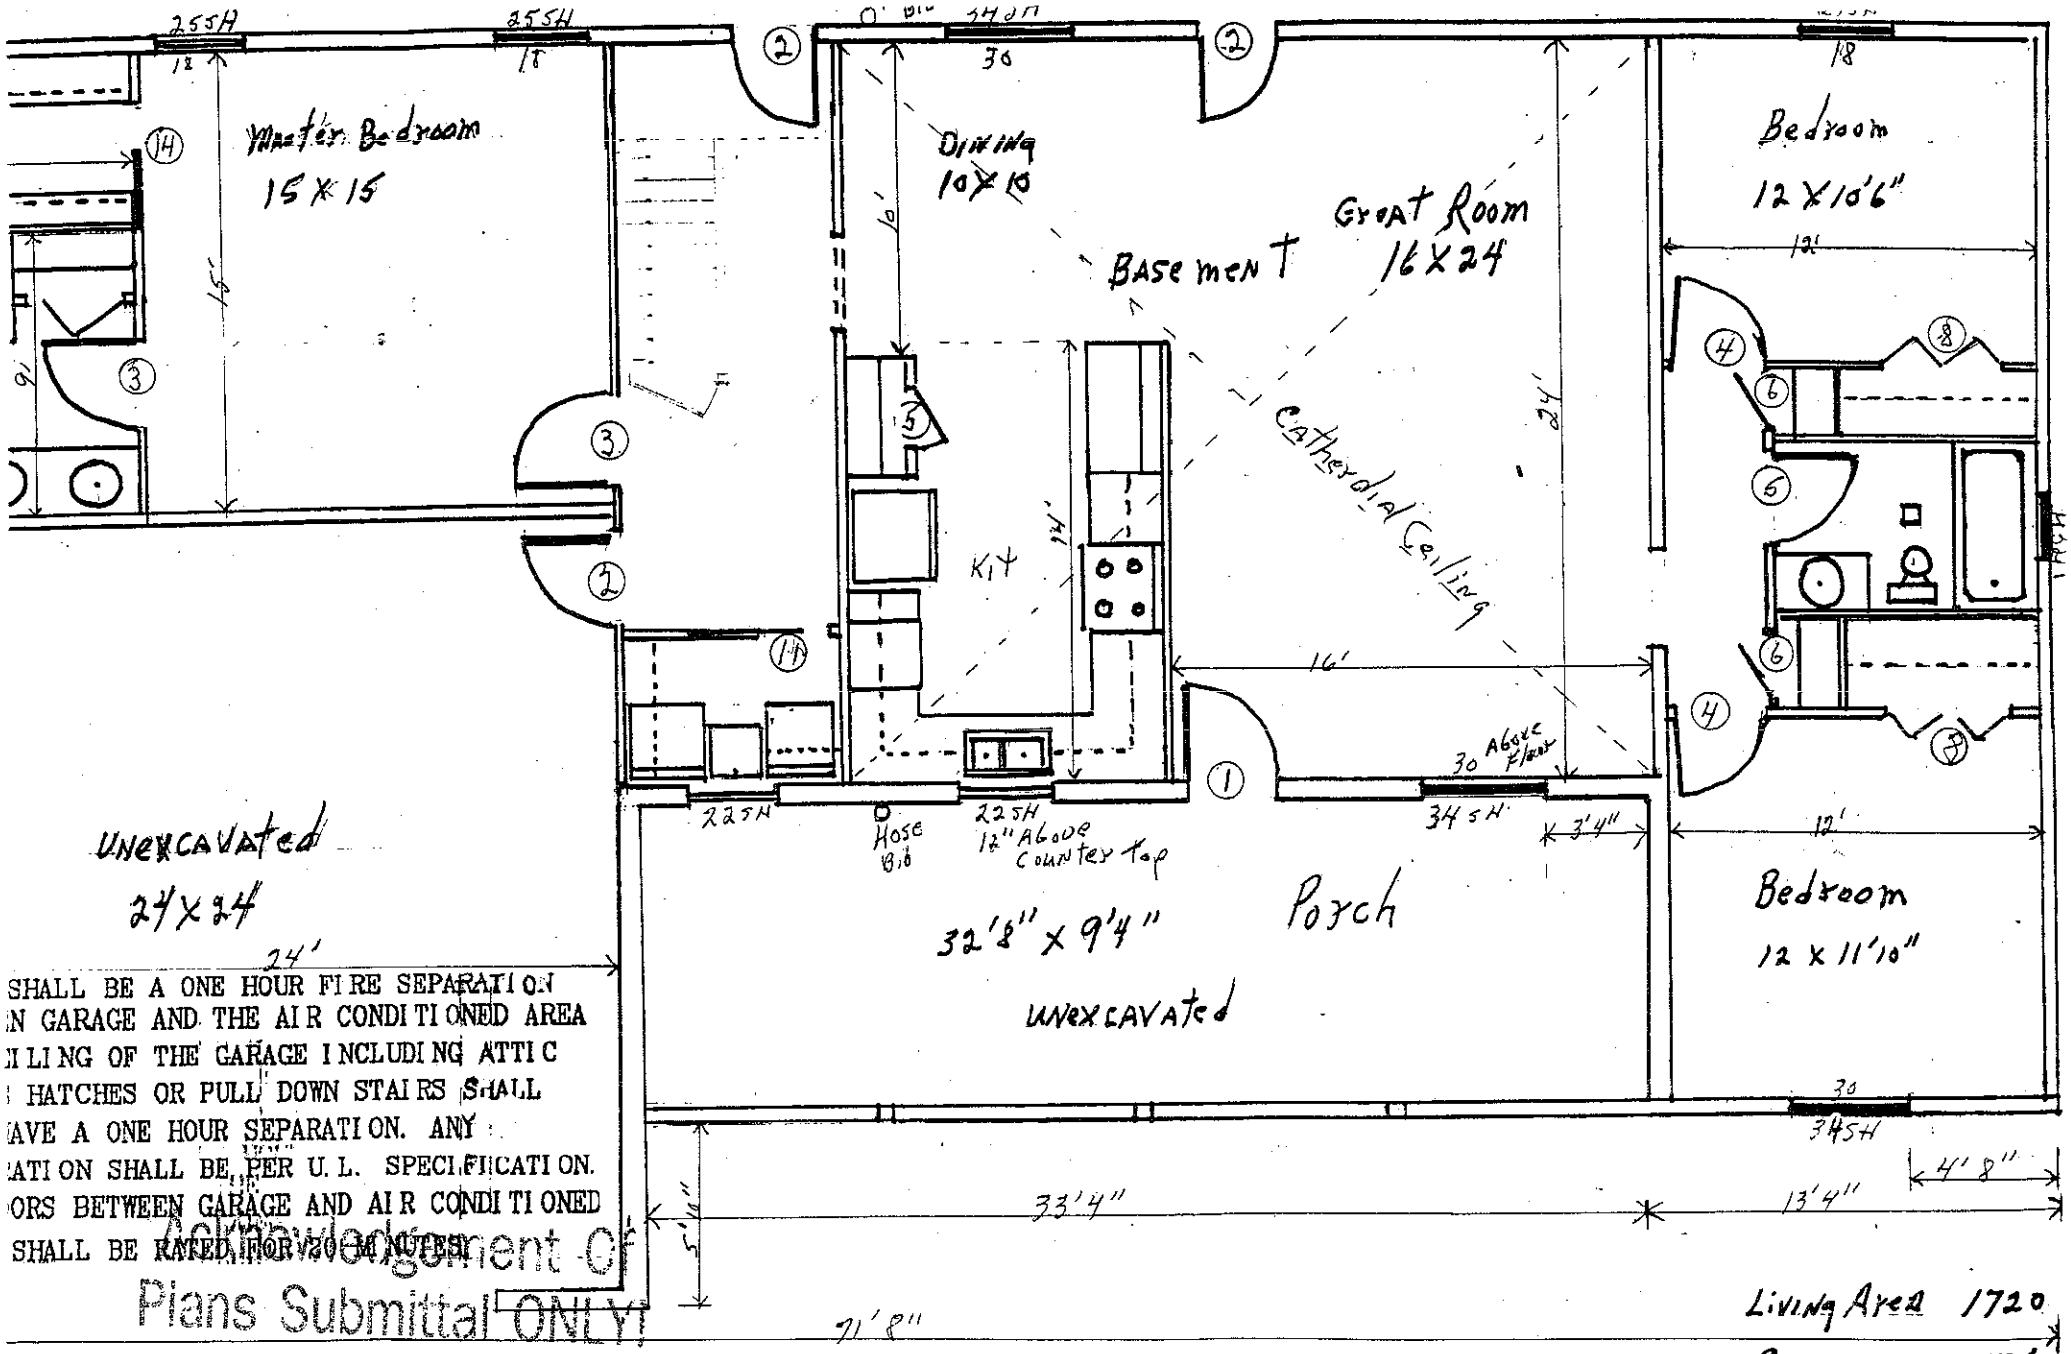


SHALL BE A ONE HOUR FIRE SEPARATION
N GARAGE AND THE AIR CONDITIONED AREA
LI LING OF THE GARAGE INCLUDING ATTIC
HATCHES OR PULL DOWN STAIRS SHALL
AVE A ONE HOUR SEPARATION. ANY
ATION SHALL BE, PER U.L. SPECIFICATION.
ORS BETWEEN GARAGE AND AIR CONDITIONED
SHALL BE RATED FOR 20 MINUTES.

Acknowledgement Of
Plans Submittal ONLY!

Date

James W Hedges Date 11/4/05

J.W. Hedges

Living Area	1720
Garage	576
O.L.	247