08649

4659 63 1228

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Billy Woodleze DATE May 11, '88 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 115-21 N. past Shepherd School TR across from Barfield (1309) Bear Rt. ~¼ mile on left S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____


House (✓) Mobile Home ( ) Business ( ) Other _____

No. Bedrooms 4 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site ~~Suitable~~ Yes (✓) No ( )
Lot Area 1 Ac.

Character & Porosity of Soil clay
Percolation Rate 24 & 30
Topography
Depth to Water Table 4'+
Rock or other impervious formations scarcely

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

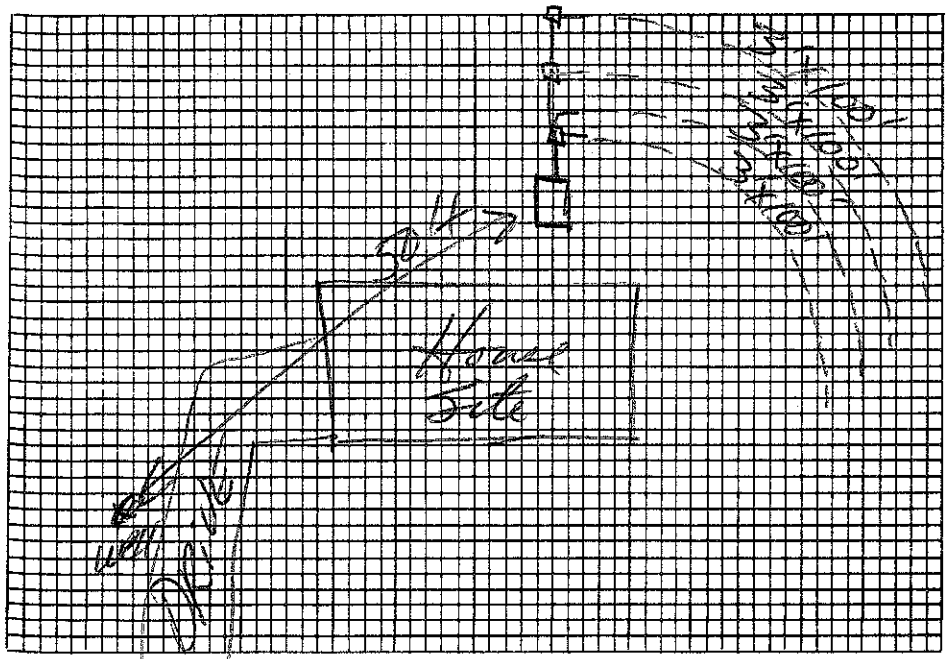

Plot of System

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 4
Sq. Ft. 200 Linear Ft. 400
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Jeff Pelchat

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: _____

CERTIFICATE OF COMPLETION BY _____, R.S. DATE 5-11-88

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

08649

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Billy Wooldridge DATE April 11, '88 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 115-21 N past Shepherd School TR across from Bayfield Rd (1309) Bear Rt. ~¼ mile on left S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 4 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site ~~Suitable~~ PS. Yes (✓) No ( )

Character & Porosity of Soil clay
Percolation Rate ~~5-8~~ 4
Topography ~~4-8~~ 4
Depth to Water Table 4'+
Rock or other impervious formations none Kn.

Lot Area 1Ac.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

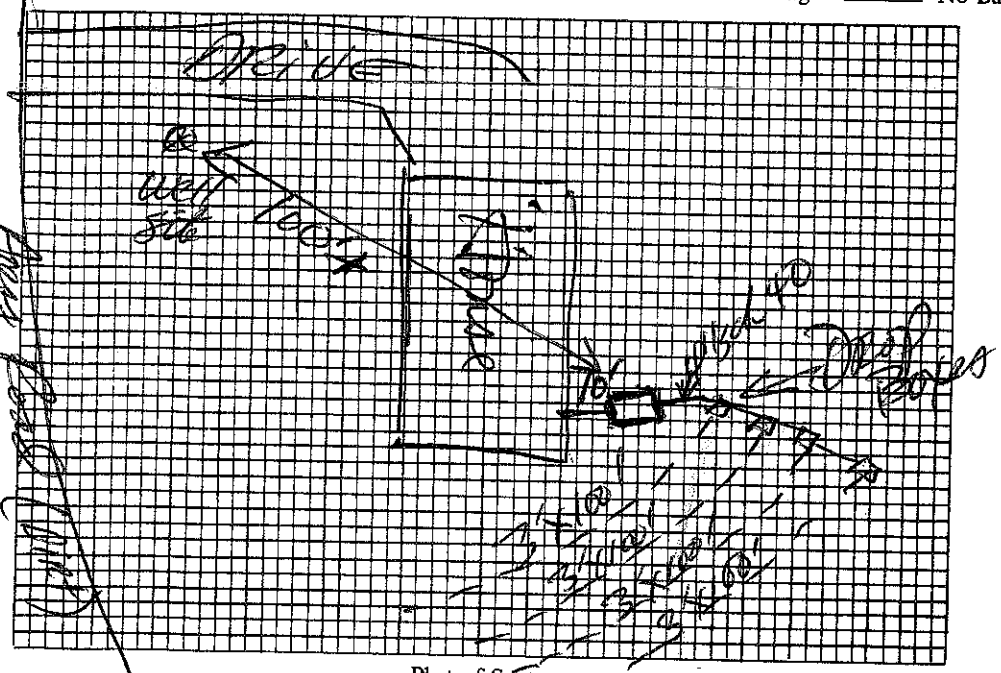

Plot of System

Size of Tank 1250 Gals.

Nitrification Field:
No. of Lines 14
Sq. Ft. 1200 Linear Ft. 400
Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: X Billy Wooldridge

IMPROVEMENTS PERMIT BY _____

COMMENTS: Yellow contour. Keep constant cover (~18") over stone. Run grade level as possible. Use drop boxes to distribute effluent.

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold