15454

STB-794 8-17-95

STB-794 8/23/95

IREDELL COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT AND CERTIFICATE OF COMPLETION / OPERATIONS PERMIT

OWNER OR CONTRACTOR ROBERT E FIORI DATE 11/24/92 PERMIT NO. IB 2A 16/17

PHONE: Business ______ Home 704-548-1770 (H) - 896-0658 - 382-6249 (W)

LOCATION SHEARERS RD, TL ON FIRST ENTRANCE TO 3 and 4th. LOTS ON (L) S.R. No. ______

SUBDIVISION NAME BELLE GLADE LOT NO. 16/17 SECTION OR BLOCK NO. ______

House ☑ Mobile Home ☐ Business ☐ Other ______

No. Bedrooms 4 No. Bathrooms 3.5

Garbage Disposal Unit Yes ☐ No ☑

Auto. Dishwasher Yes ☑ No ☐

Auto. Wash. Machine Yes ☑ No ☐

Lot Area ~ 2.06 AC

Soil Characteristics P - S.C → C TRANS


Application Rate P - .3 (FINE, MICACEOUS, SS)

Topography A - >30%

Depth to Water Table S - >48"

Rock or other impervious formations S - NONE OBSERVED. (146, 149, 183, 109)

______ Basement with Plumbing 2 ✓ Basement without Plumbing 3 ______ No Basement ______ Crawl Space

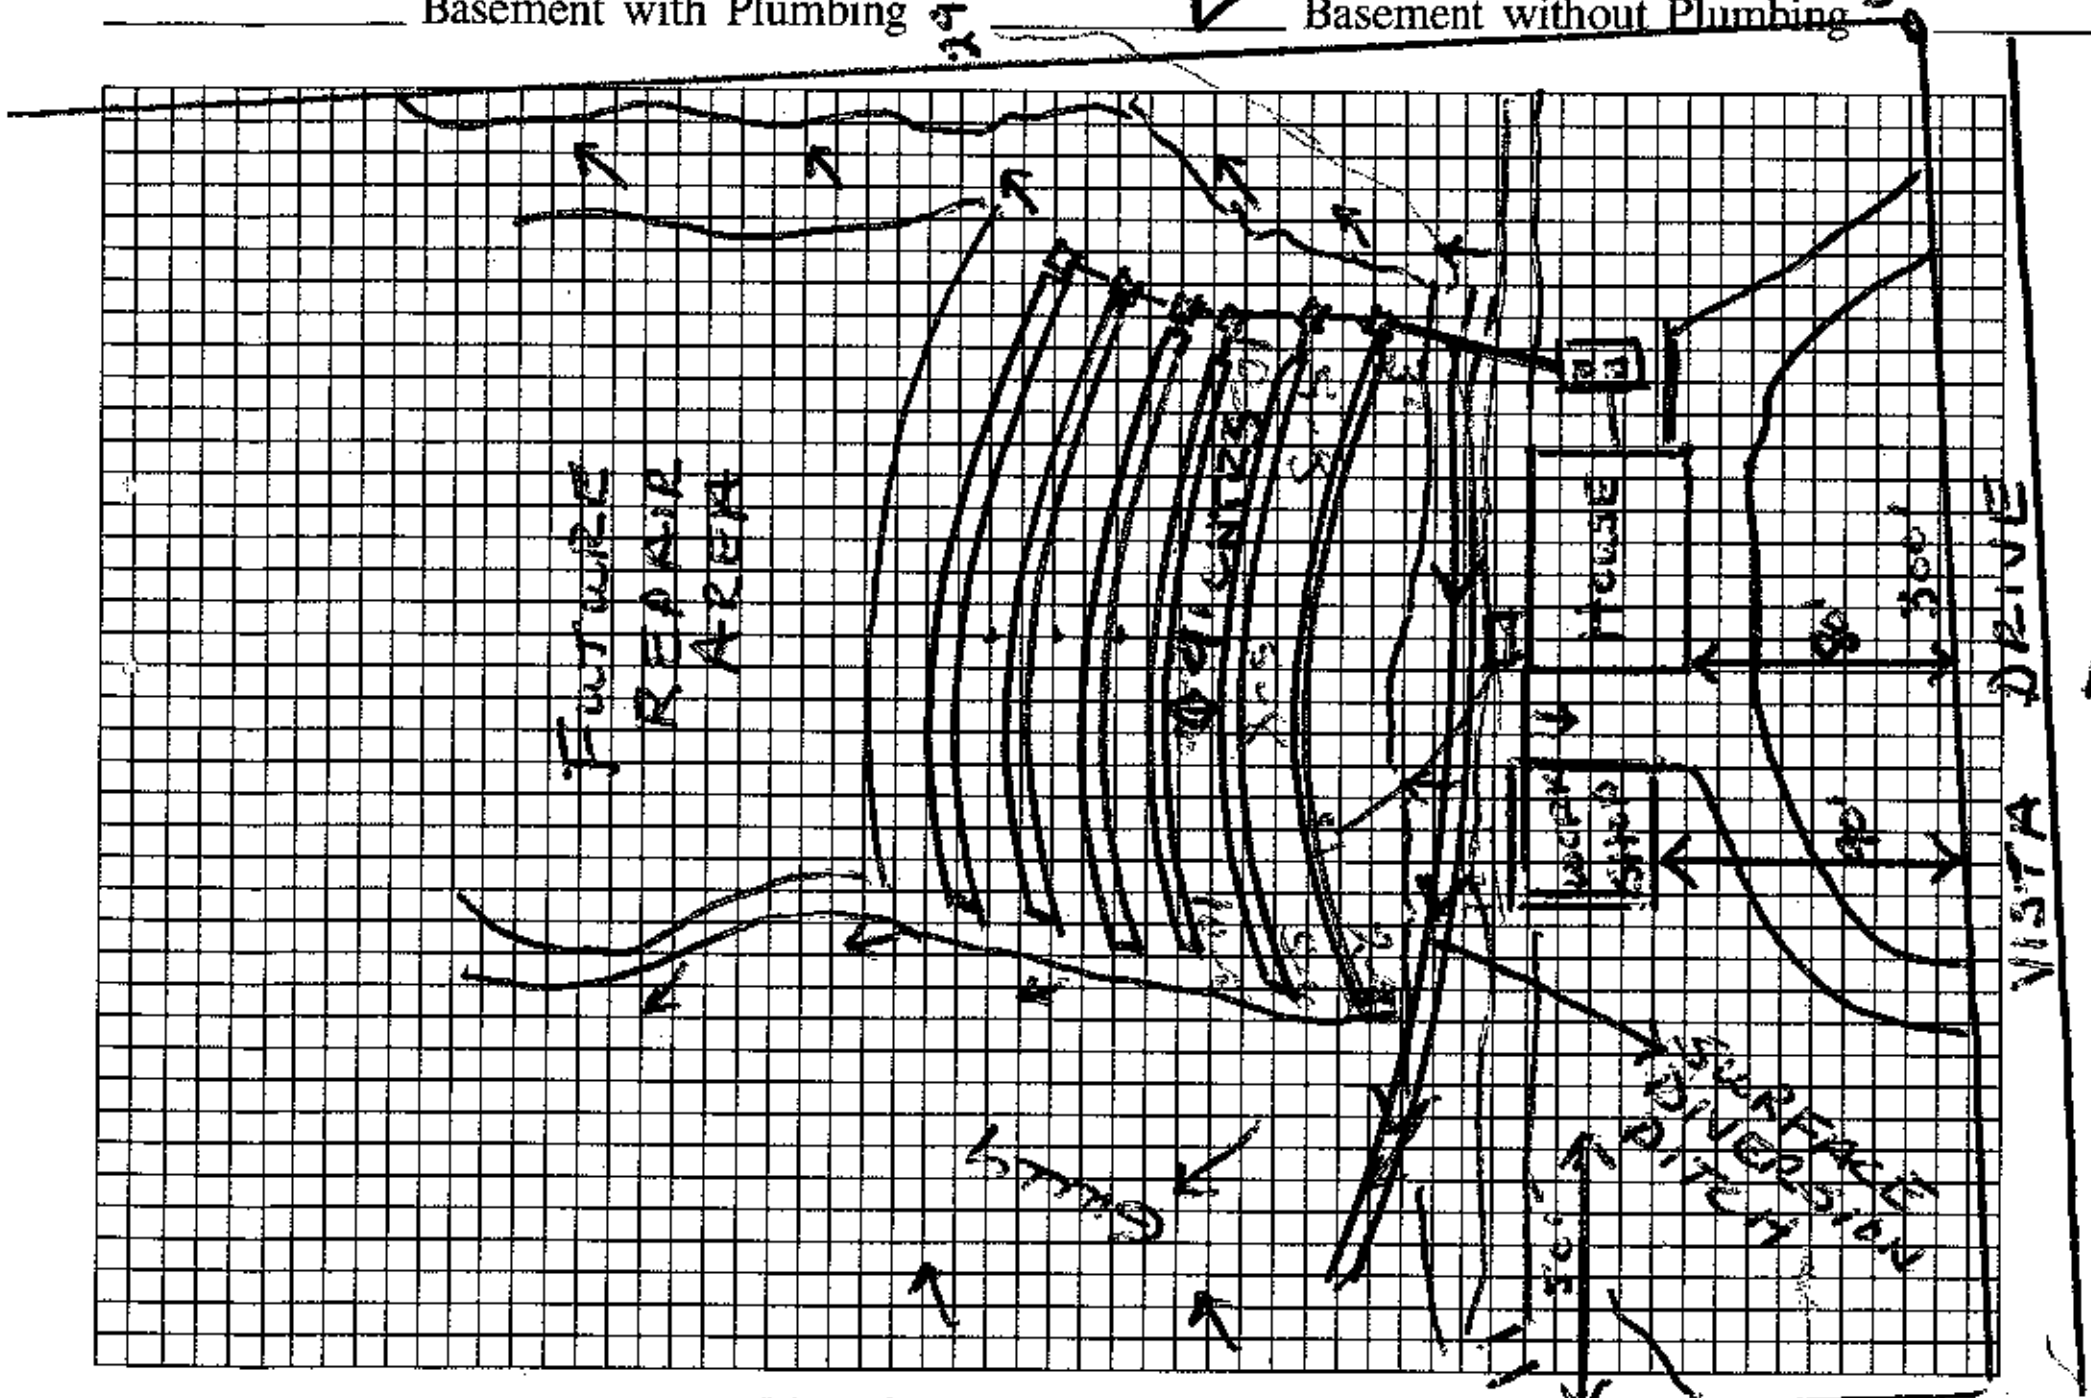

Plot of System (Not to Scale)

Size of Tank 1000 Gals. (4/29/93)

Nitrification Field: 5

No. of Lines 6 @ 88' x 2' *

Sq. Ft. 1600 Linear Ft. 533

Depth of Stone in Lines ______

Water Supply: Individual ☑ NOT DRILLED YET. Public ☐

10" FIBER WRAPPED - LARGE DIAMETER PIPE DRAINLINES

Installed by ______

I understand and agree to install a septic tank system as specified on this Improvement Permit.

Signed: MAILED COPIES AS REQUESTED -

(IMPROVEMENT PERMIT IS VALID FOR 60 MONTHS FROM DATE OF ISSUE.)

IMPROVEMENT PERMIT BY Wesley Sparks RS. * SEE ATTACHED INSTRUCTION SHEETS.

COMMENTS 10" LARGE DIAMETER FIBER WRAPPED PIPE WITH DROP BOX DISTRIBUTION. TRENCH DEPTH MAXIMUM OF 36" - SHOVEL ROUND THE BOTTOM OF EACH TRENCH TO SEAT THE PIPE WELL IN ORIGINAL SOIL. GRADE ON TRENCH BOTTOM NO GREATER THAN 1" per 100 LINEAR FEET.

CERTIFICATE OF COMPLETION BY ______ DATE ______

EXISTING SYSTEM CHECKED BY ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS

Permit is VOID if any unauthorized changes are made in installation of system, and/or if any unapproved changes are made to the site, and/or if any false information is supplied toward securing Improvement Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold