12918 — 4668663047

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Matsushita Compressor Corp DATE Aug 27, '91 PERMIT NO. 4C-B-55

PHONE: Business ____ Home ____

LOCATION 115 N. TR 2395 (Mazeppa Rd.) TR Panasonic Way 1st right Concession area for community ballfield S. R. No. ____

SUBDIVISION NAME ____ LOT NO. ____ SECTION OR BLOCK NO. ____

No food prepared on site; package snacks/drinks only

House ( ) Mobile Home ( ) Business ( ) Other Concession area / 2 public restrooms ~700 gpd wastewater flow based on Avg 140 people Attendance

No. Bedrooms – No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)

Auto. Dishwasher Yes ( ) No (✓)

Auto. Wash. Machine Yes ( ) No (✓)

Site ~~Suitable~~ PS Yes ( ) No ( )

Lot Area acreage

Character & Porosity of Soil firm ps clay


Percolation Rate .3

Topography 4-8%

Depth to Water Table 4'+

Rock or other impervious formations none obs.

____ Basement with Plumbing ____ Basement without Plumbing ✓ No Basement

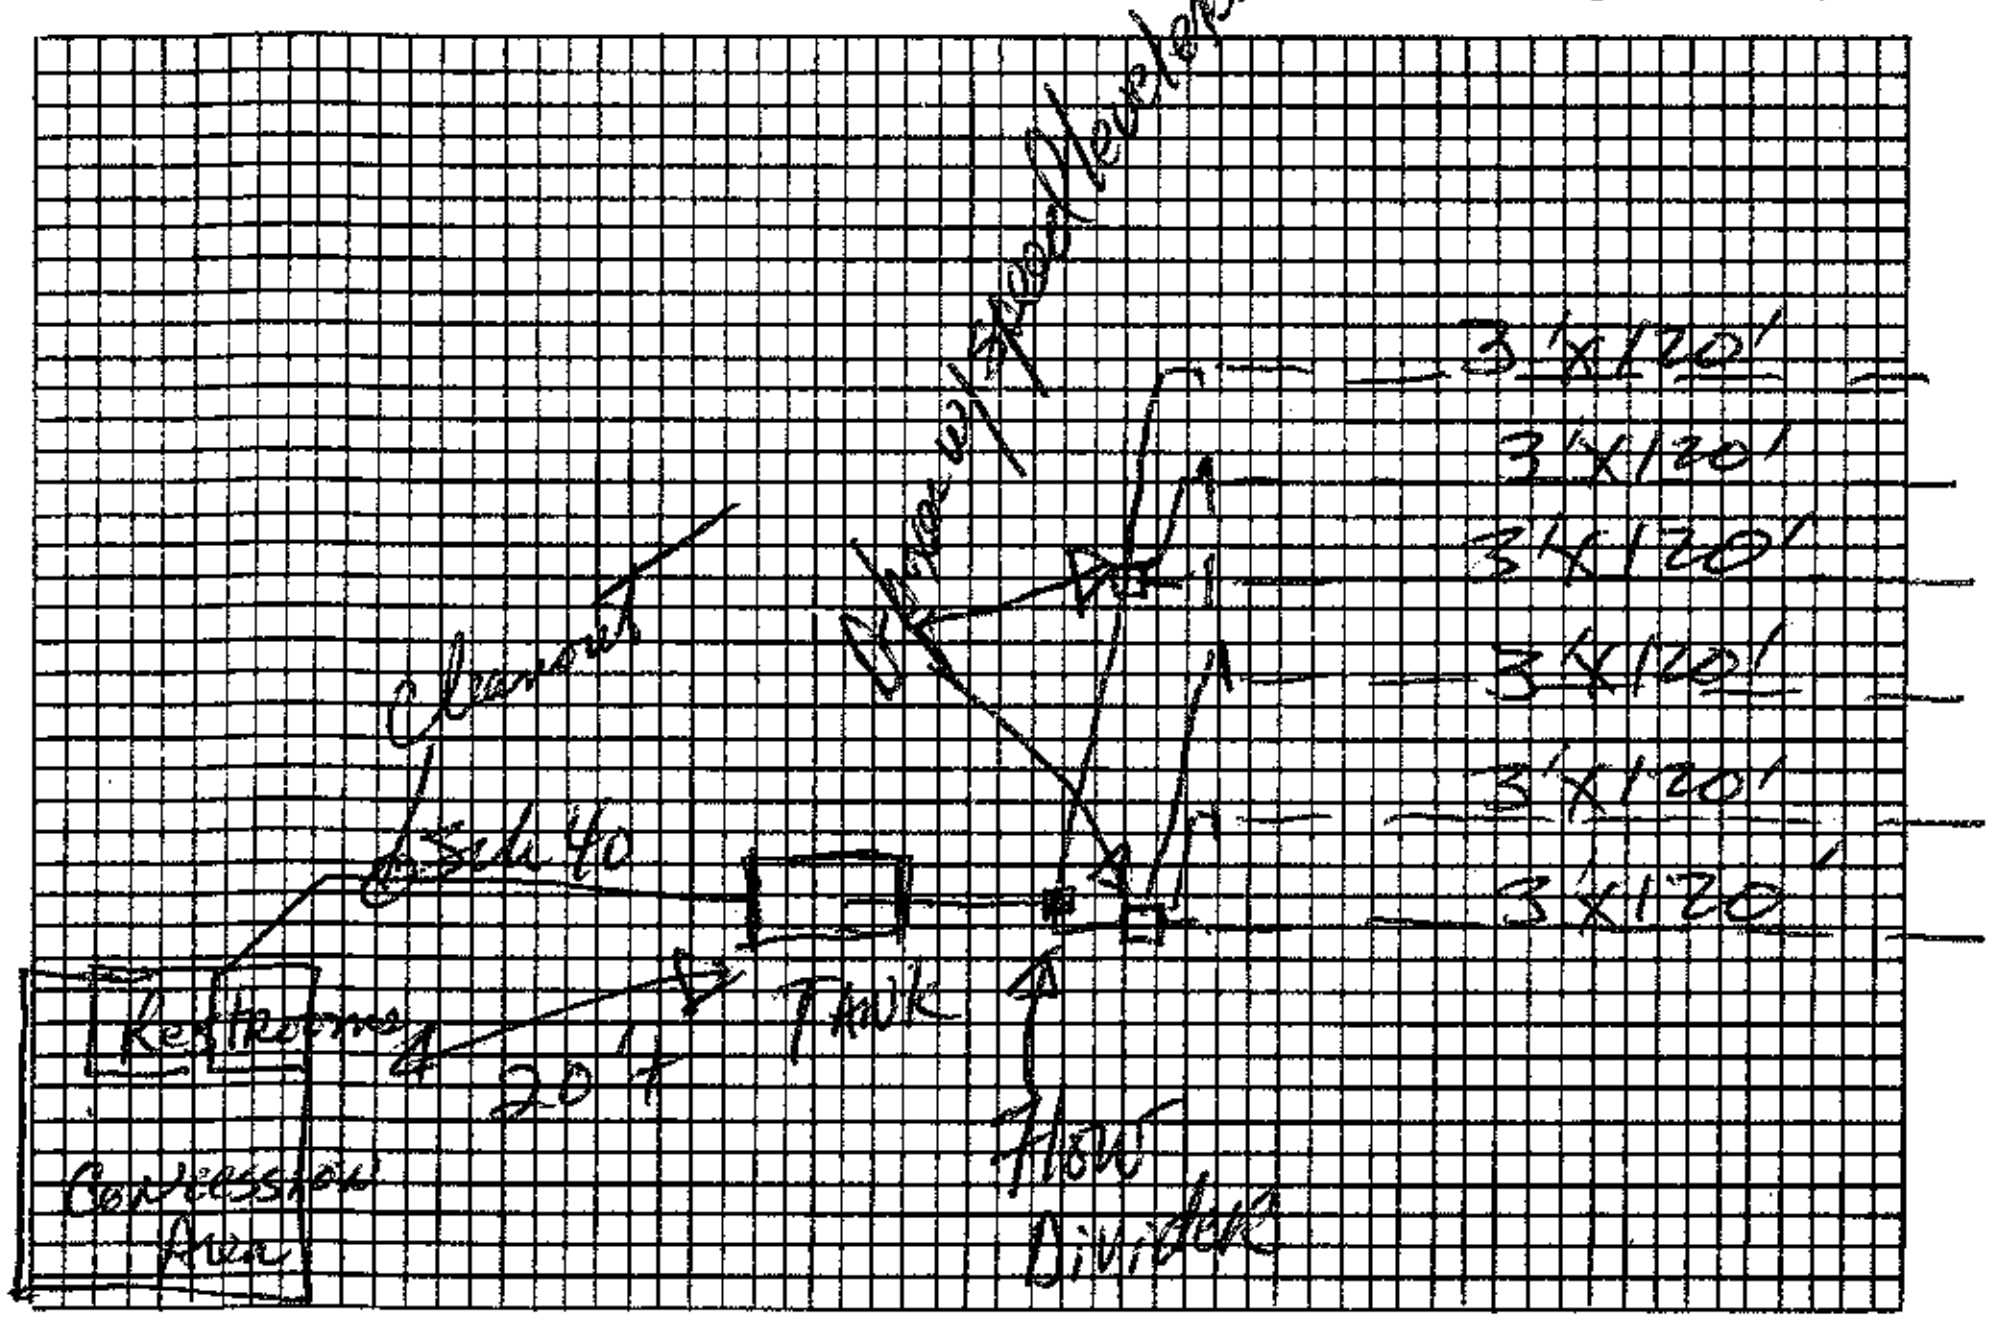

Plot of System

Size of Tank 1500 Gals.

Nitrification Field:

No. of Lines 6 (3+3)

Sq. Ft. 2160 Linear Ft. 720

Depth of Stone in Lines 12"

Water Supply: Individual ( )

Public (✓)

Installed by Orbison

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ____

IMPROVEMENTS PERMIT BY DRH

COMMENTS: Ball field

Ball field

CERTIFICATE OF COMPLETION BY DR Hinson, RS DATE 8-27-91

EXISTING SYSTEM CHECKED BY: ____ DATE ____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold