1521

IREDELL COUNTY HEALTH DEPARTMENT PIN# 4668-82-2400

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Russell Cole DATE 1/23/91 PERMIT NO. IN-2-B-5

PHONE: Business _____ Home _____

LOCATION 801 N Corner of Sardis Rd.

S. R. No. _____

SUBDIVISION NAME Beverly Park LOT NO. 5-8 SECTION OR BLOCK NO. _____


House ( ) Mobile Home (✓) Business ( ) Other _____

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes (✓) No ( )
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil clay
Percolation Rate 1.4
Topography 1-5%
Depth to Water Table 3' +
Rock or other impervious formations None observed

Lot Area 100'x220'

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

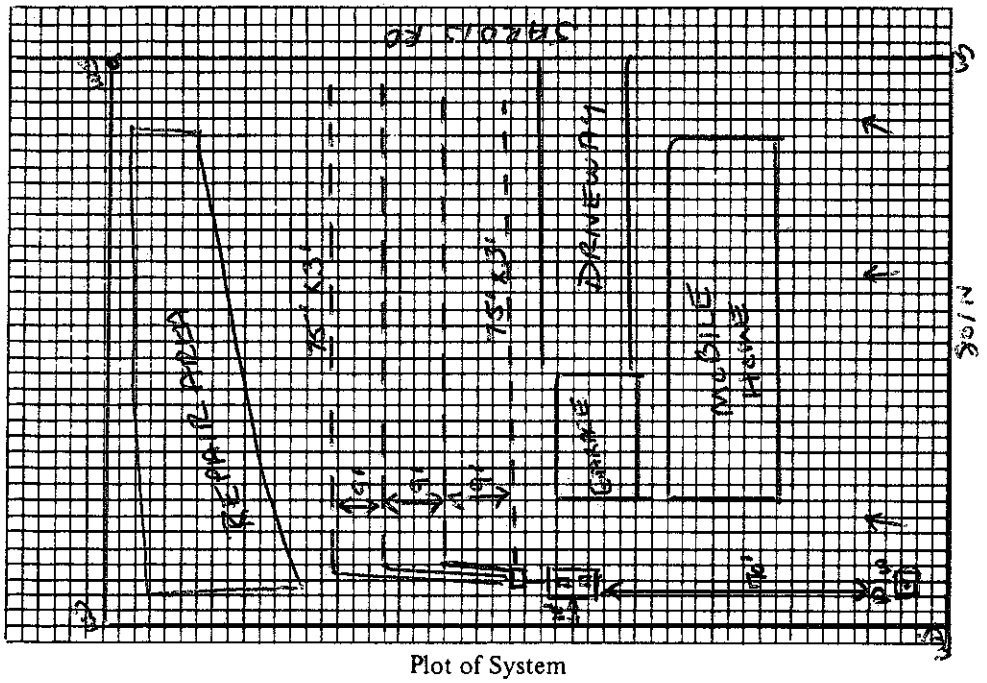

Plot of System

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 4
Sq. Ft. 900 Linear Ft. 300'
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by E J ERVIN

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY _____

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Wesley Sparks R.S. DATE 1/23/91

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

1521

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION

(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Russell Cole DATE 9/12/90 PERMIT NO. IN-2-B-5

PHONE: Business _____ Home _____

LOCATION 801 N Corner of 801N & Sardis

S. R. No. _____

SUBDIVISION NAME Beverly Park LOT NO. 5 SECTION OR BLOCK NO. _____

House ( ) Mobile Home (✓) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes (✓)	No ( )	Character & Porosity of Soil	PS clay
Auto. Dishwasher	Yes (✓)	No ( )	Percolation Rate	N.O.P.
Auto. Wash. Machine	Yes (✓)	No ( )	Topography	1-5 %
Site ~~Suitable~~ PS	Yes ( )	No ( )	Depth to Water Table	+31
			Rock or other impervious formations	none obs.

Lot Area 100 x 220

D-Box w/ Speed Levelers

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

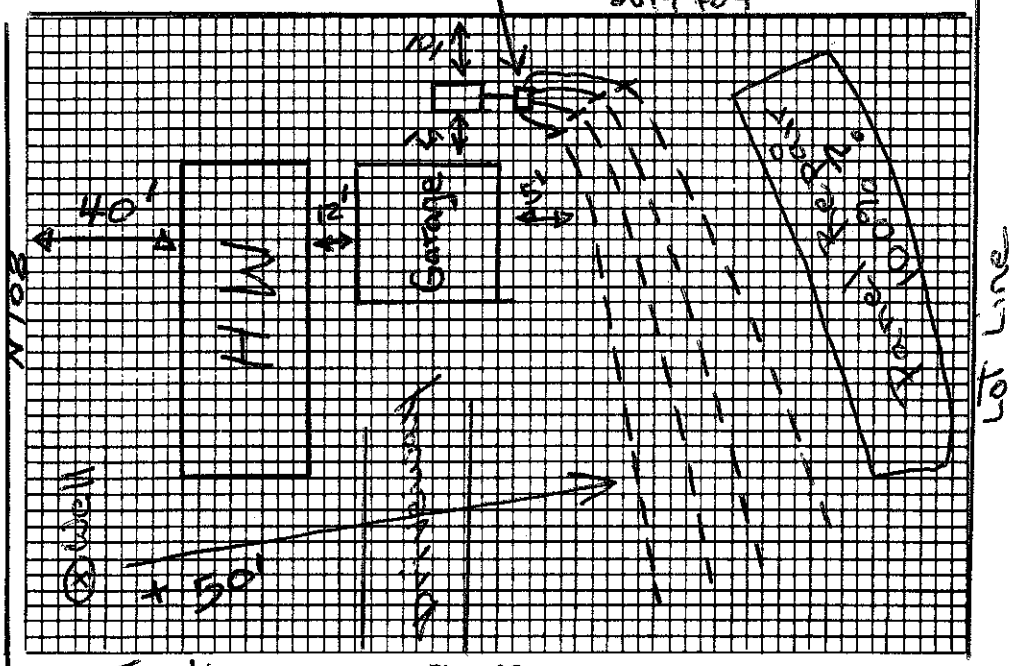

Size of Tank 1250 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 900 Linear Ft. 300'
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Joyce D. Piper
Reaction for R. Cole

IMPROVEMENTS PERMIT BY Sam Ingram EHS

COMMENTS: Garage must be 12-15' off MH to allow room for conventional system. Garage 20D x 22W Lines 30" maximum trench bottom depth

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold