DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

PROPERTY ID #: _____
COUNTY: _____

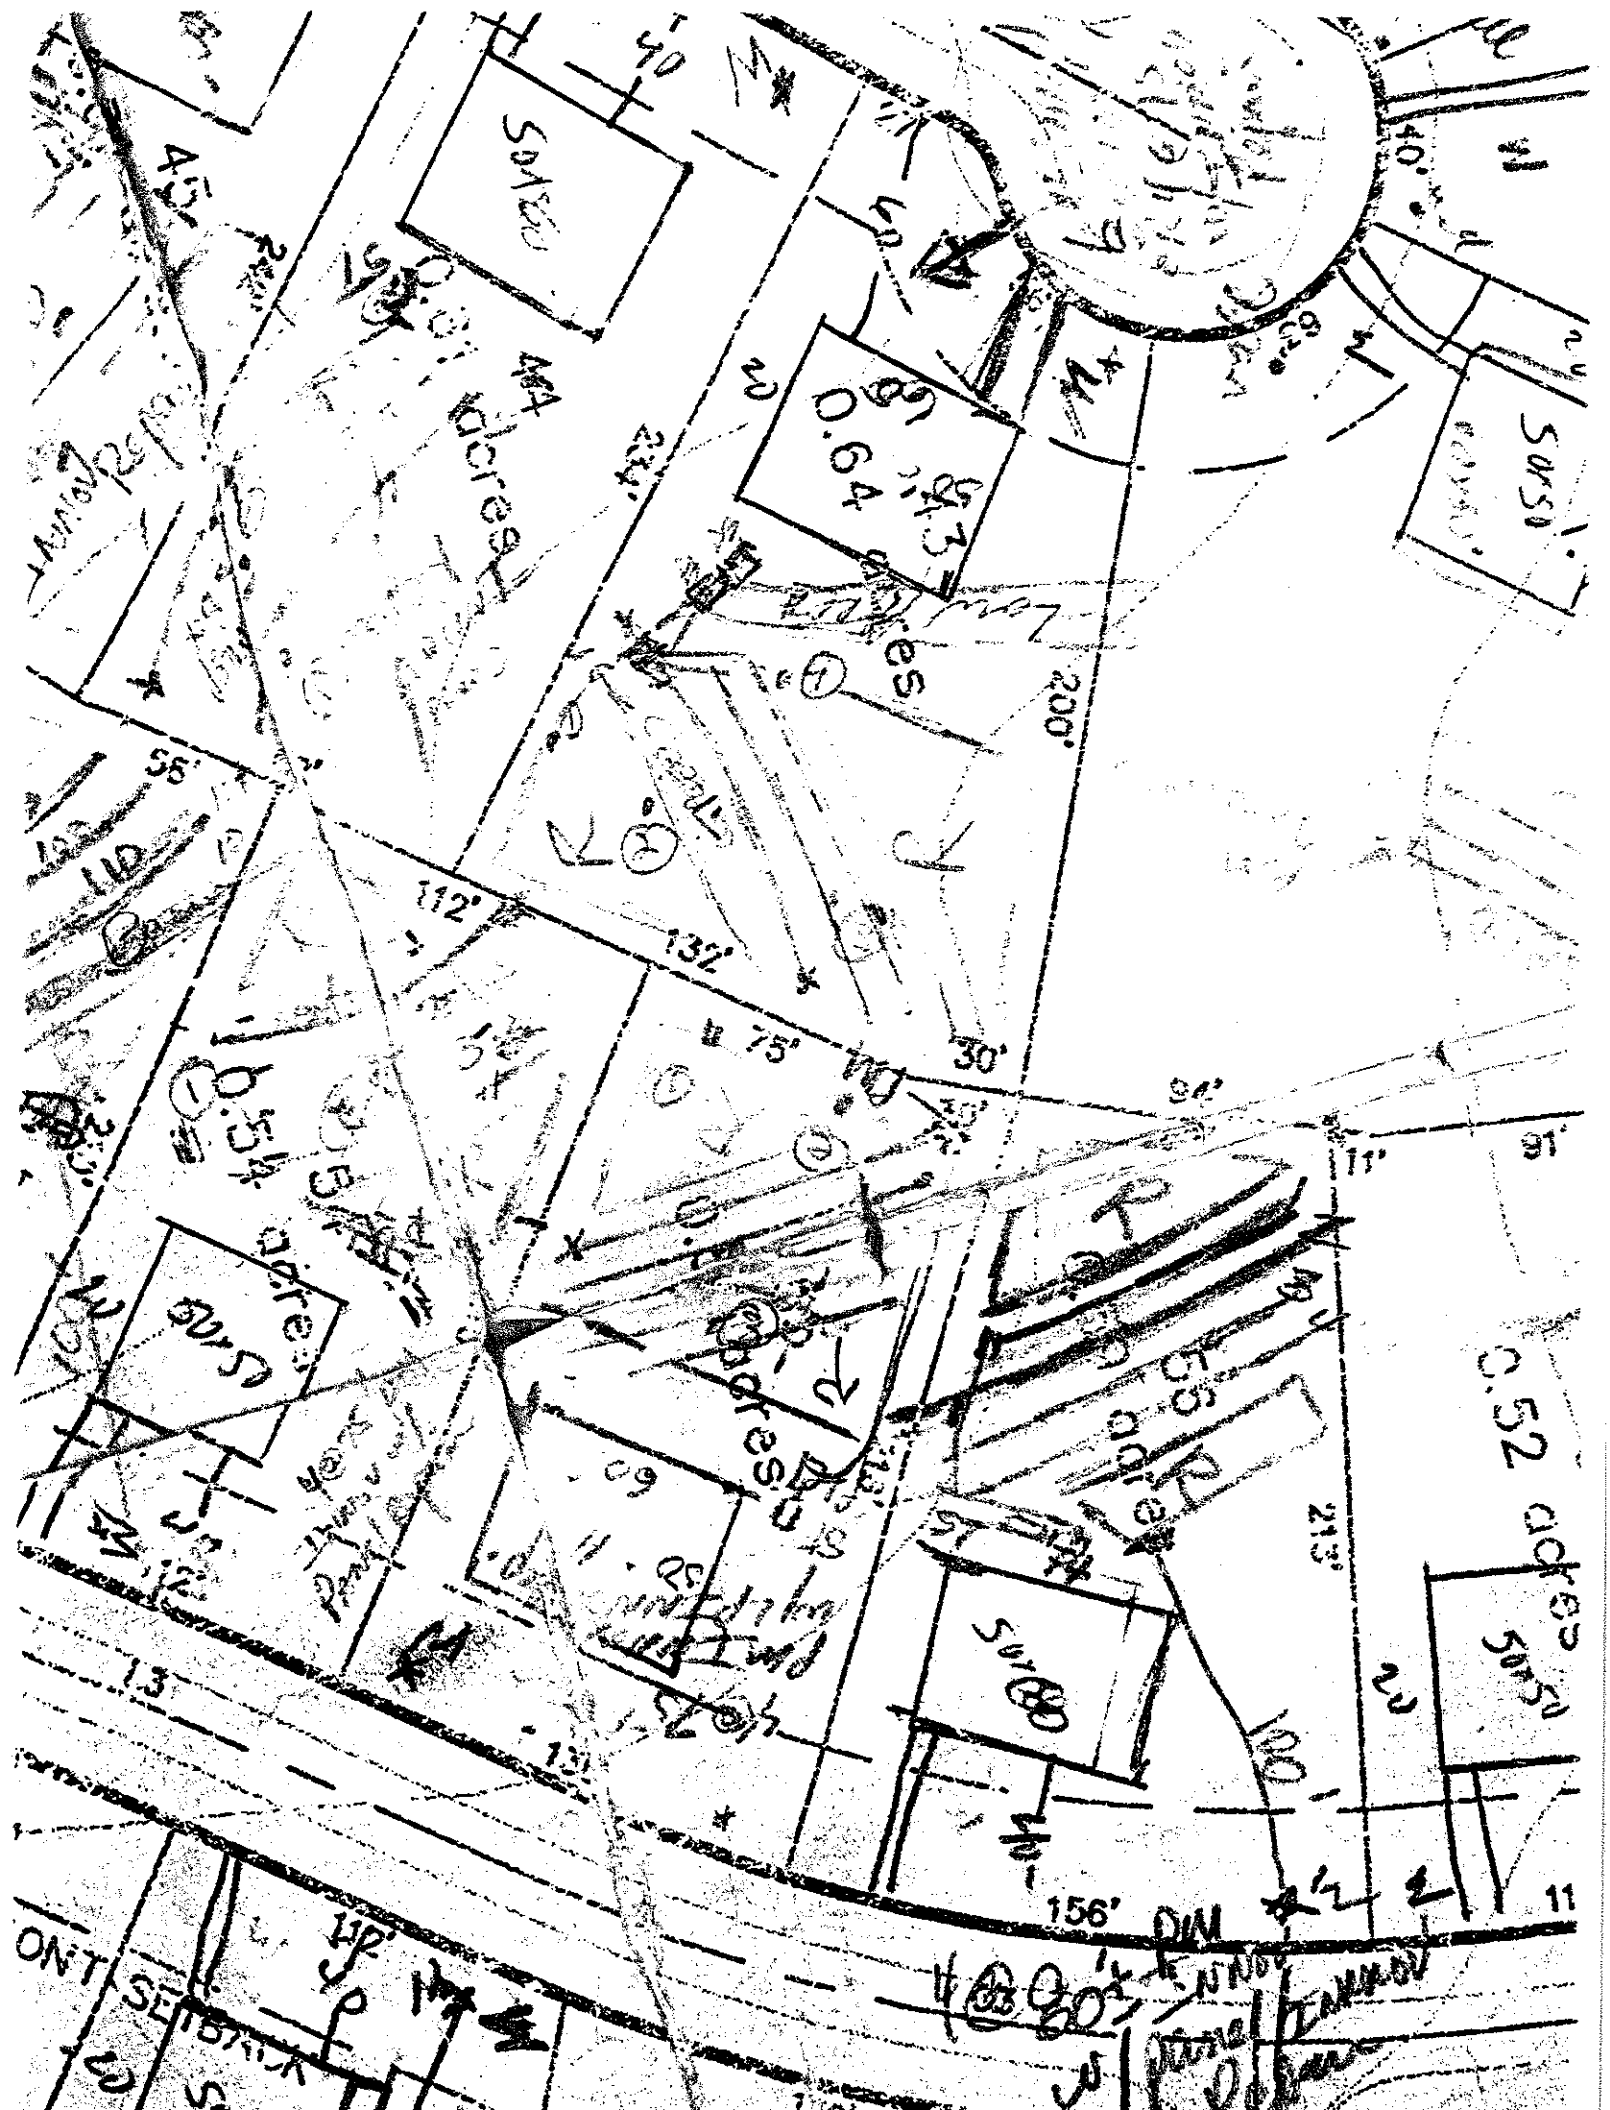
SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICANT: _____
ADDRESS: _____ APPLICATION DATE: _____ DATE EVALUATED: _____
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): _____ PROPERTY SIZE: _____
LOCATION OF SITE: Lot 56 Knoll Old PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☐ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut
TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	.1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1		0-6	SiL GR	Friable SS SP					PS .4
		6-14	RL SBK	FI SP					
		14-24	RCL WSBK	Fri SS SP					
		24-63	SL MASS	Fri SS SP					
		63-76	L MASS	Fri NS NP					
2		0-4	SiL GR	FRI SSSP					PS .3
		4-16	RL SBK	FI SP					
		16-32	RCL WSBK	FRI SSSP					
		32-64	SC SBK	FRI SSSP					
3		0-6	SiL GR	FRI SSSP					PS .3
		6-20	RL SBK	FRI/FI SSP					
		20-44	RCL WSBK	FRI SSSP					
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): _____
EVALUATED BY: _____
OTHER(S) PRESENT: _____


0.64 acres
0.54 acres
0.52 acres
112'
132'
75'
30'
156'
200'
213'
91'
11'
94'
58'
40'
50'
DW
LP
SETBACK