
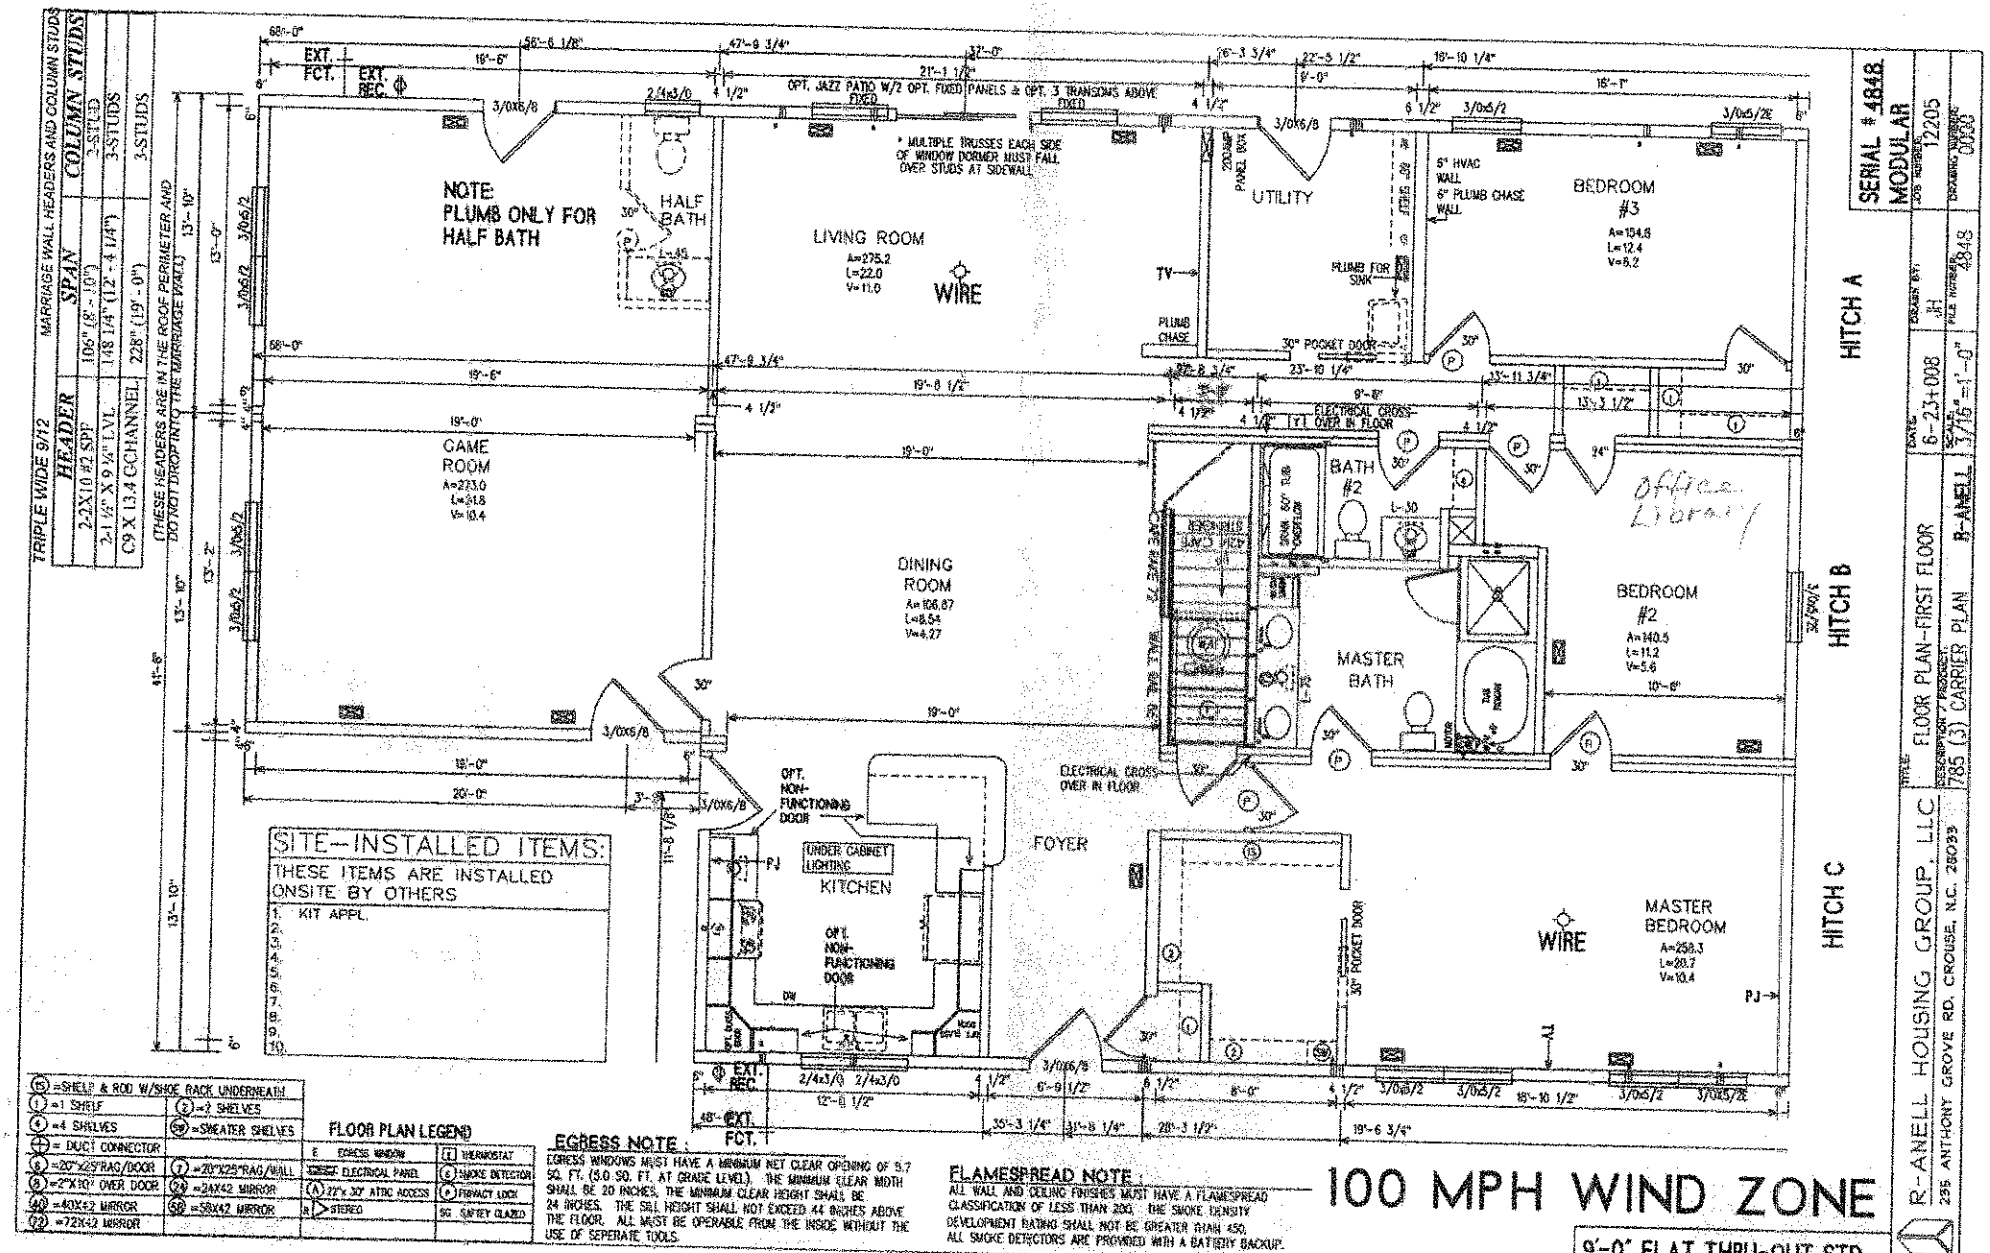


Melanie Lahman 7/22/08

Maria Dotson 7/22/08

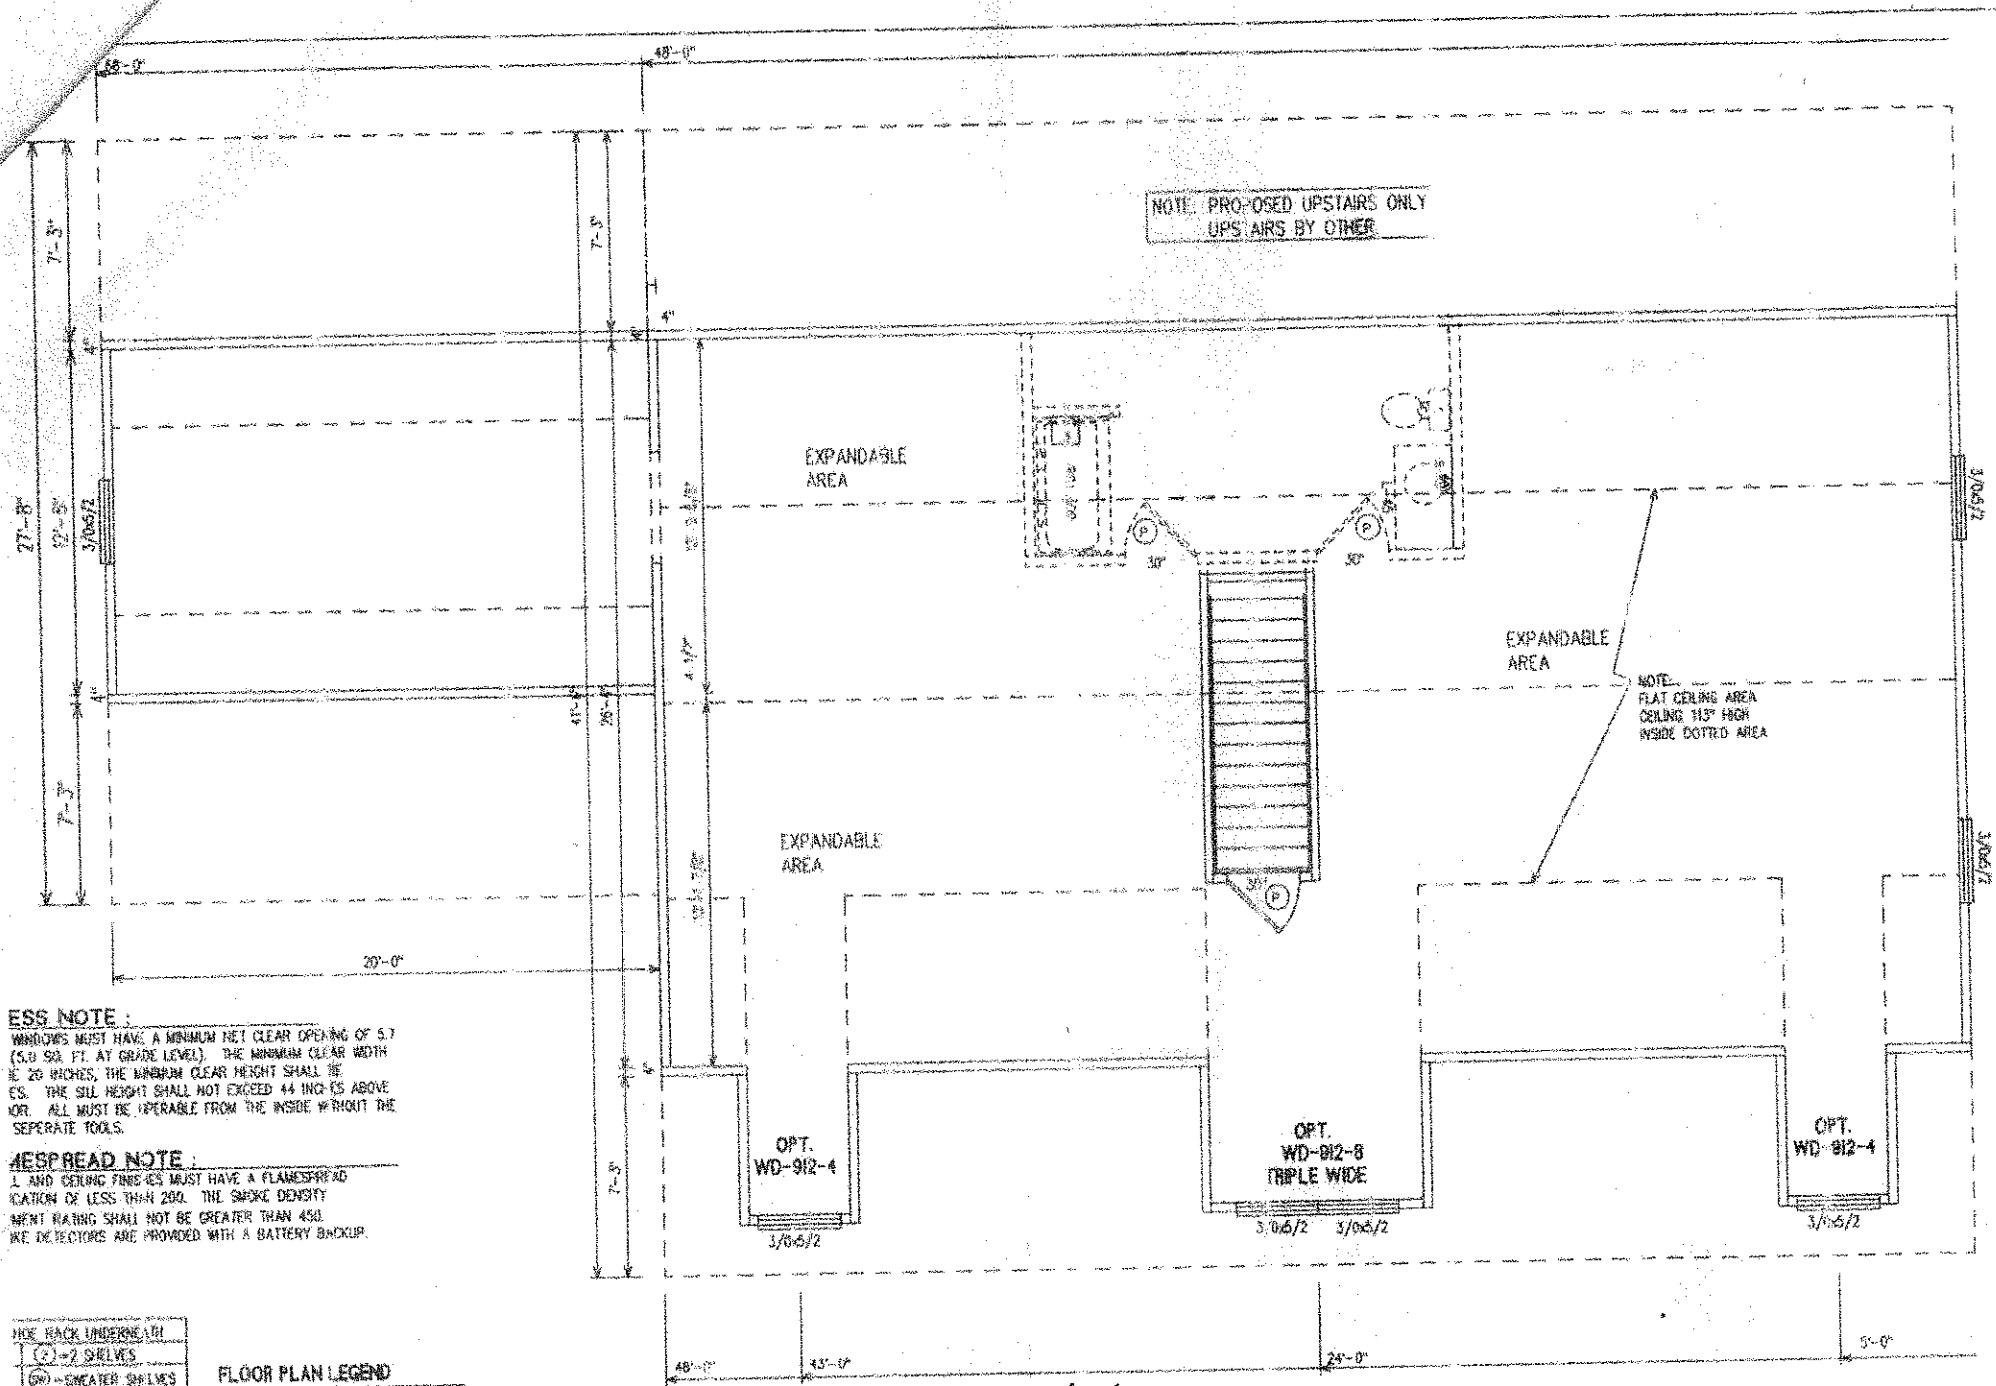

ESS NOTE :
WINDOWS MUST HAVE A MINIMUM NET CLEAR OPENING OF 5.7 (5.0 SQ. FT. AT GRADE LEVEL). THE MINIMUM CLEAR WIDTH IS 20 INCHES, THE MINIMUM CLEAR HEIGHT SHALL BE ES. THE SILL HEIGHT SHALL NOT EXCEED 44 INCHES ABOVE OR. ALL MUST BE OPERABLE FROM THE INSIDE WITHOUT THE SEPERATE TOOLS.

AESPREAD NOTE :
L AND CEILING FINISHES MUST HAVE A FLAMESPREAD ICATION OF LESS THAN 200. THE SMOKE DENSITY MENT RATING SHALL NOT BE GREATER THAN 450. KE DETECTORS ARE PROVIDED WITH A BATTERY BACKUP.

HOE RACK UNDERNEATH
(2) = 2 SHELVES
(SW) = SWEATER SHELVES

FLOOR PLAN LEGEND

	E EGRESS WINDOW	T THERMOSTAT
(R) = 20"X25" RAC WALL	ELECTRICAL PANEL	(S) SMOKE DETECTOR
(24) = 24X42 MIRROR	(A) 22"x 30" ATTIC ACCESS	(P) PRIVACY LOCK
(36) = 36X42 MIRROR	H SHOWER	SG SAFTEY GLAZED

Melanie Lahyman 7/22/08

Marian Dotson 7/22/08

CRN# 14855