4009484998

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Donald Garmon DATE 7/24/89 PERMIT NO. _____

PHONE: Business _____ Home _____

LOCATION 115 N TR Shinnville Rd. TR@ Shinns Store On R 1st house.

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____ S. R. No. _____

House (✓) Mobile Home ( ) Business ( ) Other Repair


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit	Yes ( )	No (✓)	
Auto. Dishwasher	Yes (✓)	No ( )	
Auto. Wash. Machine	Yes (✓)	No ( )	
Site Suitable	Yes (✓)	No ( )	

Character & Porosity of Soil Clayey
Percolation Rate 4
Topography 60%
Depth to Water Table 4'+
Rock or other impervious formations none observed

Lot Area existing

✓ Basement with Plumbing ____ Basement without Plumbing ____ No Basement

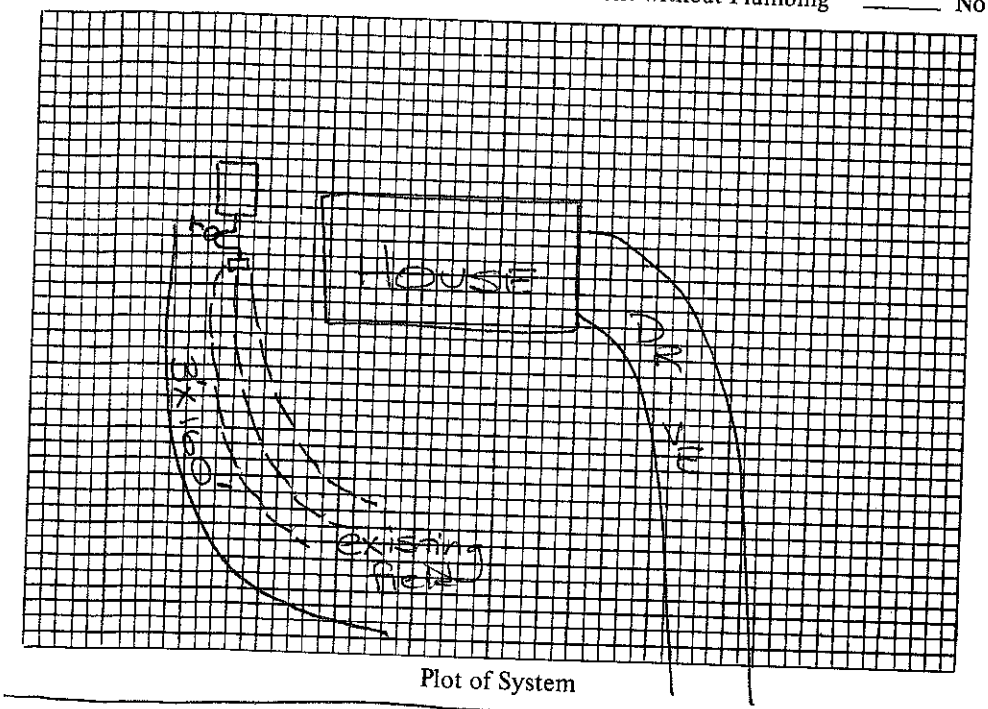

Plot of System

Size of Tank existing Gals.
Nitrification Field:
No. of Lines 1
Sq. Ft. 480 Linear Ft. 160
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by James Huddleston

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY STREET

COMMENTS: _____

CERTIFICATE OF COMPLETION BY Andre C. Price, R.S. DATE July 29, 89

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Donald Garmon DATE 6/26/89 PERMIT NO.

PHONE: Business ______ Home ______

LOCATION US. 21 TR on 2383 TR on 2377
~1/4 mile on Right

SUBDIVISION NAME ______ S. R. No. ______

LOT NO. ______ SECTION OR BLOCK NO. ______

House (✓) Mobile Home ( ) Business ( ) Other ______


No. Bedrooms 3 No. Bathrooms 1½

	Yes	No
Garbage Disposal Unit	( )	(✓)
Auto. Dishwasher	( )	(✓)
Auto. Wash. Machine	(✓)	( )
Site Suitable	(✓)	( )

Character & Porosity of Soil existing
Percolation Rate
Topography
Depth to Water Table
Rock or other impervious formations

Lot Area existing

✓ Basement with Plumbing ______ Basement without Plumbing ______ No Basement

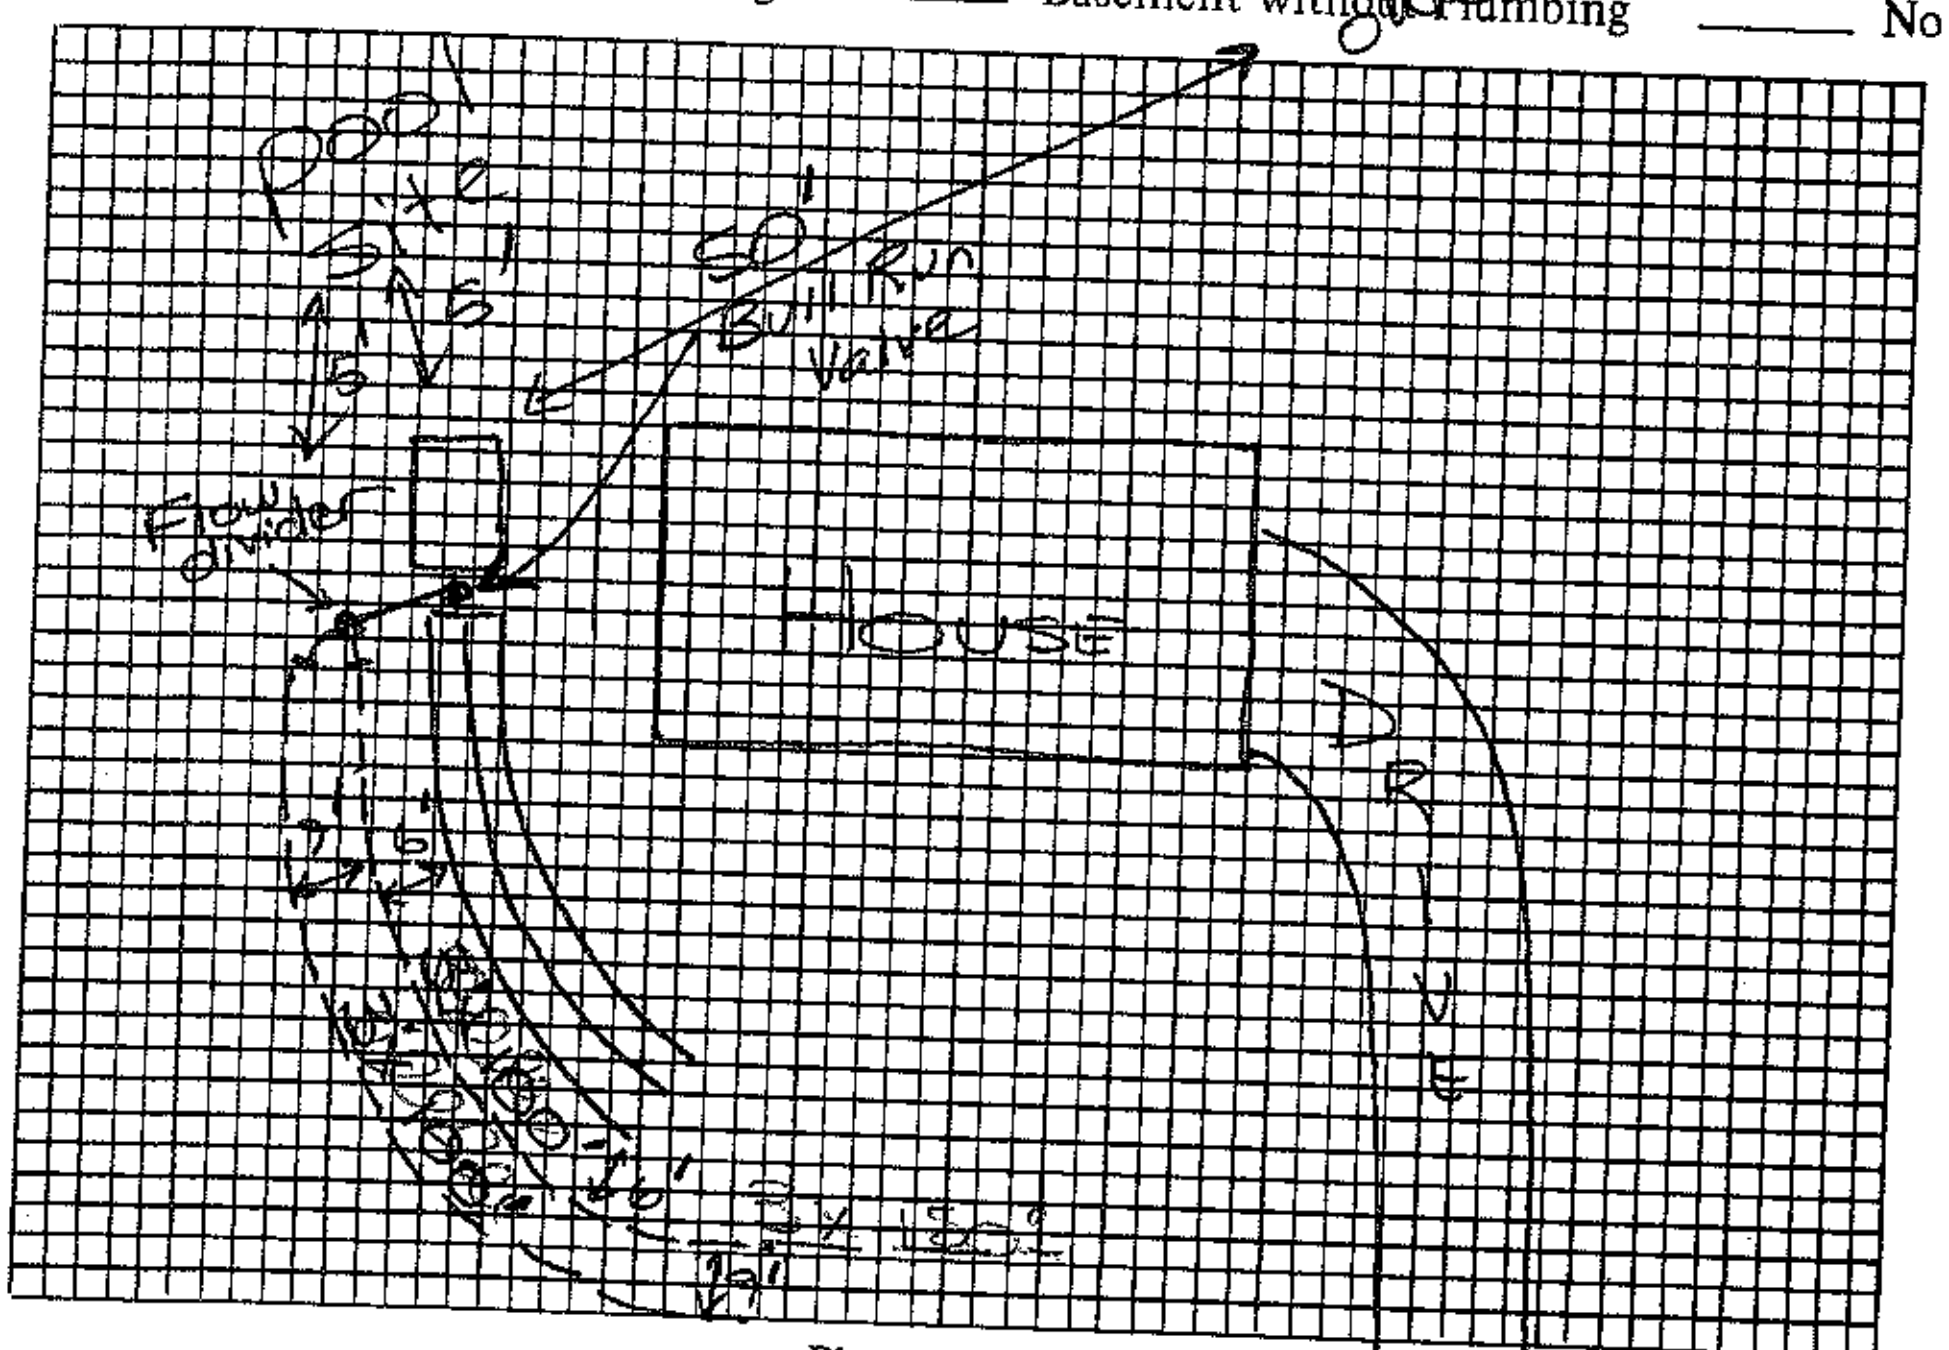

Plot of System
NOT TO SCALE

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 2
Sq. Ft. 600 Linear Ft. ~~200~~ 150
Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by ______

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Donald R Garmon

IMPROVEMENTS PERMIT BY Andie C. Price

COMMENTS: Install a bull run valve and run 2 new lines 6' + off old system. Keep drainlines shallow (30" max. to bottom) and contour. Recommend pumping tank.

CERTIFICATE OF COMPLETION BY Changes approved 7/11/89 ACP DATE ______

EXISTING SYSTEM CHECKED BY: OK → 150' of lines DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.
Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold