DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ___ of ___
PROPERTY ID #: _____
COUNTY: _____

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM

OWNER: _____ APPLICATION DATE _____
ADDRESS: _____ IBR Expansion DATE EVALUATED: 6/9/08
PROPOSED FACILITY: _____ PROPOSED DESIGN FLOW (.1949): 120 PROPERTY SIZE: _____
LOCATION OF SITE: Fuquay Dr. PROPERTY RECORDED: _____
WATER SUPPLY: ☐ Private ☐ Public ☑ Well ☐ Spring ☐ Other _____
EVALUATION METHOD: ☐ Auger Boring ☐ Pit ☐ Cut TYPE OF WASTEWATER: ☐ Sewage ☐ Industrial Process ☐ Mixed


PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
1	TS 5%	0-10	mSbK CL	fr-ss-ps-sexp					PS a35
		10-30	Sr L DkBr	vfr ss np	Few reds	ab 28"			at 18"
		30-40	Sr L DkBr	vfr ss np	Few-com DkGrayish	10YR 6/2		*	max depth
2									
3									
4									

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)		
System Type(s)		
Site LTAR		

OTHER FACTORS (.1946): _____
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: Anthony Cobert
OTHER(S) PRESENT: _____

AC

6/5/08

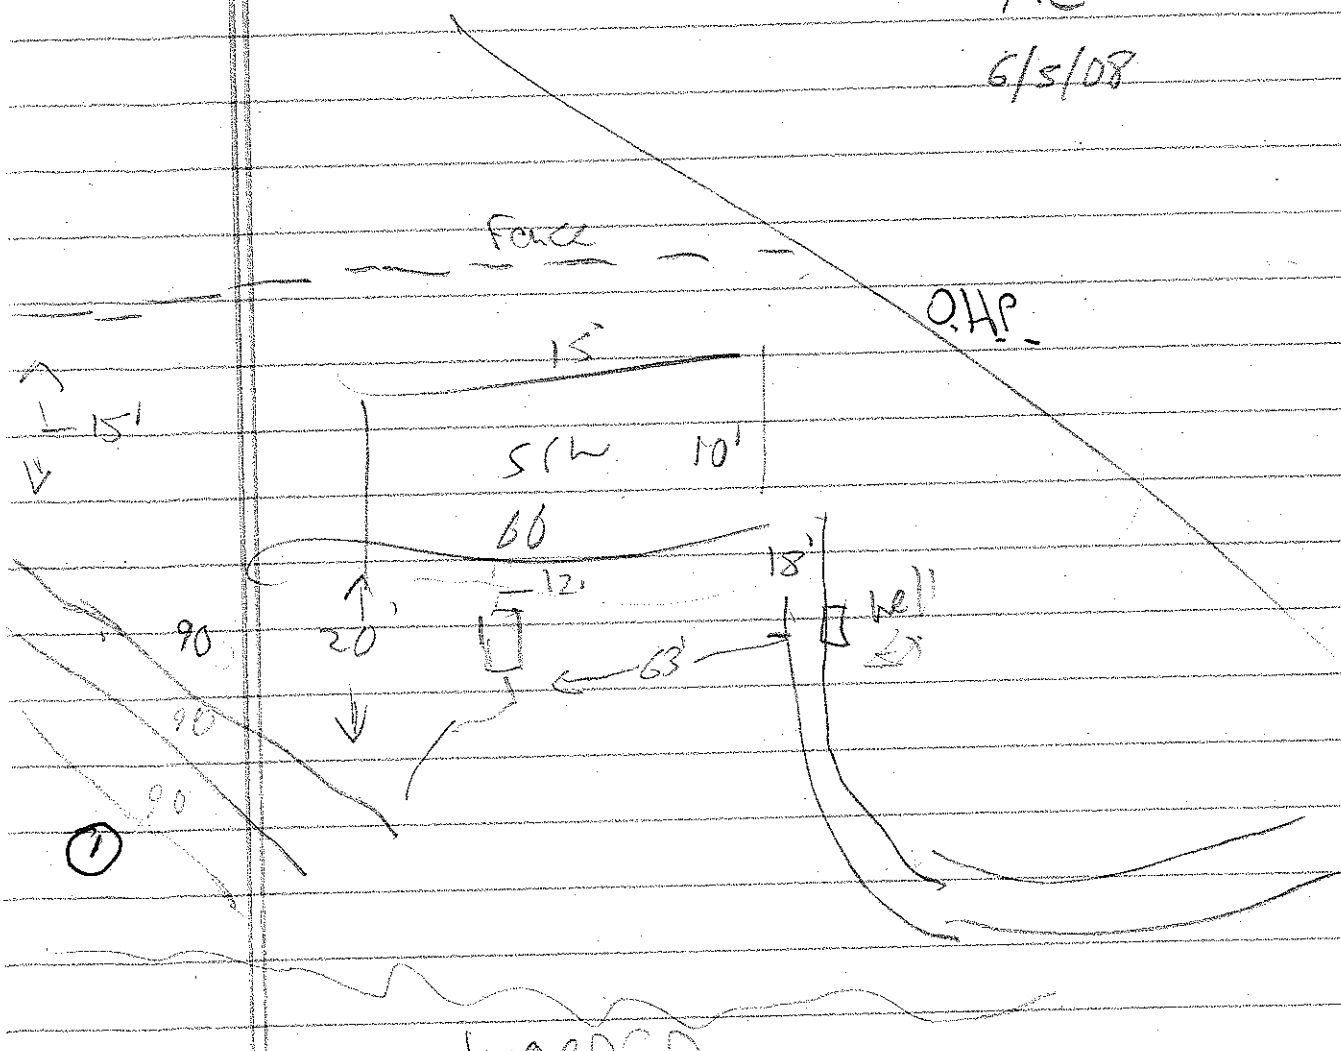

If increasing size of MH to 26' wide

Tank will likely need to be relocated