9744
9745

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Donald Ray Pope DATE 4/27/89 ~~PERMIT NO.~~ Quad # 22C

PHONE: Business ______ Home 598-6620

LOCATION 136 South TR Johnson Dairy Rd. On Left ~ 1/4 mile before the creek. S. R. No. ______

SUBDIVISION NAME ______ LOT NO. ______ SECTION OR BLOCK NO. ______

Tax #: 1B-A-9 Coddle Creek

House ( ) 2 Mobile Homes (✓) Business ( ) Other ______
ea. w/ 3BR/2Baths.

No. Bedrooms 6 No. Bathrooms 4


Garbage Disposal Unit	Yes ( )	No (✓)
Auto. Dishwasher	Yes (✓)	No ( )
Auto. Wash. Machine	Yes (✓)	No ( )
Site Suitable	Yes (✓)	No ( )

Character & Porosity of Soil clay
Percolation Rate .3gpd/ft²
Topography 6-10%
Depth to Water Table 4'+
Rock or other impervious formations none observed

Lot Area 6 ACRES

____ Basement with Plumbing ____ Basement without Plumbing ✓ No Basement

P.T.: 2000 gals

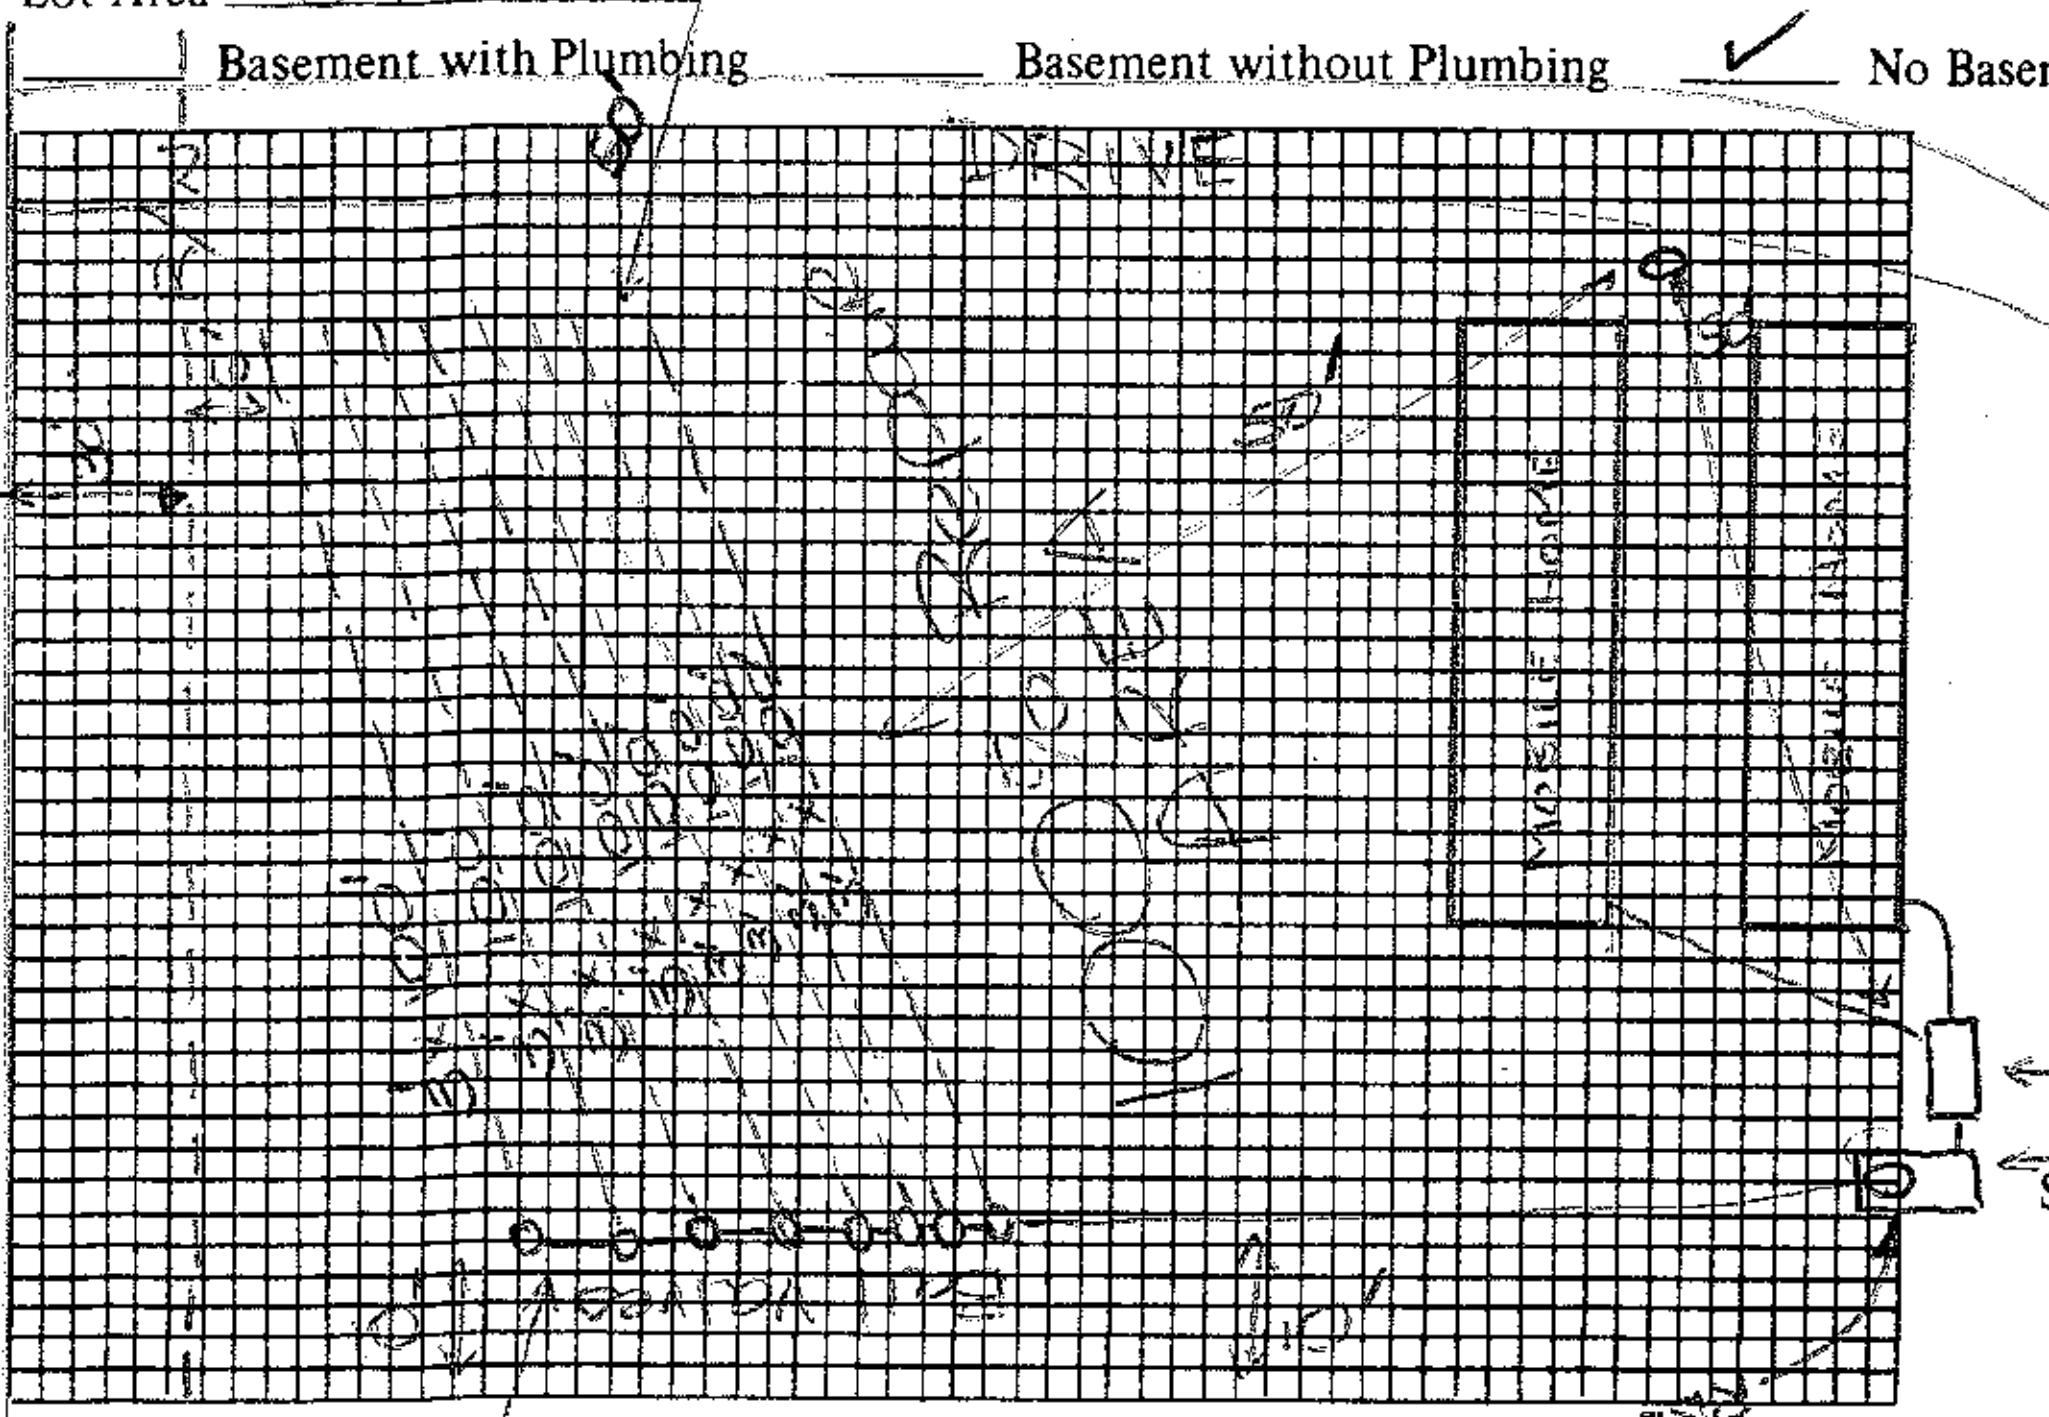

Plot of System

Size of Tank 2000 Gals.
Nitrification Field:
No. of Lines 8
Sq. Ft. 2400 Linear Ft. 800
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Robert Brigman Septic Tank and Grading Mecklenburg

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: Donald Ray Pope

441gals

IMPROVEMENTS PERMIT BY André C. Pierce

COMMENTS: Install tanks behind 2nd Mobile Home. Run pumpline 10' from property line and install 1st drainline on highest contour in order to install ~100' drainline. Stay 5' from R/W. Drainlines must be shallow (24" MAXIMUM) and

CERTIFICATE OF COMPLETION BY lines must be ON CONTOUR & level. DATE ______

EXISTING SYSTEM CHECKED BY: ~~[illegible]~~ Use 3" pumpline and reduce DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit. to 1 1/2" Sch. 40 PVC. w/ 5/32" hole every 5'.

Pumps should deliver 66gal/min with a total head of 25'.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold