4674 28 2433

IREDELL COUNTY HEALTH DEPARTMENT 488 JOHNSON DAIRY RD.

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Wesley Enroth DATE 12-30-86 PERMIT NO. 653

PHONE: Business _____ Home _____

LOCATION 136 S. TR 1142 (Johnson Dairy Rd.) ¼ mile on left

S. R. No. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

Future Temporary

House (✓) Mobile Home ( ) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Lot Area 8.13 Ac

Character & Porosity of Soil Clay
Percolation Rate 13
Topography S-Slope
Depth to Water Table 4FT
Rock or other impervious formations none obs.

_____ Basement with Plumbing _____ Basement without Plumbing _____ No Basement

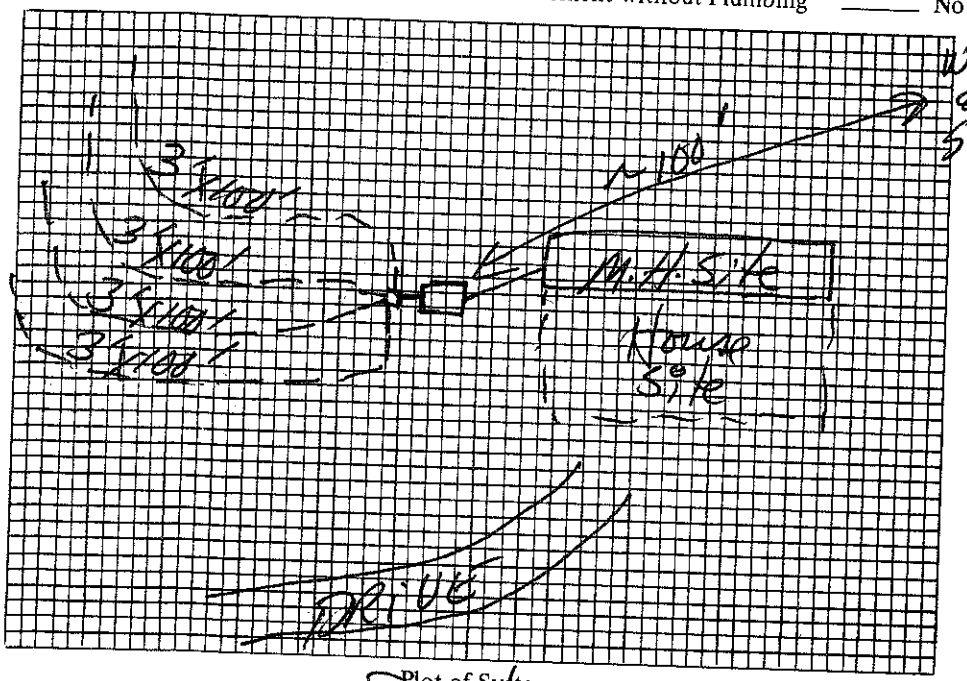

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 1200 Linear Ft. 300
Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by J. Irvin

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: _____

IMPROVEMENTS PERMIT BY DRJ

COMMENTS: _____

CERTIFICATE OF COMPLETION BY DR Johnson, RS. DATE 12-30-86

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

11500

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System -- G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR Wesley Enroth DATE 10-22-86 PERMIT NO. 446

PHONE: Business _____ Home _____

LOCATION 136 S. TR 1142 (~~Hiatt~~ Johnson Dairy Farm Rd.) ~1/4 mile on left 300' off road S. R. NO. _____

SUBDIVISION NAME _____ LOT NO. _____ SECTION OR BLOCK NO. _____

Future Temporary

House (~~✓~~) Mobile Home (✓) Business ( ) Other _____


No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Character & Porosity of Soil Clay
Percolation Rate 45
Topography 8-16%
Depth to Water Table 40+
Rock or other impervious formations none obs.

Lot Area 8.31 Ac.

_____ Basement with Plumbing _____ Basement without Plumbing ✓ No Basement

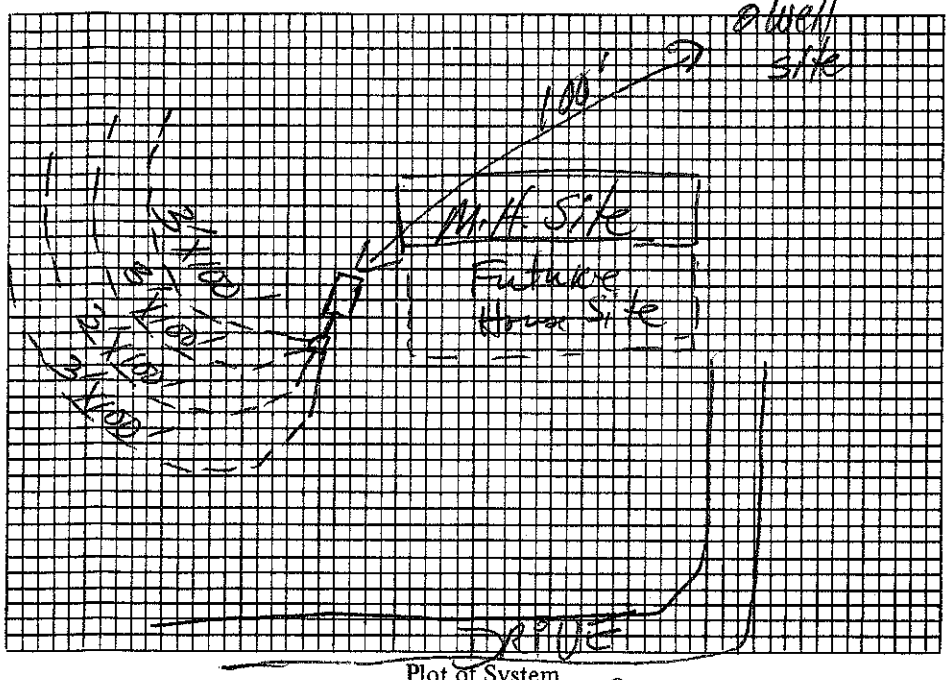

Plot of System

Size of Tank 1000 Gals.

Nitrification Field:
No. of Lines 4
Sq. Ft. 1200 Linear Ft. 480
Depth of Stone in Lines 12"

Water Supply: Individual (✓)
Public ( )

Installed by _____

I understand and agree to install septic tank system as specified on this Improvements Permit.

~~Signed~~: Wesley Enroth

IMPROVEMENTS PERMIT BY David R. Hinson, RS

COMMENTS: Keep drainfield shallow (12" cover)

CERTIFICATE OF COMPLETION BY _____ DATE _____

EXISTING SYSTEM CHECKED BY: _____ DATE _____

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold