IREDELL COUNTY HEALTH DEPARTMENT 4674292427

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System – G. S. Chapter 130-Article 13C)

Mooresville office

OWNER OR CONTRACTOR Jack Callahan DATE 7-1-77 PERMIT NO.

PHONE: Business → James E. Johnson Home

477 Johnson Dairy Road - Mrsvl.

LOCATION Cattle Creek Rd (1143) TR on 1142 1000' TR on Drive 500' off Road S. R. No. 1142

SUBDIVISION NAME LOT NO. SECTION OR BLOCK NO.


House (✓) Mobile Home ( ) Business ( ) Other

No. Bedrooms 4 No. Bathrooms 2

Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
Site Suitable Yes (✓) No ( )

Lot Area approx. 12 acres

Character & Porosity of Soil Provisionable suitable soil
Percolation Rate 60 to 120 min/inch
Topography 2% slope
Depth to Water Table 10'+
Rock or other impervious formations none

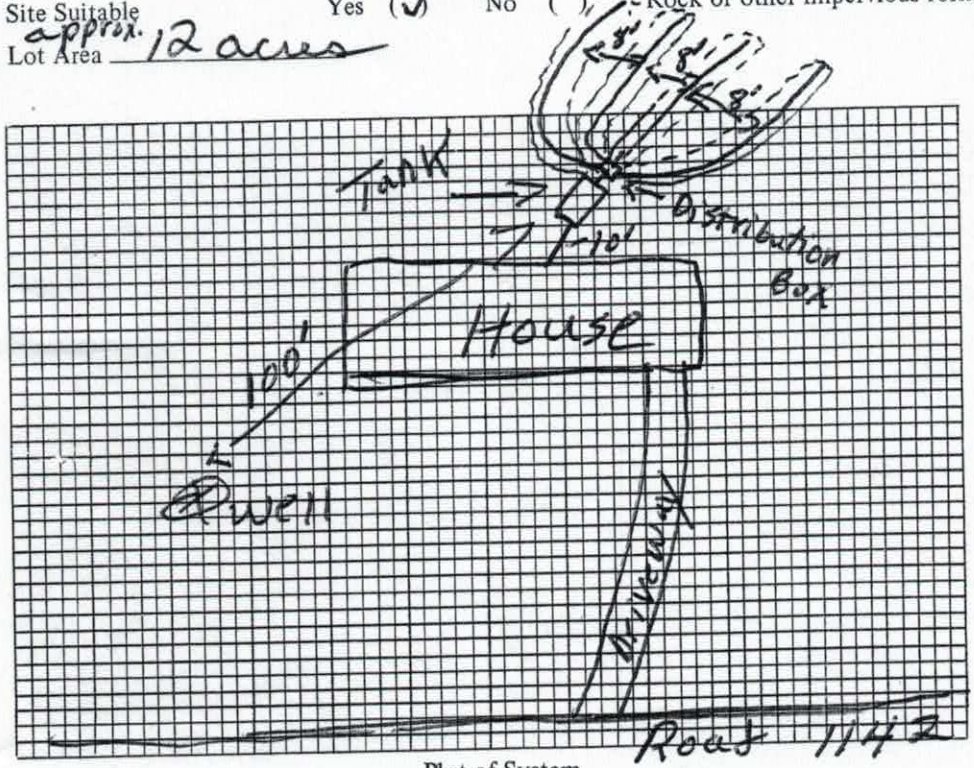

Plot of System

Size of Tank 1250 Gals.
Nitrification Field:
No. of Lines 4
Sq. Ft. 1200 Linear Ft. 400
Depth of Stone in Lines 10"
Water Supply: Individual (✓)
Public ( )

Installed by


IMPROVEMENTS PERMIT BY R. C. Moore

COMMENTS: System has 4 intivitual Ditches 3'X 100' each set atleast 8' apart on center. This is to be in accord with State Sewage ordinance effective 7-1-7

CERTIFICATE OF COMPLETION BY DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold

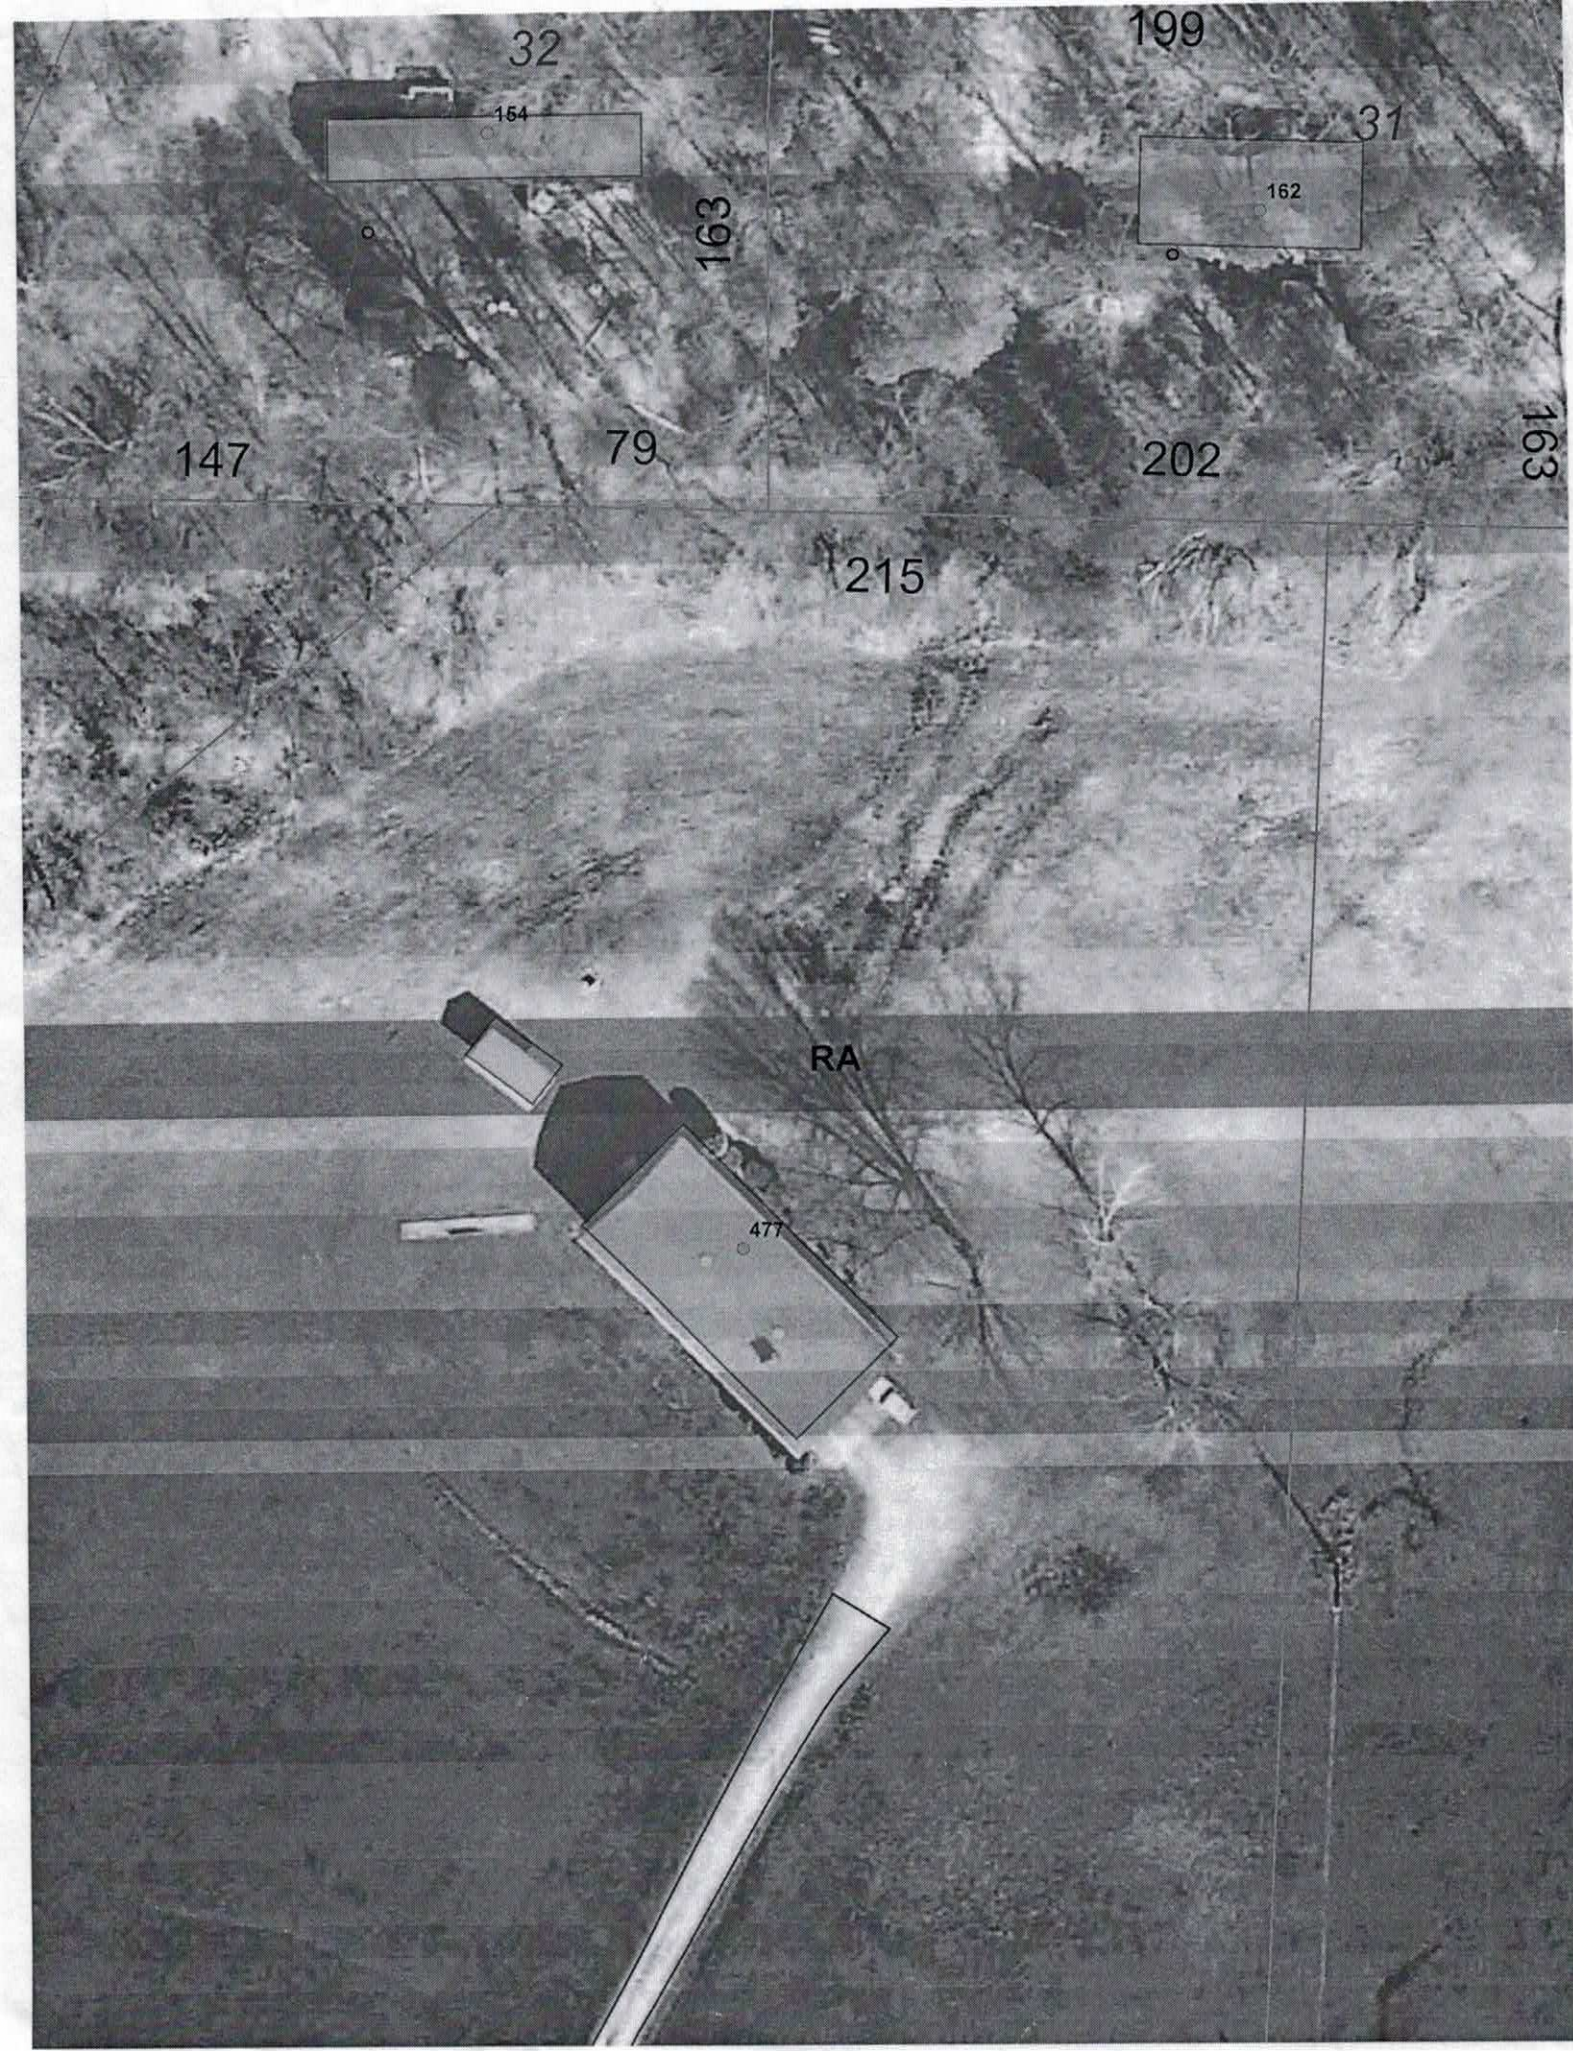
32
154
163
199
31
162
147
79
202
163
215
RA
477