4675303509

10799

IREDELL COUNTY HEALTH DEPARTMENT

(SEPTIC TANK) IMPROVEMENTS PERMIT AND CERTIFICATE OF COMPLETION
(Ground Absorption Sewage Disposal System — G. S. Chapter 130-Article 13C)

OWNER OR CONTRACTOR EMR Builders DATE March 20, '91 PERMIT NO. 1B-1-B1

PHONE: Business ______ Home ______

LOCATION 136 S, TR (~1/4 mile before Johnson Dairy Rd.) into Hunter Woods (1st lot on Right) S. R. No. ______


SUBDIVISION NAME Hunter Woods LOT NO. 1 SECTION OR BLOCK NO. ______

House (✓) Mobile Home ( ) Business ( ) Other ______

No. Bedrooms 3 No. Bathrooms 2
Garbage Disposal Unit Yes ( ) No (✓)
Auto. Dishwasher Yes (✓) No ( )
Auto. Wash. Machine Yes (✓) No ( )
~~Site Suitable~~ PS Yes (✓) No ( )
Neighbors Well Area ≈ 1/2 Ac.

Character & Porosity of Soil PS clay
Percolation Rate LTAR .35
Topography 2-4%
Depth to Water Table 4'+
Rock or other impervious formations none obs.

______ Basement with Plumbing ______ Basement without Plumbing ✓ No Basement

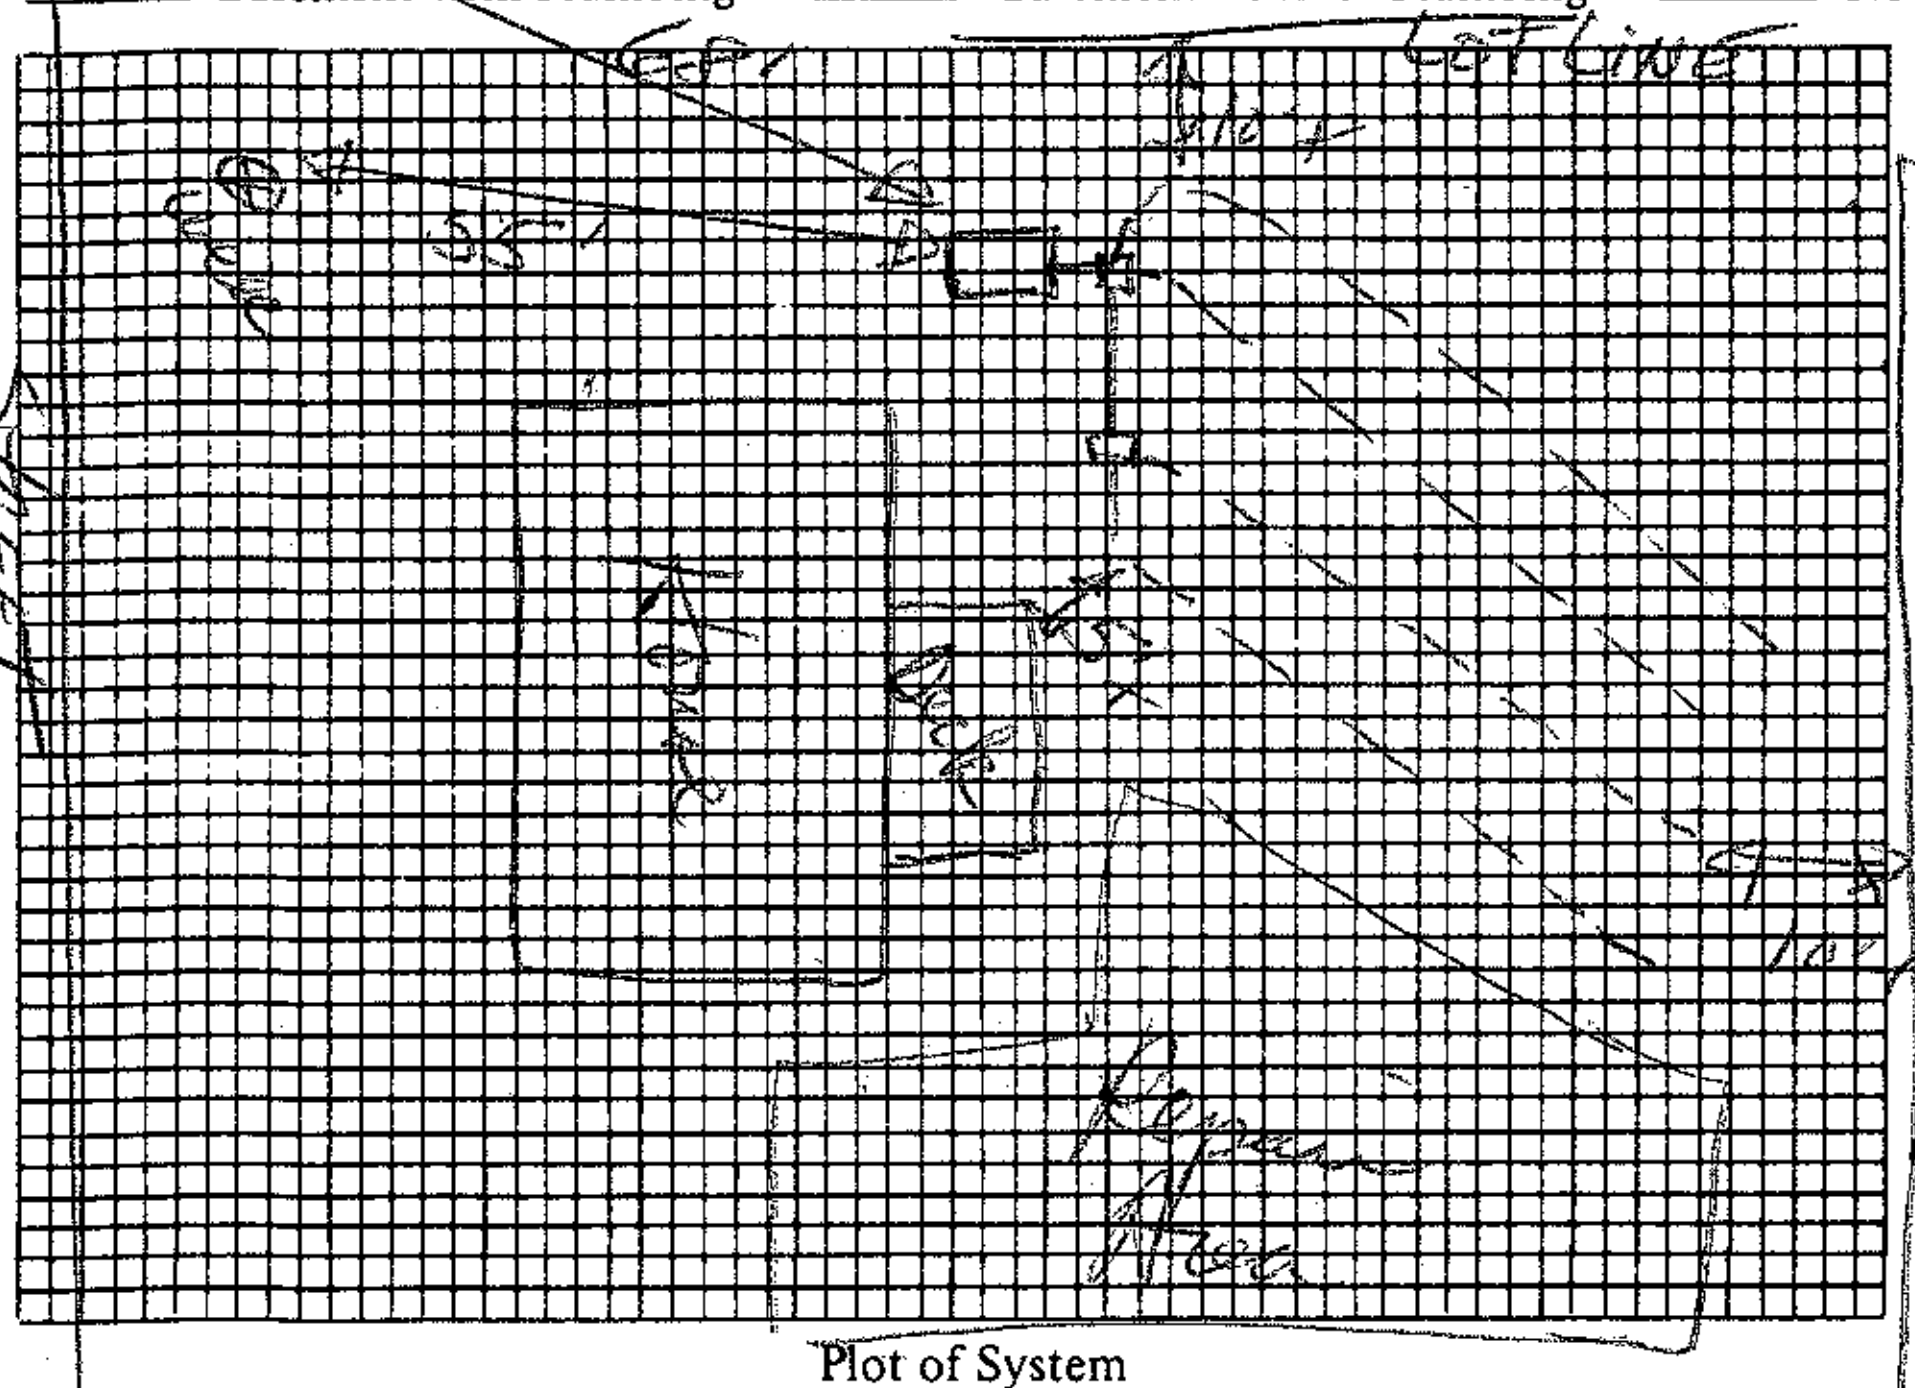

Plot of System

← Hwy 136 S

Size of Tank 1000 Gals.
Nitrification Field:
No. of Lines 4
Sq. Ft. 1050 Linear Ft. 350
Depth of Stone in Lines 12"
Water Supply: Individual (✓)
Public ( )

Installed by Delbert Bostian

I understand and agree to install septic tank system as specified on this Improvements Permit.

Signed: ______

IMPROVEMENTS PERMIT BY DBH

COMMENTS: Original permit in name of Kerry Davis (12/28/89)

CERTIFICATE OF COMPLETION BY David R. Hinson, EHC DATE 3/20/91

EXISTING SYSTEM CHECKED BY: ______ DATE ______

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS.

Permit is VOID if any unauthorized changes are made in installation of system and/or if any false information is supplied in making Improvements Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold