15018

IREDELL COUNTY HEALTH DEPARTMENT

IMPROVEMENT PERMIT AND CERTIFICATE OF COMPLETION / OPERATIONS PERMIT

OWNER OR CONTRACTOR PBS REALTY INC. DATE 8/25/92 PERMIT NO. IH-12-H-68

PHONE: Business 532-6529 Home

LOCATION Enochville Rd, TL on Bromley TR first entrance, to stop sign TR to 3rd drive on (R) S.R. No.

SUBDIVISION NAME QUAIL HILL LOT NO. 68 SECTION OR BLOCK NO. 3+4

House ☐ Mobile Home ☑ SINGLE WIDE Business ☐ Other

No. Bedrooms 3 No. Bathrooms 2

Garbage Disposal Unit Yes ☐ No ☑

Auto. Dishwasher Yes ☑ No ☐

Auto. Wash. Machine Yes ☑ No ☐

Lot Area ~ AC

Soil Characteristics P - cl / c TRANS

Application Rate P - .2 (F, sp - wk structure)

Topography P - 3-4%

Depth to Water Table S - >48"

Rock or other impervious formations S - 39-40" TO TRANSITION

Basement with Plumbing Basement without Plumbing No Basement ✓ Crawl Space

Size of Tank 1000 ST / 1000 PT Gals.

Nitrification Field:


No. of Lines 4 @ 75' x 2' ✱

Sq. Ft. Linear Ft. 300

Depth of ~~Stone~~ SAND in Lines 6" SAND

Water Supply: Individual ☑ NOT DRILLED Public ☐

✱ 16" Prefabricated Permeable Panels - Pressure Distributed

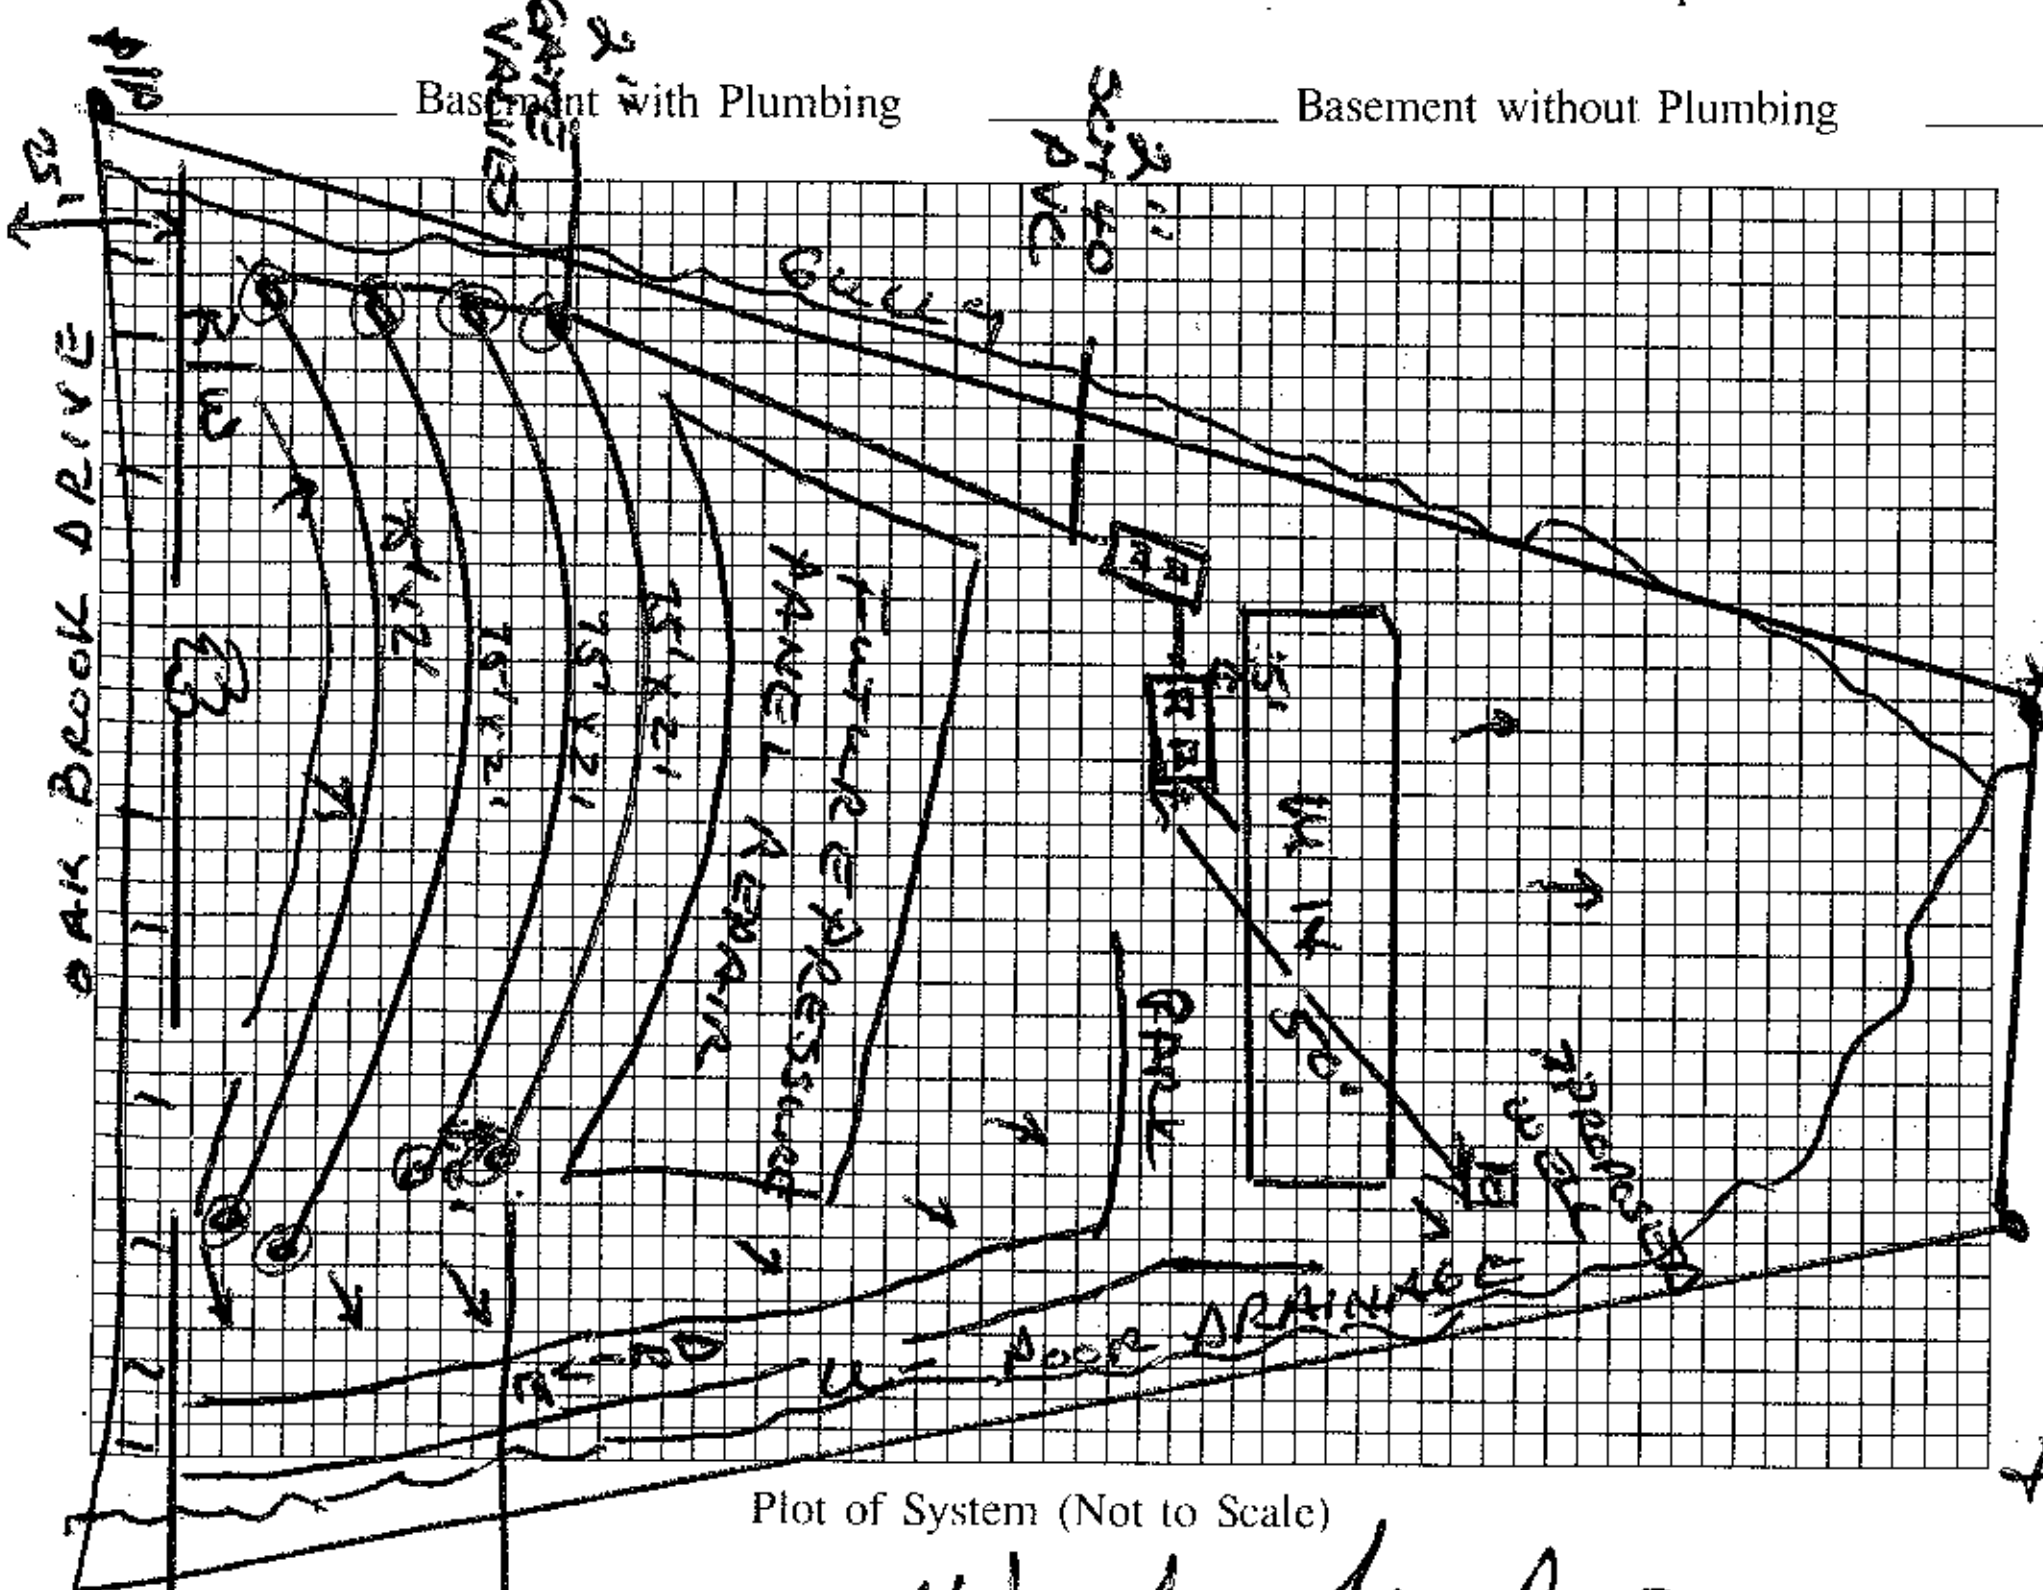

Plot of System (Not to Scale)

Installed by

I understand and agree to install a septic tank system as specified on this Improvement Permit.

Signed: [signature]

(IMPROVEMENT PERMIT IS VALID FOR 60 MONTHS FROM DATE OF ISSUE.)

✱ ELEVATION HEAD NEEDS TO BE MEASURED ON SITE FROM TANK FLOOR TO UPPER LATERAL

IMPROVEMENT PERMIT BY Wesley Sparks R.S.

COMMENTS 35-37 GPM SEWAGE RATED PUMP - APPROXIMATE ELEVATION HEAD OF 20' - 2' PRESSURE AT END OF EACH DRAINLINE - 2" GATE VALVE AT BEGINNING OF EACH DRAINLINE - MAINTENANCE AGREEMENT REQUIRED BEFORE OPERATIONS PERMIT ISSUED

CERTIFICATE OF COMPLETION BY DATE 12/14/92

EXISTING SYSTEM CHECKED BY DATE

CONSTRUCTION MUST COMPLY WITH ALL OTHER APPLICABLE STATE AND LOCAL REGULATIONS

Permit is VOID if any unauthorized changes are made in installation of system, and/or if any unapproved changes are made to the site, and/or if any false information is supplied toward securing Improvement Permit.

Health Dept. Copy: White Inspection Dept. Copy: Yellow Sanitarian's Copy: Pink Owner's Copy: Gold