DEPARTMENT OF ENVIRONMENT AND NATURAL RESOURCES
DIVISION OF ENVIRONMENTAL HEALTH
ON-SITE WASTEWATER SECTION

Sheet ____ *of* ____
PROPERTY ID #: _____
COUNTY: Iredell

SOIL/SITE EVALUATION
for ON-SITE WASTEWATER SYSTEM


OWNER: IREDELL GROUP APPLICATION DATE 3/06
ADDRESS: 109-C WILLIAMSON ROAD MOORESVILLE DATE EVALUATED: 3/06
PROPOSED FACILITY: RES PROPOSED DESIGN FLOW (.1949): 480 PROPERTY SIZE: ____ AC
LOCATION OF SITE: Walden Ridge Lot 15 PROPERTY RECORDED: Y
WATER SUPPLY: X Private ☐ Public ☐ Well ☐ Spring ☐ Other
EVALUATION METHOD: ☐ Auger Boring X Pit ☐ Cut TYPE OF WASTEWATER: X Sewage ☐ Industrial Process ☐ Mixed

PROFILE #	.1940 LANDSCAPE POSITION/ SLOPE %	HORIZON DEPTH (IN.)	SOIL MORPHOLOGY (.1941) .1941 STRUCTURE/ TEXTURE	SOIL MORPHOLOGY (.1941) .1941 CONSISTENCE/ MINERALOGY	OTHER PROFILE FACTORS .1942 SOIL WETNESS/ COLOR	.1943 SOIL DEPTH	.1956 SAPRO CLASS	.1944 RESTR HORIZ	PROFILE CLASS & LTAR
15A	LSS 8-10%	0-29	RC MFSBK	fri SSSP SexP	N/A	52"	N/A	N/A	PS .3 gpd/ft²
		29-52	RCL WFSBK	fri SSSP SexP					
15B	8-10%	0-7	BSCL C-R	fri SSSP SexP	N/A	49"	N/A	N/A	PS .3 gpd/ft²
		7-49	RC MFSBK	fri SSSP SexP					
15C	8-10%	0-18	RC MFABK	fri SSSP SexP	few SAPInc. N/A	52"	N/A	N/A	PS .3 gpd/ft²
		18-52	RCL MWSBK	fri SSSP SexP					
D		0-8	WKSBK rhen scl	fr SSSP					.3
		8-24	ABK/SBK rd C	fr SSSP SexP					
		24-51	WKSBK rd cl	fr SSSP					

DESCRIPTION	INITIAL SYSTEM	REPAIR SYSTEM
Available Space (.1945)	1200 ft²	1368 ft²
System Type(s)	25% Rcd	25% Rcd
Site LTAR	.3	.3

OTHER FACTORS (.1946):
SITE CLASSIFICATION (.1948): PS
EVALUATED BY: ROLLANS SOIL & ENVIRONMENTAL SERVICES
OTHER(S) PRESENT:

COMMENTS:

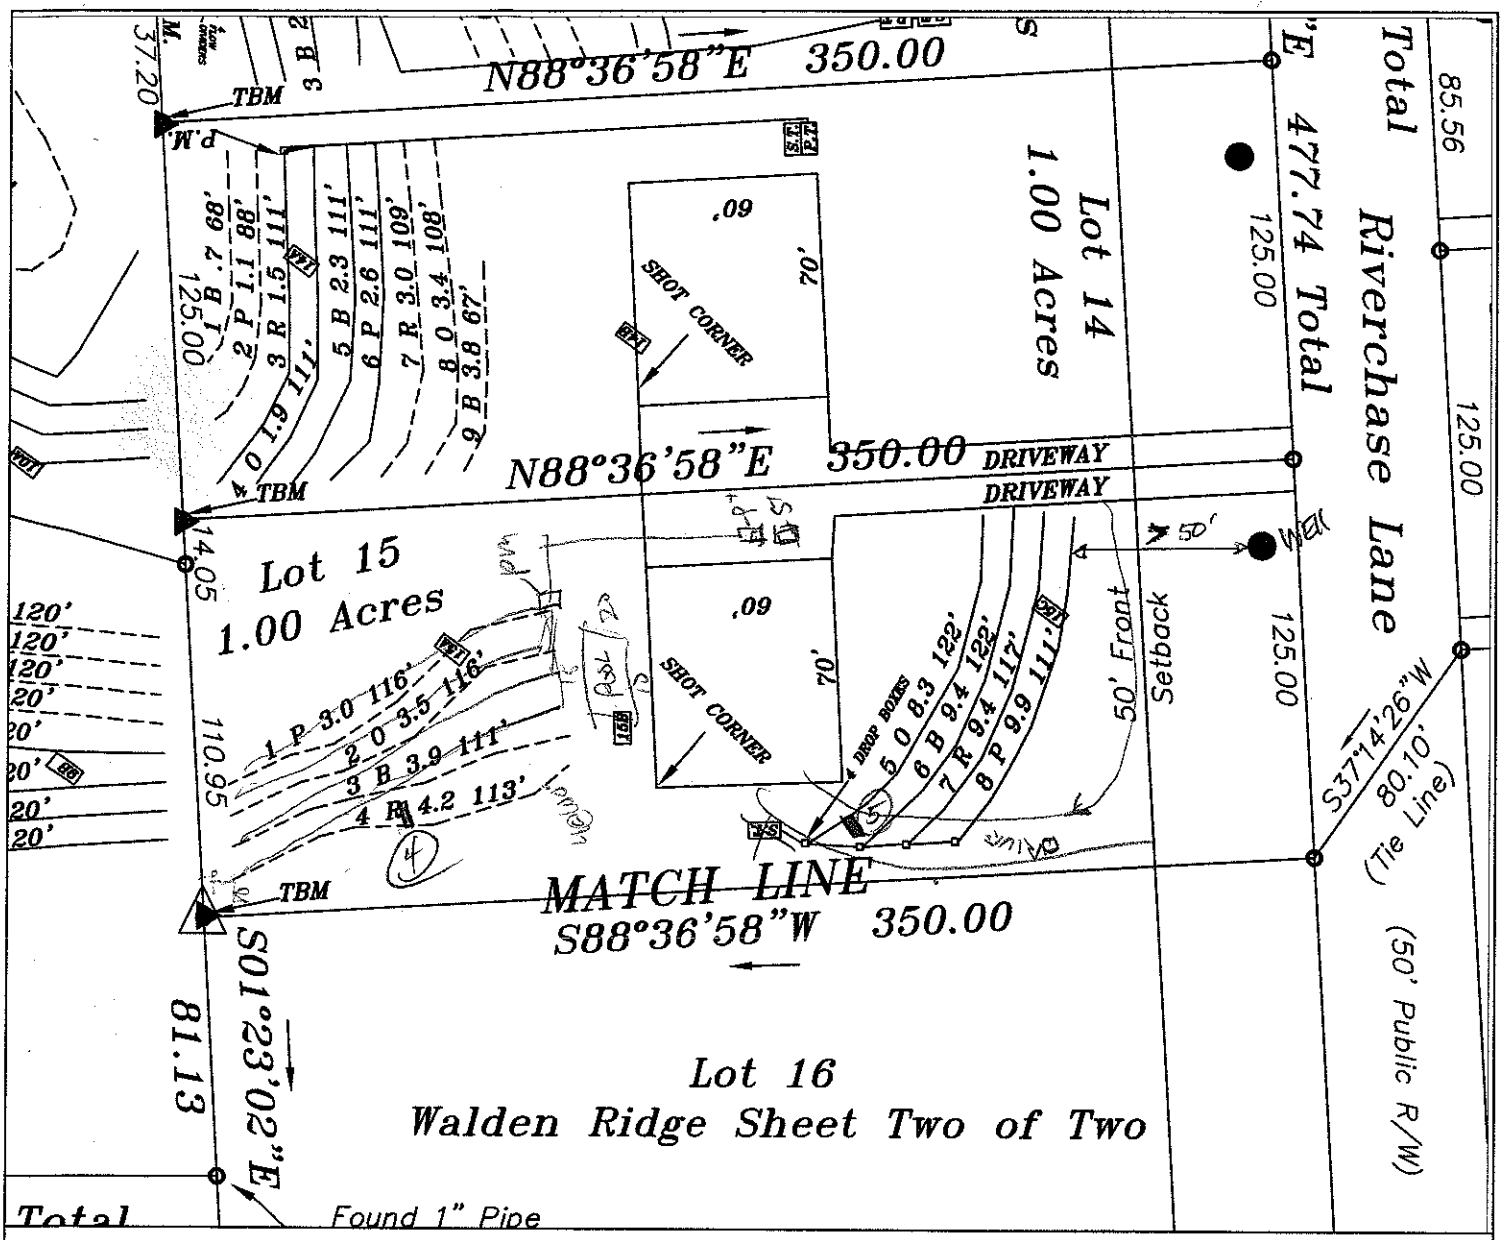

LEGEND

- Areas contain soils with 24 inches or more of useable material and have potential for conventional, modified conventional and low-pressure pipe (lpp) septic systems.
- Unsuitable areas.
- System lines.
- Repair lines.
- Temporary Bench Mark (TBM)
- Well Location.

GRAPHIC SCALE
1" = 60'

60 0 60 120

FOR PRELIMINARY PLANNING PURPOSES ONLY. ALL LOTS WILL REQUIRE FINAL APPROVAL BY THE COUNTY HEALTH DEPARTMENT ON A LOT BY LOT BASIS. THIS MAP SHOULD BY USED AS A GENERAL GUIDE, SOME ADJUSTMENTS WILL BE NECESSARY IN THE FIELD DUE TO SOIL VARIABILITY AND COMPLEX TOPOGRAPHIC FEATURES. THIS MAP ONLY REFLECTS EXISTING SOIL SUITABILITY FOR ON-SITE SEPTIC TANK SYSTEMS.

PLEASE REFER TO ATTACHED SOIL REPORT FOR ADDITIONAL SITE SPECIFIC INFORMATION

ROLLANS SOIL & ENVIRONMENTAL SERVICES
2120 GRAHAM ROAD
MOUNT ULLA, NC 28125
PHONE/FAX: (704) 278-0989
ASHLEY ROLLANS, NC LICENSED SOIL SCIENTIST
MOBILE: (704) 746-5046
EMAIL: ROLLANSPORTCJ@AOL.COM

MAP TITLE: SITE PLAN & DRAINFIELD AREAS

PROJECT NAME: IREDELL GROUP LLC/WALDEN RIDGE SUBDIVISION

LOCATION/DATE: TEETER ROAD IREDELL COUNTY, NORTH CAROLINA DECEMBER 2005

JOB # :	01-1069
FILE:	C:\JOBS\01-1069
PROJECT MGR.:	CBF
FIELD WORK:	CBF AND AP
DRAWN BY:	CBF AND AP